



1600 Walnut Street, 2nd Floor  
Philadelphia, PA 19103  
215-985-4410  
[smparchitects.com](http://smparchitects.com)

## **ADDENDUM 2**

**June 4, 2024**

### **Sheets**

<b>A0.1</b>	Alternate 1 removed. Made an Allowance.
<b>C1.0</b>	Revisions to tree removal/replacement.
<b>C2.0</b>	Revisions to tree removal/replacement.
<b>C3.0</b>	Revisions to depth of excavation.
<b>C6.0</b>	Revisions to tree removal/replacement.
<b>C7.0</b>	Tree Planting detail



# CITY OF PHILADELPHIA FREE LIBRARY OF PHILADELPHIA

MAYOR - CHERELLE L. PARKER  
PRESIDENT AND DIRECTOR - FREE LIBRARY - KELLY RICHARDS

## MCPHERSON SQUARE LIBRARY

PROJECT NO.: 52025E-05-01

601 E Indiana Ave,  
Philadelphia, PA 19134

### CONSTRUCTION DOCUMENTATION ADDENDUM 2



**SMP ARCHITECTS**  
1600 Walnut Street, 2nd Floor  
Philadelphia, Pennsylvania 19103  
215 985 4410

**CIVIL ENGINEER:**  
**KS ENGINEERS, P.C.**  
530 Walnut Street, Suite 460  
Philadelphia, Pennsylvania 19106  
215 925 0425

**STRUCTURAL ENGINEER:**  
**ANN ROTHMANN STRUCTURAL ENGINEERING**  
100 East Lancaster Avenue, Suite 203  
Wayne, Pennsylvania 19087  
610 213 3657


**ROOFING CONSULTANT:**  
**STEVE McLAUGHLIN**  
Steve McLaughlin  
210 Garden Avenue  
Somerville, NJ 08083  
856 287 2422

**PROJECT USER:**  
**FREE LIBRARY OF PHILADELPHIA**  
1901 Vine Street,  
Philadelphia, Pennsylvania 19103

**PROJECT ADMINISTRATOR:**  
**REBUILD PHILADELPHIA**  
Cassie O'Connell, Project Manager  
1515 Arch Street, Mezzanine Level  
Philadelphia, Pennsylvania 19107



#### LOCATION PLAN

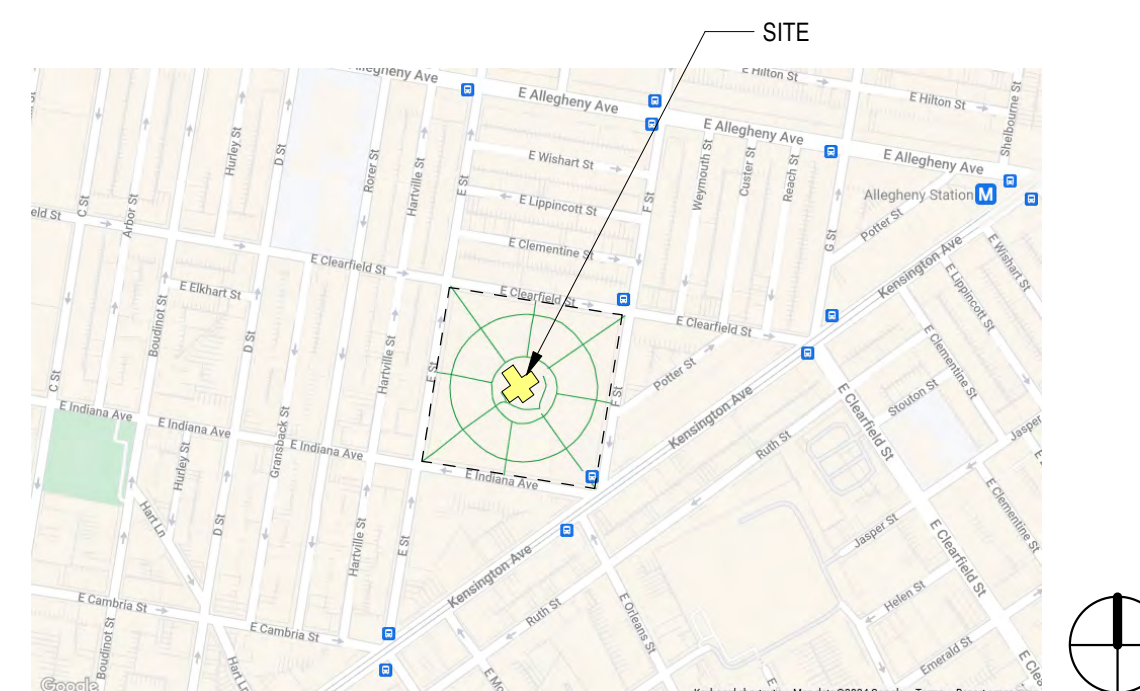

#### DRAWING LIST

GENERAL	
CS 1	COVER SHEET
A0.1	GENERAL NOTES, ABBREVIATIONS, MATERIALS, REFERENCE SYMBOLS
CIVIL	
C1.0	EXISTING SITE PLAN
C2.0	DEMOLITION PLAN
C3.0	PROPOSED SITE PLAN
C6.0	EROSION AND SEDIMENT CONTROL PLAN
C6.1	EROSION AND SEDIMENT CONTROL DETAILS
C6.2	EROSION AND SEDIMENT CONTROL NOTES
C7.0	CONSTRUCTION DETAILS
C8.0	UTILITY DETAILS
C8.1	UTILITY DETAILS
ARCHITECTURAL	
D2.0	DEMOLITION BASEMENT & ROOF PLAN
D3.0	DEMOLITION EXTERIOR ELEVATIONS
D3.1	DEMOLITION EXTERIOR ELEVATIONS
A2.0	FLOOR PLANS
A2.1	ROOF PLAN
A3.0	EXTERIOR ELEVATIONS
A3.1	EXTERIOR ELEVATIONS
A8.0	ROOF DETAILS
A8.1	CORNICE DETAILS
A10.0	DOME INTERIOR PHOTOS
STRUCTURAL	
S1	ROOF FRAMING PLAN, SECTIONS AND NOTES

#### PROJECT APPROVED

PROJECT MANAGER/PUBLIC PROPERTY  
PROJECT MANAGER/REBUILD  
ART COMMISSION

SEALS

CITY OF PHILADELPHIA  
DEPARTMENT OF PUBLIC PROPERTY

ROOM 709

PHILADELPHIA	PENNSYLVANIA
PROJECT NO. 52025E-05-01	DRAWING NO. CS-1
DATE 04/15/2024	SCALE AS NOTED
DRAWN BY JS	CHECKED BY JGH


NOTE: ALL DIMENSIONS AND CONDITIONS SHALL BE VERIFIED BY THE CONTRACTOR AT THE SITE BEFORE PROCEEDING WITH THE WORK.



**GENERAL NOTES:**

1. DO NOT SCALE DRAWINGS.
2. THE CONTRACTOR SHALL OBTAIN ALL REQUIRED PERMITS PRIOR TO THE START OF CONSTRUCTION.
3. THE CONTRACTOR SHALL COMPLY WITH ALL FEDERAL, STATE AND LOCAL REGULATIONS, CODES AND ORDINANCES.
4. THE CONTRACTOR SHALL CONFIRM, LOCATE AND COORDINATE WORK WITH HIDDEN MECHANICAL, PLUMBING AND ELECTRICAL CONDITIONS.
5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO THE EXISTING BUILDING, SITE AND EQUIPMENT DURING CONSTRUCTION, INCLUDING DAMAGE FROM THE ELEMENTS. THE CONTRACTOR SHALL EXERCISE CARE SO AS NOT TO DAMAGE EXISTING BUILDING DURING CONSTRUCTION. THE CONTRACTOR SHALL REPAIR ANY DAMAGE IMMEDIATELY AND TO THE SATISFACTION OF THE OWNER.
6. THE CONTRACTOR SHALL VERIFY EXISTING CONDITIONS AND DIMENSIONS ON THE JOB SITE. IF EXISTING CONDITIONS DO NOT PERMIT INSTALLATION OF WORK IN ACCORDANCE WITH THE DRAWINGS AND SPECIFICATIONS, NOTIFY THE ARCHITECT AND PROVIDE A SKETCH OF THE CONDITION.
7. DIMENSIONS ARE TO FINISH FACE OF WALL UNLESS NOTED OTHERWISE.
8. THE CONTRACTOR SHALL COORDINATE LOCATION AND SIZE OF ALL OPENINGS WITH ALL TRADES PRIOR TO INSTALLATION.
9. DETAILS SHOWN ARE INTENDED FOR SPECIFIC LOCATIONS AND CONDITIONS. MINOR MODIFICATIONS MAY BE REQUIRED TO SUIT SIMILAR CONDITIONS AND SHALL BE CONSIDERED PART OF THE WORK.
10. UNLESS OTHERWISE INDICATED ON THE DRAWINGS OR IN THE SPECIFICATIONS AS BEING NIC, ALL ITEMS, MATERIALS, ETC. AND INSTALLATION OF SAME ARE A PART OF THE CONTRACT WORK.
11. THE GENERAL CONTRACTOR SHALL COORDINATE ALL SLEEVING WORK, UNO, COORDINATE LOCATION AND SIZE OF ALL OPENINGS, INTERIOR AND/OR EXTERIOR WITH ALL TRADES PRIOR TO INSTALLATION.


**MATERIAL SYMBOLS:**

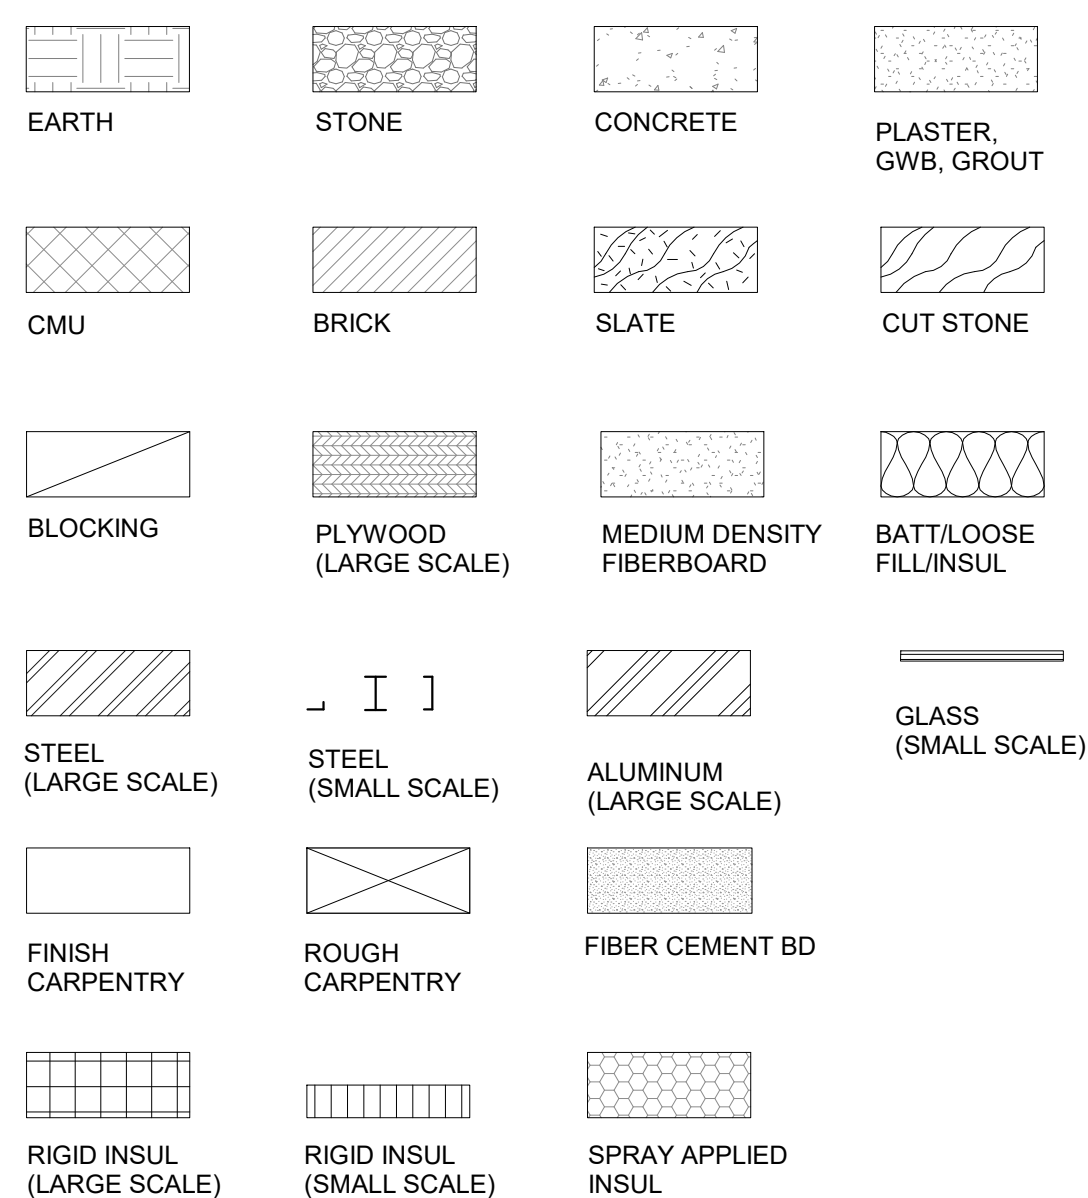

**ABBREVIATIONS:**

<b>A</b>	ARCHITECT/ENGINEER	<b>F</b>	FIRE ALARM	<b>P</b>	PRECAST ARCHITECTURAL CONCRETE
A/E	ANCHOR BOLT	FCB	FIBER CEMENT BOARD	PERF	PERFORATED
AB	ABOVE	FCU	FAN COIL UNIT	PLAM	PLASTIC LAMINATE
ABV	ACUSTIC CEILING TILE	FD	FLOOR DRAIN	PLAS	PLASTER
ACT	ADJACENT/ADJUSTABLE	FEC	FIRE EXTINGUISHER CABINET	PNL	PANEL
ADJ	ADJACENT/ADJUSTABLE	FF	FACTORY FINISH	PNLG	PANELING
AFF	AGGREGATE	FEE	FINISHED FLOOR ELEVATION	PNT	PAINT(ED)
AGG	AGGREGATE	FIN	FINISH(ED)	POL	POLISHED
ALOW	ALUMINUM CURTAINWALL	FLG	FLASHING	PROJ	PROJECTION
AL(ALUM)	ALUMINUM	FLR	FLOOR(ING)	P.T.	PRESSURE TREATED
ALSF	ALUMINUM STOREFRONT	FND	FOUNDATION	PT	PORCELAIN TILE
ALW	ALUMINUM WINDOW	F.O.	FACE OF	PTN	PARTITION
ANOD	ANODIZED	FP	FILLER PANEL	PWD	PLYWOOD
AP	ACCESS PANEL	FT	FOOT (FEET)	PV	PIPE VENT
APPROX	APPROXIMATE	FTG	FOOTING	<b>R</b>	
ARCH	ARCHITECTURAL	FTR	FIN TUBE RADIATOR	RA	RETURN AIR
<b>B</b>		<b>G</b>		RAD	RADIUS
B&B	BOARD AND BATTEN	GA	GUAGE	RB	RUBBER BASE
BCAB	BASE CABINET	GALV	GALVANIZED	RBT	RUBBER STAIR TREAD
BD	BOARD	GF	GROUND FACE	RCP	REFLECTED CEILING PLAN
BLDG	BUILDING	GLAZ	GLAZED, GLAZING, GLASS	RD	ROOF DRAIN
BLKG	BLOCKING	GRG	GLASS REINFORCED GYPSUM	REF	REFER, REFERENCE
BLW	BELOW	GWB	GYPSUM WALLBOARD	REQD	REQUIRED
B.O.	BOTTOM OF	<b>H</b>		REV	REVISION, REVISE(D)
BC	BROADLOOM CARPET	HDPE	HIGH DENSITY POLYETHYLENE	RSF	RESILIENT FLOORING
BM	BEAM	HM	HOLLOW METAL	RT	RESILIENT TILE FLOORING
BRK	BRICK	HOR	HORIZONTAL	RM	ROOM
BTW	BETWEEN	HR	HARDWOOD	R.O.	ROUGH OPENING
<b>C</b>		HRWD	HARDWOOD	RTF	RESILIENT RUBBER TILE FLOORING
CAB	CABINET	HSS	HOLLOW STEEL SECTION	RWC	RAINWATER CONDUCTOR
CB	CEMENTBOARD	HT	HIGH TEMPERATURE	<b>S</b>	
CERT	CERTIFIED	HVAC	HEAVY/VENTILATION/AIR	S	SOUTH
CFMF	COLD FORMED METAL FRAMING	HW	HOT WATER HEATER	SA	SUPPLY AIR
CJ	CONSTRUCTION/CONTROL JOINT	<b>I</b>		SBC	SINK BASE CABINET
CL	CENTERLINE	IGU	INSULATED GLAZING UNIT	SBO	SUPPLIED BY OTHERS
CLG	CEILING	INCL	INCLUDING/INCLUDED	SFI	SPRAY FOAM INSULATION
CLR	CLEAR/CLEARANCE	INFO	INFORMATION	SIT	STRUCTURAL GLAZED TILE
CMU	CONCRETE MASONRY UNIT	INSUL	INSULATED, INSULATION	SIM	SIMILAR
COL	COLUMN	INT	INTERIOR	SIP	STRUCTURAL INSULATED PANEL
COMP	COMPOSITE	<b>J</b>		SL	SLOPED/SLOPE
CONC	CONCRETE	JT	JOINT	SLG	SLOPED/SLOPE
CONC	CONCRETE	<b>L</b>		SOG	SLAB ON GRADE
CONT	CONTINUOUS	LAM	LAMINATED	SSTL	STAINLESS STEEL
COORD	COORDINATE	LF	LINEAR FEET	STD	STANDARD
COR	CORRUATED	LG	LONG	STL	STEEL
CPT	CARPET TILE	LIN	LINOLEUM	STN	STAIN(ED)
CT	CERAMIC TILE	LLV	LONG LEG VERTICAL	STRUC	STRUCTURAL
CUH	CABINET UNIT HEATER	LTL	LINTEL	SUSP	SUSPENDED
CW	CURTAINWALL	LT	LIGHT	<b>T</b>	
<b>D</b>		LOUV	LOUVER	TER	TERRAZZO
DEMO	DEMOLISH/DEMOLITION	<b>M</b>		TF	TRANSPARENT FINISH
DIA	DIAMETER	MAS	MASONRY	THK	THICKNESS
DIM	DIMENSION	MATL	MASONRY DIMENSION	TLT	TOILET
DN	DOWN	MAX	MAXIMUM	TPTN	TOILET PARTITION
DR	DOOR	MDF	MEDIUM DENSITY FIBERBOARD	T.O.	TOP OF
DS	DOWNSPOUT	MECH	MECHANICAL	TYP	TYPICAL
DTL	DETAIL	MFR	MANUFACTURER	T&G	TONGUE AND GROOVE
DWG(S)	DRAWING(S)	MIN	MINIMUM	<b>U</b>	
<b>E</b>		M.O.	MOISTURE RESISTANT	UNO	UNLESS NOTED OTHERWISE
E	EAST	MR	MOUNTED	<b>V</b>	
EA	EACH	MTD	MOUNTED	VAR	VARIAS/VARIOUS
EJ	EXPANSION JOINT	MTL	METAL	VERT	VERTICAL
EJ	EXPANSION JOINT	MULL	MULLION	VEST	VESTIBULE
EL	ELEVATION	<b>N</b>		VIF	VERIFY IN FIELD
ELEC	ELECTRICAL	NA	NORTH	VTR	VENT THROUGH ROOF
ELEV	ELEVATOR	NAT	NATURAL	<b>W</b>	
EMER	EMERGENCY	NIC	NOT IN CONTRACT	W	WEST
EOR	ENGINEER OF RECORD	NIS	NOT IN SCOPE	W/	WITH
EP	ELECTRICAL PANEL	NOM	NOMINAL	W/O	WITHOUT
EPX	EPOXY	NTS	NOT TO SCALE	WB	WALL BASE
EQ	EQUAL	<b>O</b>		WC	WATER CLOSET
EQPM	EQUIPMENT	OC	ON CENTER	WCAB	WALL CABINET
ES	EXPOSED STRUCTURE	OFE	OWNER FURNISHED EQUIPMENT	WD	WOOD
ETR	EXISTING TO REMAIN	OH	OPPOSITE HAND	WDP	WOOD PANEL
EWC	ELECTRIC WATER COOLER	OPP	OPPOSITE	WF	WIDE FLANGE
EXP	EXPOSED	OPG	OPENING	WIN	WINDOW
EXG	EXISTING	OSB	ORIENTED STRAND BOARD	WOM	WALK OFF MAT
EXT	EXTERIOR	OTLN	OUTLINE	WSCT	WAINSCOT

**REFERENCE SYMBOLS:**

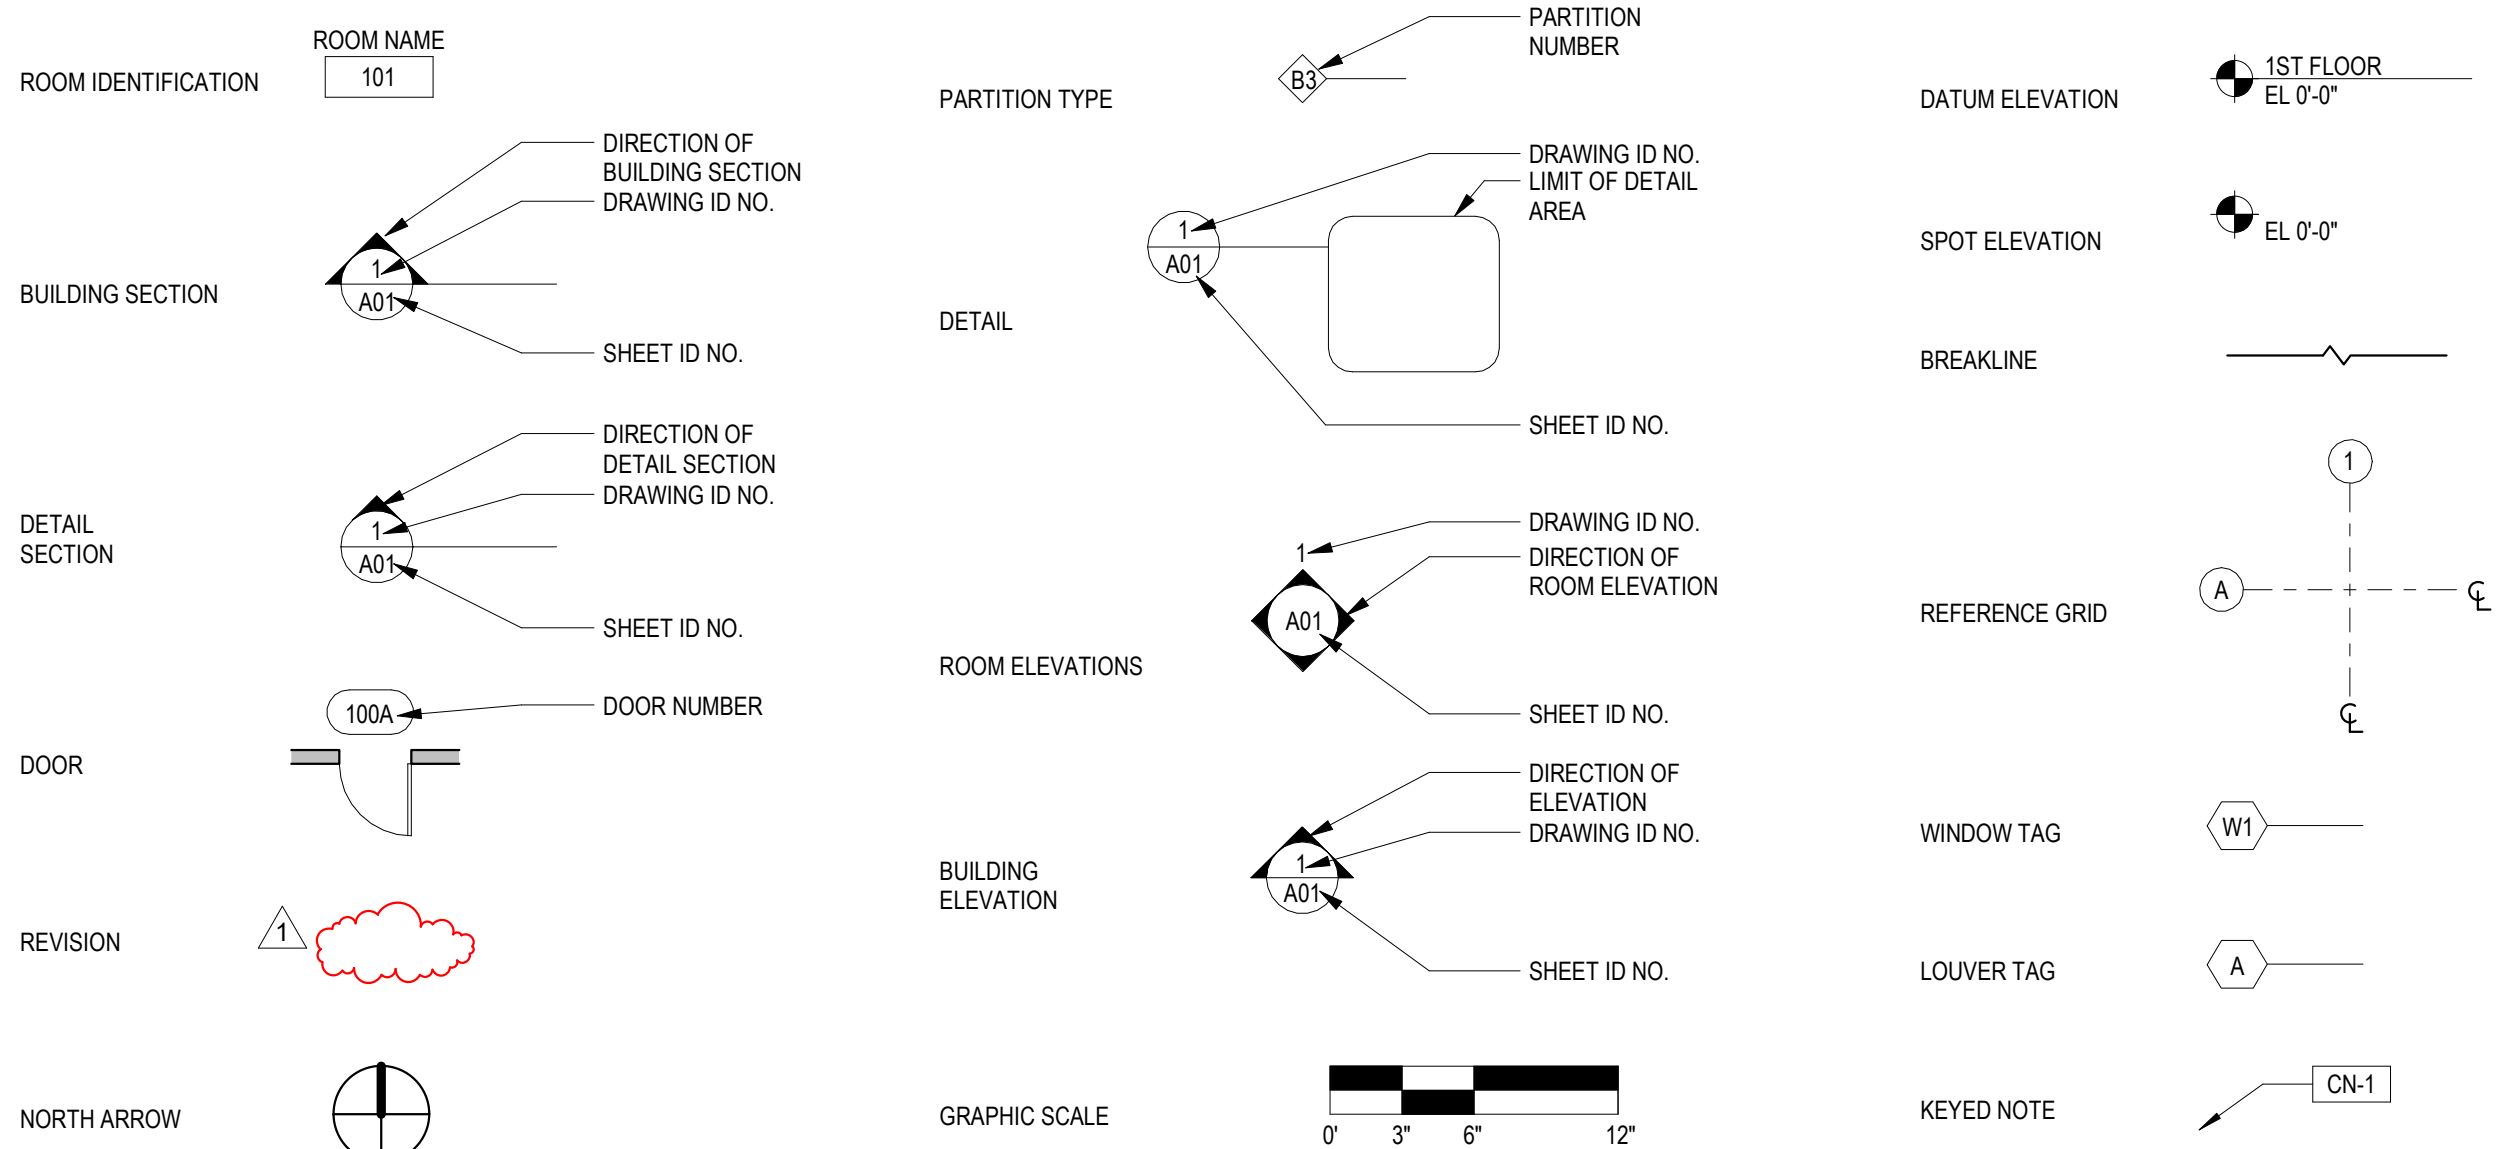

**CODE:**

THIS RENOVATION DOES NOT IMPACT ISSUES OF OCCUPANCY, HEIGHT AND AREA OR EGRESS.

**ALTERNATES:**

**A. ALTERNATE 1(ADD):**  
REPAIR AND RESTORE EXISTING PLASTER AND LATH CEILING (ASSUMED) AT DOME INTERIOR. REPAINT INTERIOR DOME SURFACE.

**B. ALTERNATE 2:**  
FOR REPLACEMENT TERRA COTTA UNITS, CONTRACTOR MAY CONSIDER ALTERNATIVE MATERIALS, SUCH AS GLASS FIBER REINFORCED CONCRETE (GFRC) AS AN ALTERNATE FOR CONSIDERATION BY OWNER. PROVIDE PRODUCT DATA FOR ALTERNATIVE PRODUCT FOR REVIEW. IN ADDITION TO PROPOSED DEDUCT ALTERNATE COST. IDENTIFY AND QUANTIFY SCHEDULE IMPROVEMENTS AVAILABLE TO THE PROJECT IF THIS ALTERNATE IS SELECTED BY THE OWNER.



MCPHERSON SQUARE LIBRARY  
601 E INDIANA AVE, PHILADELPHIA, PA 19134

**ARCHITECTS:**  
SMP Architects  
1600 Walnut Street, 2nd Floor Philadelphia, PA 19103  
215 985 4410  
www.smparchitects.com

**CIVIL ENGINEER:**  
K.S Engineers  
530 Walnut Street, Suite 460 Philadelphia, PA 19106  
215 616 3060

**STRUCTURAL ENGINEER:**  
Ann Rothmann  
100 E Lancaster Avenue, Suite 203 Wayne, PA 19087  
610 688 2566

**ROOFING CONSULTANT:**  
Steve McLaughlin  
210 Garden Avenue Somersdale, NJ 08083  
856 287 2424

DATE	REVISION
04/2024	ADDENDUM 2

By: JH Checked: JPH Scale: AS NOTED  
Date: 04/15/2024


Drawing Title: GENERAL NOTES, ABBREVIATIONS, MATERIALS, REFERENCE SYMBOLS

Drawing No.: A0.1




**LEGEND**

EXISTING	
---	PROPERTY LINES
- - -	CONTOUR LINE
G	GAS LINE
W	POTABLE WATER
S	SEWER (COMBINED)
S	SANITARY SEWER
D	STORM DRAIN
T	TELECOM CONDUIT
E	ELECTRIC CONDUIT
OHW	ELECTRIC OVERHEAD LINE
X	CHAIN LINK FENCE
□	METAL FENCE
—	CURB
⊙	UNKNOWN MANHOLE
⊙	TELEPHONE MANHOLE
⊙	SANITARY MANHOLE
⊙	WATER MANHOLE
⊙	WATER VALVE
⊙	OIL FILL VALVE
⊙	FRESH AIR INLET
⊙	FIRE HYDRANT
⊙	UTILITY POLE/STREET LIGHT
⊙	LIGHTPOLE
⊙	TRAFFIC SIGNAL
⊙	INLET
⊙	AREA DRAIN
⊙	SIGN
⊙	TREE
⊙	FLAG POLE

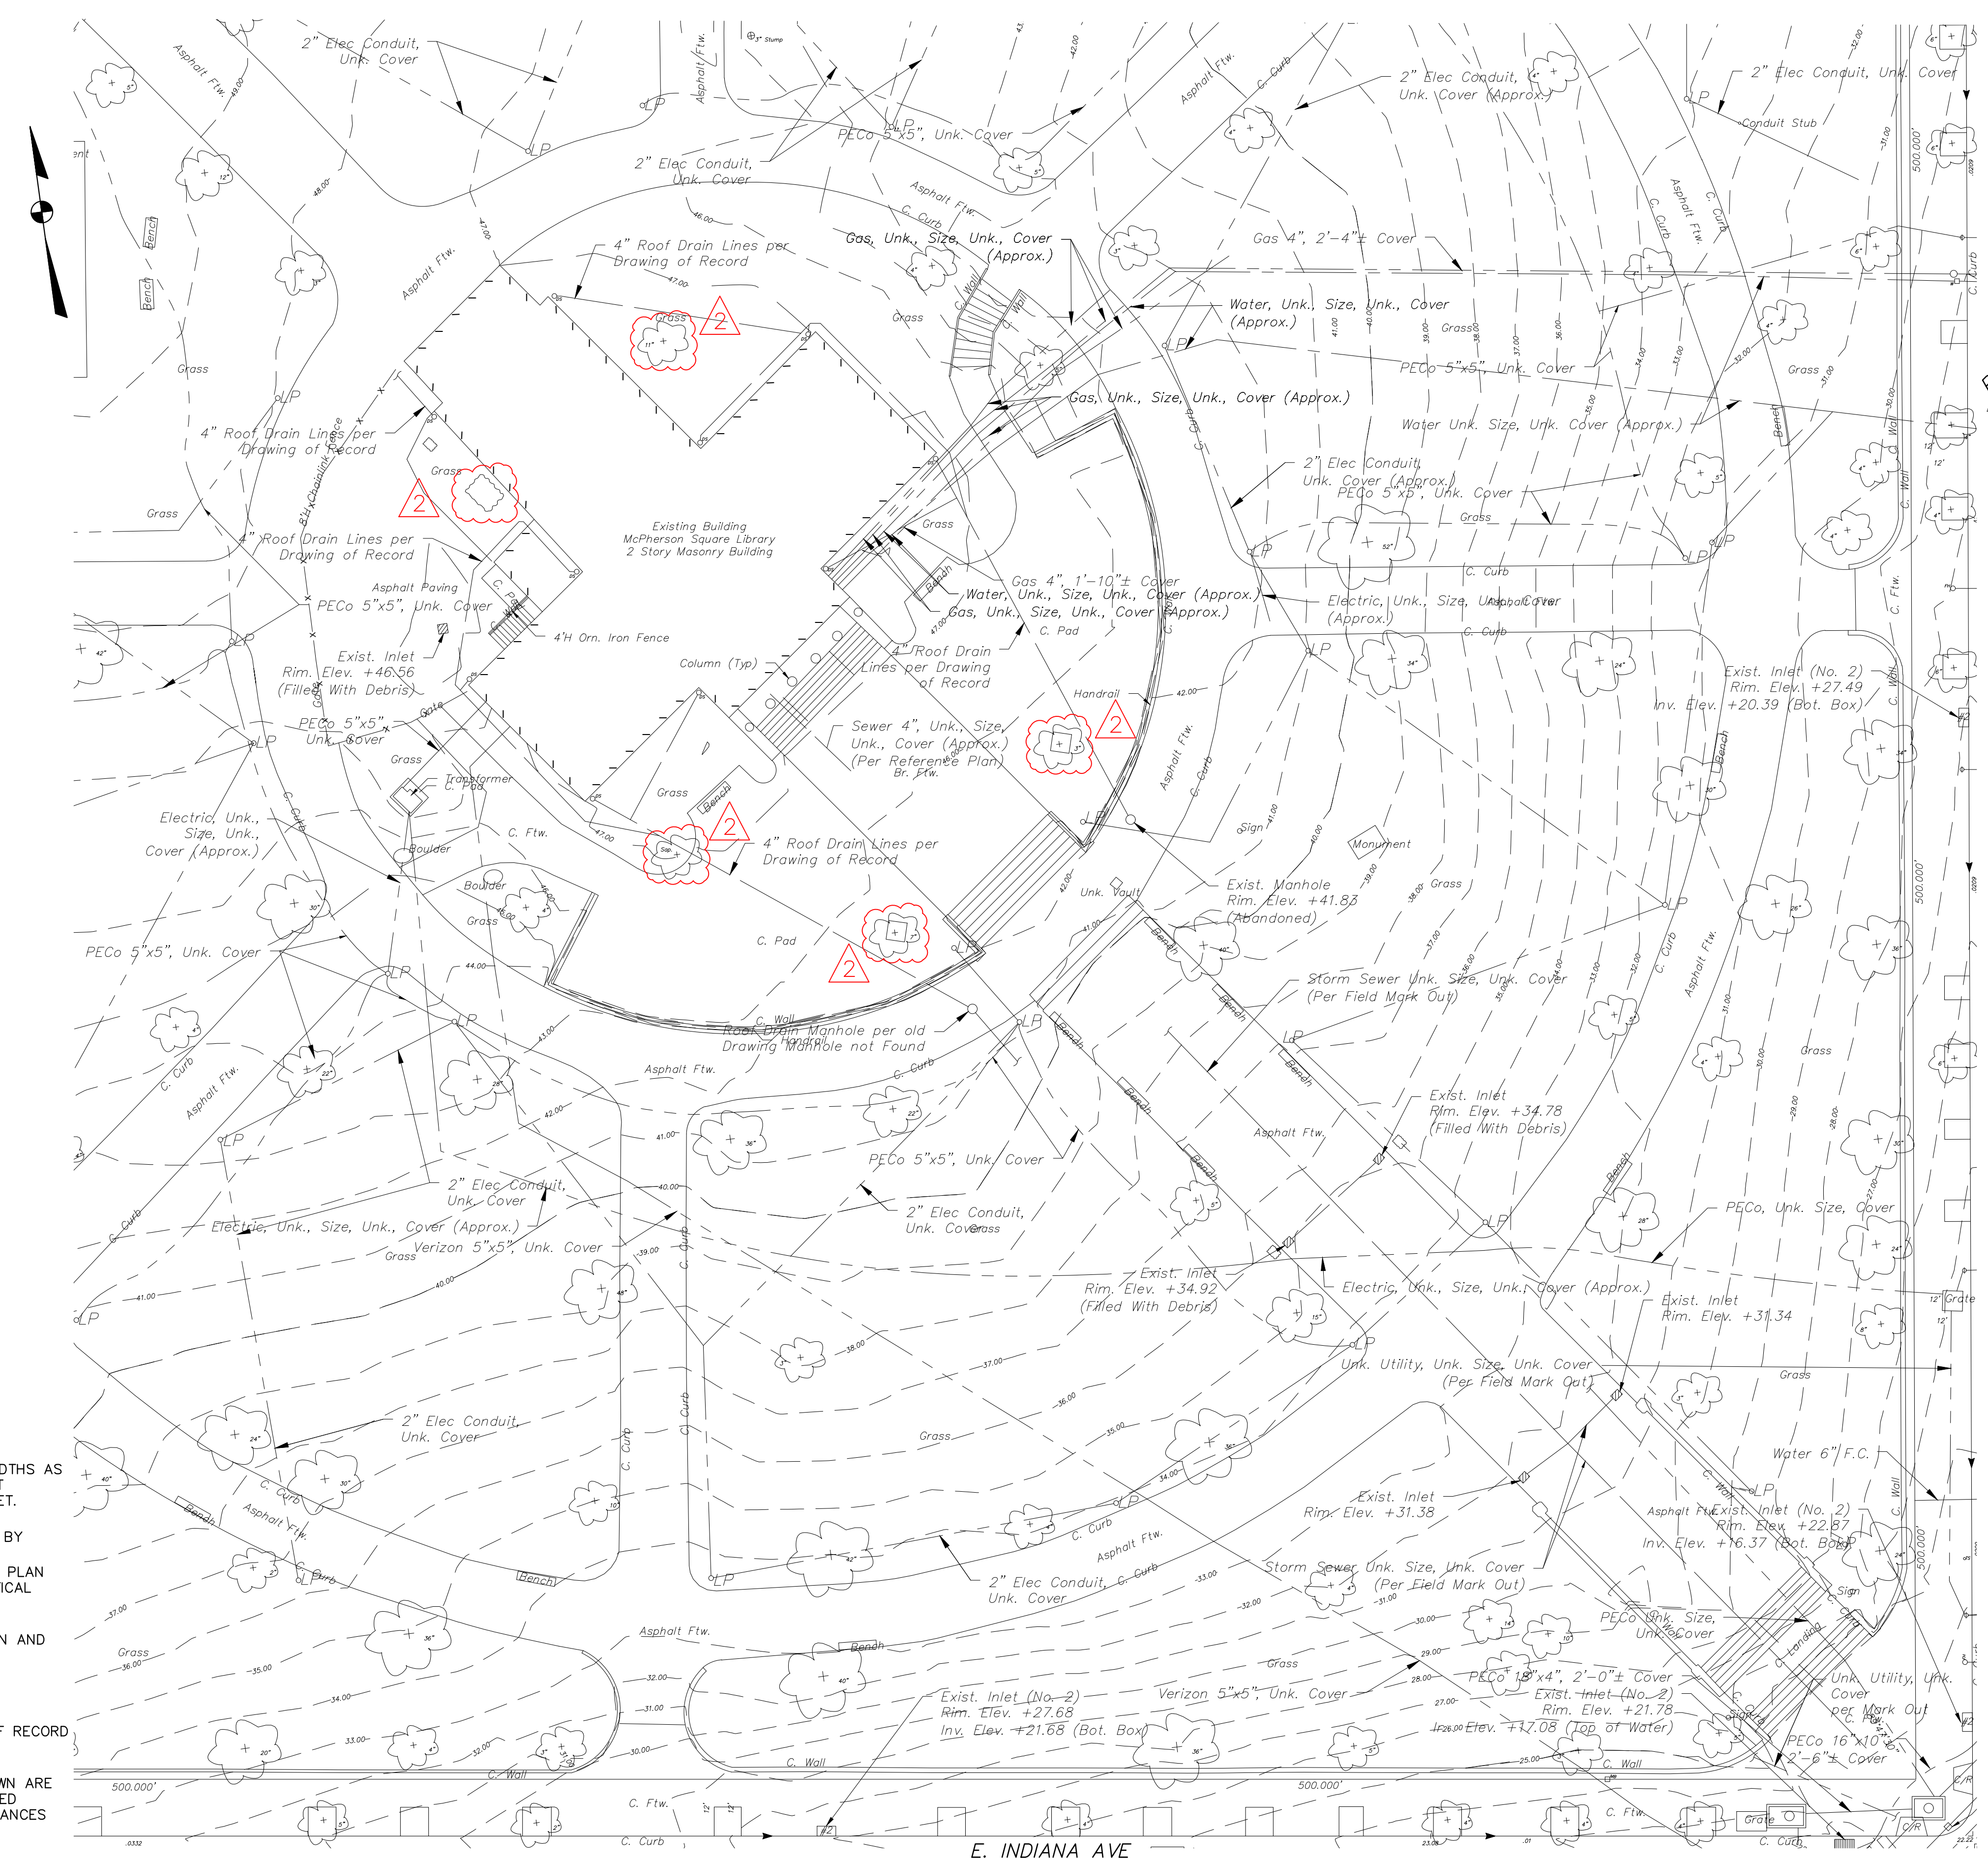

- GENERAL NOTES:**
- PROPERTY DIMENSIONS ARE PER DEEDS OF RECORD AND STREET WIDTHS AS PER CITY PLAN NO. 18 AND ARE SHOWN IN PHILADELPHIA DISTRICT STANDARD. ALL OTHER DIMENSIONS ARE SHOWN IN U.S. SURVEY FEET.
  - SURVEY INFORMATION OBTAINED FROM A FIELD SURVEY PERFORMED BY RODRIGUEZ CONSULTING, LLC ON 02/19/2020. SURVEY BASED ON P.A.S.P.C.S. (SOUTH ZONE) NAD83. BEARINGS SHOWN ARE PER CITY PLAN AND DEED OF RECORD. ELEVATIONS ARE REFERENCED TO CITY VERTICAL DATUM.
  - EXISTING SITE CONDITIONS AND PROPERTY LINE ARE BASED ON PLAN AND SURVEY BY OTHERS:  
PLAN REFERENCE:  
#1 - PWD GSI PROJECT #50120, RECEIVED 11/26/2019
  - SUBJECT TO ALL RESTRICTIONS, EASEMENTS AND/OR COVENANTS OF RECORD EITHER WRITTEN OR IMPLIED THAT MAY NOT APPEAR OF THIS PLAN.
  - IF BUILDINGS ARE ON THIS PLAN, BUILDING OFFSET DISTANCES SHOWN ARE FOR THE PURPOSE OF CHECKING COMPLIANCE WITH ZONING AND DEED RESTRICTIONS ONLY. NO LIABILITY WILL BE ACCEPTED IF THESE DISTANCES ARE USED FOR ANY OTHER PURPOSES.
  - UNDERGROUND UTILITIES AS SHOWN TAKEN FROM FIELD EVIDENCE AND PLANS AS PROVIDED BY THE VARIOUS UTILITY AUTHORITIES (PA ONE CALL SERIAL NO. 20200520979). THE ACCURACY REGARDING UTILITY LOCATION AND/OR DEPTH CANNOT BE GUARANTEED AND ADDITIONAL UNDERGROUND UTILITIES NOT DEPICTED ON THIS PLAN MAY EXIST. BEFORE EXCAVATIONS ARE BEGUN, THE PENNSYLVANIA ONE CALL SYSTEM AT 1-800-242-1776 SHALL BE CONTACTED AT LEAST 3-10 DAYS PRIOR TO COMMENCEMENT OF ANY DEMOLITION OR EXCAVATION ACTIVITIES IN ACCORDANCE WITH ALL APPLICABLE LAWS, RULES AND REGULATIONS.
  - INFORMATION PERTAINING TO LOTS OTHER THAN THE SUBJECT PARCEL IS SHOWN FOR INFORMATIONAL PURPOSES ONLY.
  - PROJECT SITE IS LOCATED WITHIN THE SP-PO-A DISTRICT.

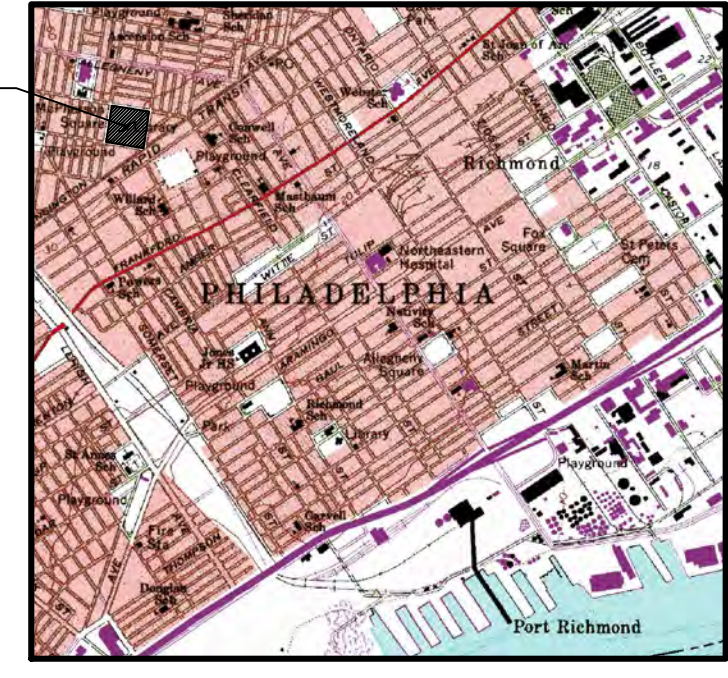


**VICINITY MAP**  
DELAWARE DIRECT WATERSHED (SOUTH)  
MANAGEMENT DISTRICT A  
SCALE 1"=100'

POTTER STREET  
\*LEGALLY OPEN ON CITY PLAN\*  
(50' WIDE R.O.W.)  
(18'-14'-8")

F STREET  
\*LEGALLY OPEN ON CITY PLAN\*  
(50' WIDE R.O.W.)  
(12'-26'-12")

KENSINGTON AVE  
\*LEGALLY OPEN ON CITY PLAN\*  
(70' WIDE R.O.W.)  
(13'-02'-35")

E. INDIANA AVE  
\*LEGALLY OPEN ON CITY PLAN\*  
(50' WIDE R.O.W.)  
(12'-26'-26")

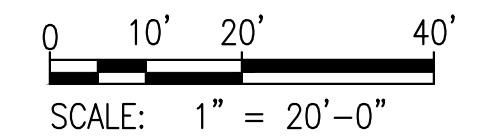

**PROTECT YOURSELF**



WHAT YOU DON'T KNOW CAN HURT YOU.  
CALL BEFORE YOU DIG!  
PENNSYLVANIA LAW REQUIRES 3 WORKING DAYS NOTICE FOR CONSTRUCTION PHASE & 10 WORKING DAYS IN DESIGN STAGE  
Pennsylvania One Call System, Inc.  
1-800-242-1776

ACT 187	
IT IS THE CONTRACTOR'S RESPONSIBILITY TO COMPLY WITH THE PENNSYLVANIA ACT 187 AND TO CONTACT THE "ONE CALL SYSTEM" THREE (3) WORKING DAYS (UNLESS OTHERWISE NOTED) PRIOR TO START OF CONSTRUCTION.	
PENNSYLVANIA ONE CALL: 1-800-242-1776	
PHILADELPHIA WATER DEPARTMENT 1101 MARKET STREET, 2ND FLOOR PHILADELPHIA, PENNSYLVANIA (215) 685-6270	VERIZON 900 RACE STREET PHILADELPHIA, PENNSYLVANIA 19107 (215) 351-8947
PHILADELPHIA GAS WORKS 800 W. MONTGOMERY AVENUE, 3RD FLOOR PHILADELPHIA, PENNSYLVANIA 19122 (215) 684-6796	COMCAST 1351 S. COLUMBUS BOULEVARD PHILADELPHIA, PENNSYLVANIA 19147 (215) 952-4935
PECO-CONSTRUCTION DEPARTMENT 2301 MARKET STREET PHILADELPHIA, PENNSYLVANIA 19103 (215) 731-3264	




MCPHERSON SQUARE LIBRARY  
601 E INDIANA AVE.  
PHILADELPHIA, PA 19134

**ARCHITECTS:**  
SMP Architects  
1600 Walnut Street, 2nd Floor  
Philadelphia, PA 19103  
215.985.4410  
www.smparchitects.com

**CIVIL ENGINEER:**  
KS ENGINEERS  
530 Walnut Street, Suite 460  
Philadelphia, PA 19106  
215.616.3060

**STRUCTURAL ENGINEER:**  
Ann Rothmann  
100 E Lancaster Avenue, Suite 203  
Wayne, PA 19087  
610.688.2566

**ROOFING CONSULTANT:**  
Steve McLaughlin  
210 Garden Avenue  
Somersdale, NJ 08083  
856.287.2424

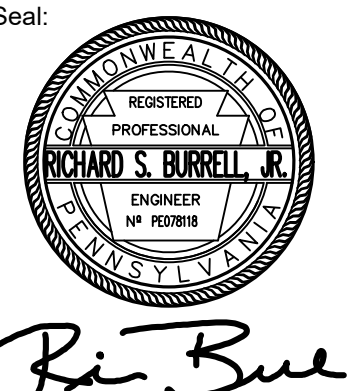

**EXISTING SITE PLAN**

Date: 05/24/2024  
Drawing Title:  
**C1.0**  
Drawing No.:



**LEGEND**


EXISTING	
---	PROPERTY LINES
- - -	CONTOUR LINE
G	GAS LINE
W	POTABLE WATER
- - -	SEWER (COMBINED)
S	SANITARY SEWER
D	STORM DRAIN
T	TELECOM CONDUIT
E	ELECTRIC CONDUIT
OHW	ELECTRIC OVERHEAD LINE
X	CHAIN LINK FENCE
□	METAL FENCE
□	CURB
○	UNKNOWN MANHOLE
○	TELEPHONE MANHOLE
○	SANITARY MANHOLE
○	WATER MANHOLE
○	WATER VALVE
○	OIL FILL VALVE
○	FRESH AIR INLET
○	FIRE HYDRANT
○	UTILITY POLE/STREET LIGHT
○	LIGHTPOLE
○	TRAFFIC SIGNAL
○	INLET
○	AREA DRAIN
○	SIGN
○	TREE
○	FLAG POLE

**DEMOLITION LEGEND**


---	SAWCUT PAVEMENT LINE
---	EX. CONC. CURB TO BE REMOVED
---	EX. PAVING TO BE REMOVED
---	EX. GRASS TO BE REMOVED
---	EX. CONCRETE TO BE REMOVED
---	EX. INLET/ AREA DRAIN TO BE REMOVED
---	EX. TREE TO BE REMOVED

**DEMOLITION NOTES:**

- PRIOR TO STARTING ANY DEMOLITION WORK, CONTRACTOR TO DOCUMENT EXISTING SITE CONDITIONS WITH PHOTOS.
- PRIOR TO STARTING ANY EXCAVATION, CONTRACTOR TO HAVE UNDERGROUND UTILITY LOCATION SERVICES COMPLETED WITHIN THE LIMIT OF DISTURBANCE.
- EXISTING CONCRETE AND BITUMINOUS PAVING TO BE SAW-CUT WITH A CLEAN CUT LINE TO A SUFFICIENT DEPTH TO ALLOW THE REMOVAL OF PAVING WITHOUT DISTURBING THE EXISTING PAVING THAT IS TO REMAIN
- ALL EXISTING FILL TO BE REMOVED FROM SITE IN ACCORDANCE WITH THE PA DEP MANAGEMENT OF FILL POLICY AND REGULATIONS.
- TEMPORARY 8' HIGH LOCKABLE CHAINLINK CONSTRUCTION FENCE TO BE UTILIZED IN SECURING THE WORK AREA AND BLOCK OFF ENTRANCES TO WORK AREA. CONSTRUCTION FENCE TO BE SECURED WITH THE USE OF CONCRETE BLOCKS AND TO BE LOCKED WHEN NOT IN USE. ALL CONSTRUCTION VEHICLES, EQUIPMENT, AND MATERIALS ARE TO BE KEPT INSIDE LOCKED AREA WHEN NOT IN USE.
- CONTRACTOR TO MONITOR EXISTING PARKING LOT AND PLAYGROUND AREA AT ALL TIMES TO PREVENT CONFLICT BETWEEN CONSTRUCTION VEHICLES, STAFF VEHICLES, DELIVERY TRUCKS AND PEDESTRIANS. CONTRACTOR TO REPAIR/REPLACE ANY CONCRETE, ASPHALT, LAWN OR PLANTED AREAS WITHIN THIS AREA AND WITHIN THE PUBLIC ROW THAT IS DAMAGED BY CONSTRUCTION VEHICLES DURING CONSTRUCTION.
- REMOVAL OF EXISTING TREES TO INCLUDE ALL MAJOR ROOT STRUCTURES, LOCATIONS TO BE TEMPORARILY BACKFILLED IN ACCORDANCE WITH SPECIFICATIONS.

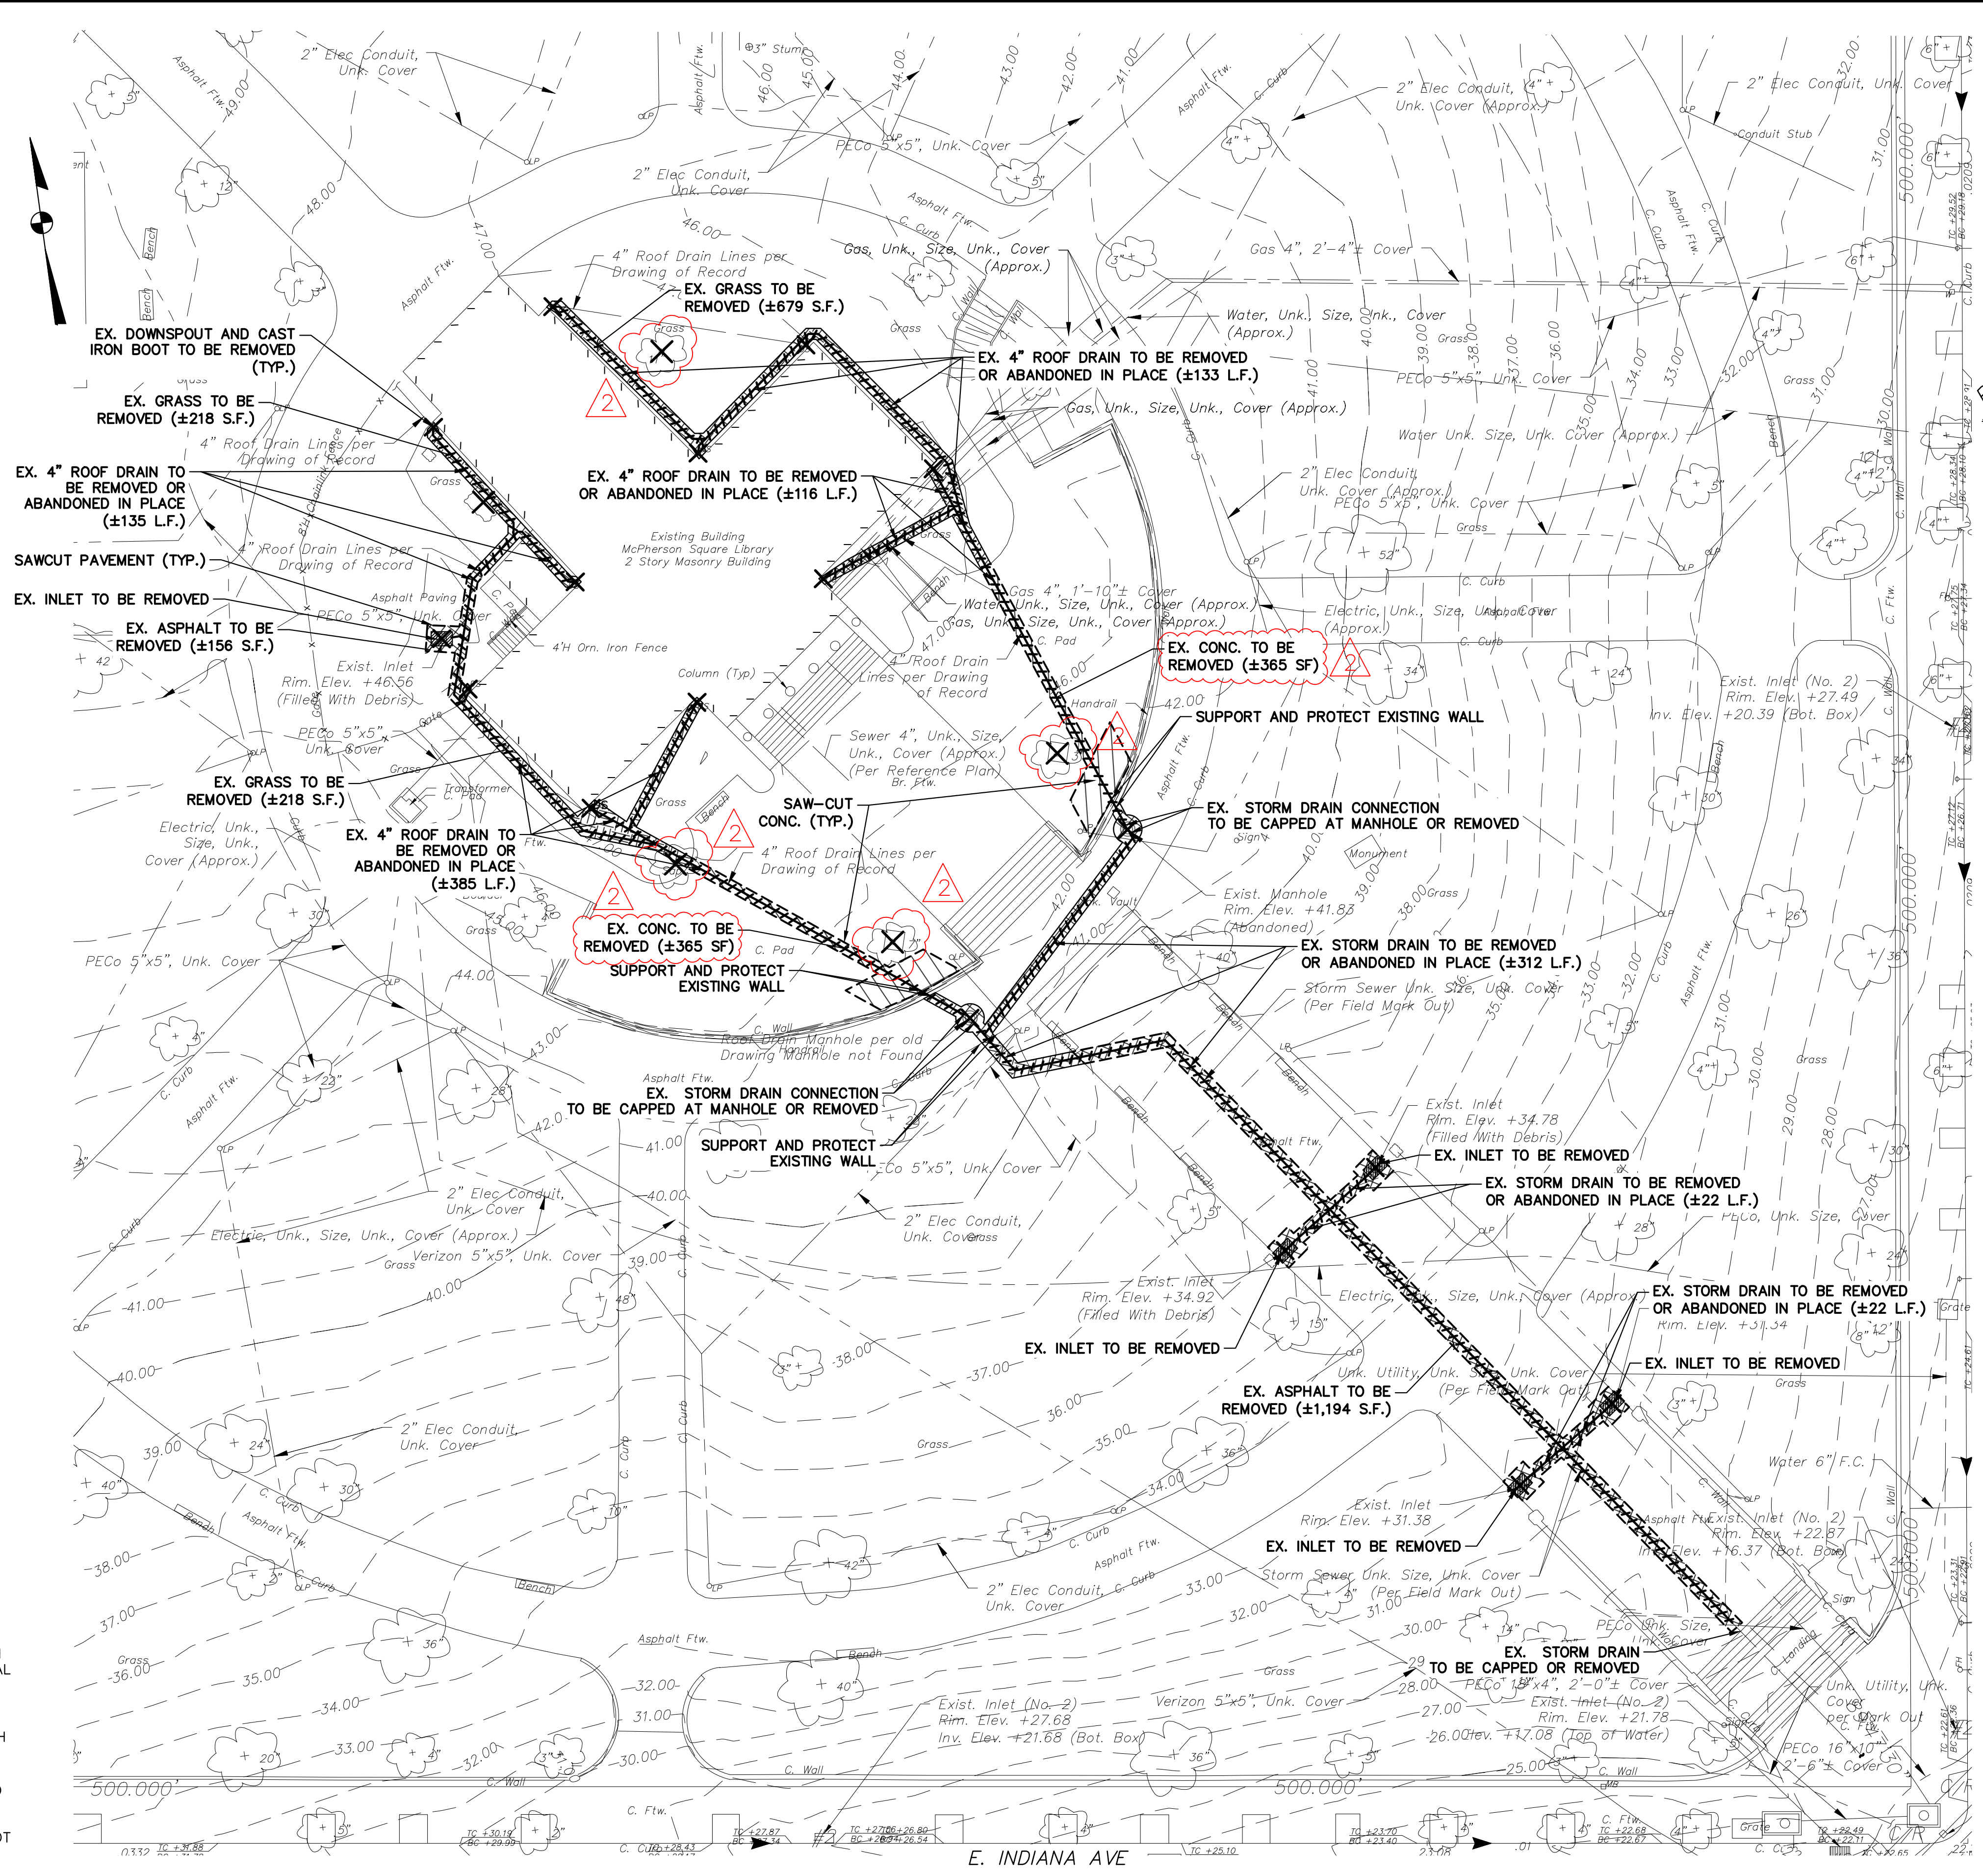

LIMIT OF DISTURBANCE (LOD) SUMMARY		
ON-SITE	2,550 S.F.	0.059 ACRES
PUBLIC R.O.W.	-	-
TOTAL	2,550 S.F.	0.059 ACRES

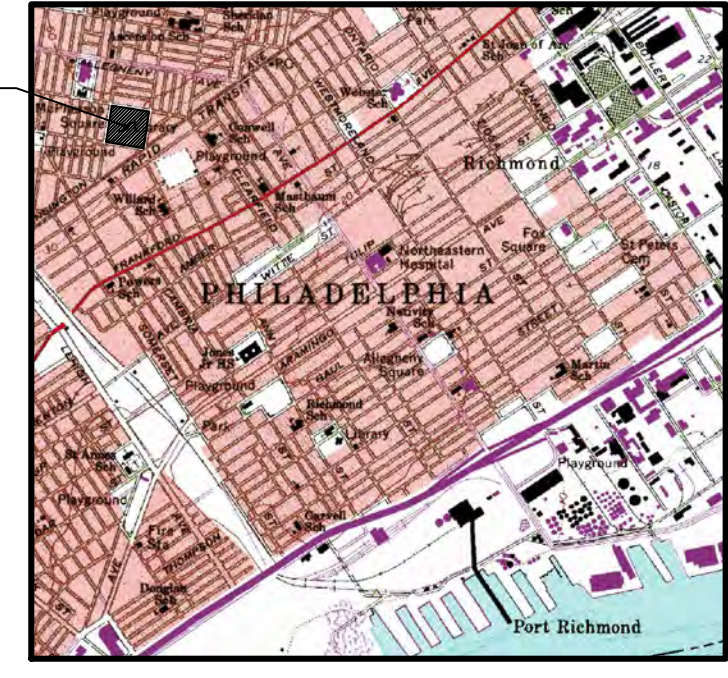

**VICINITY MAP**  
DELAWARE DIRECT WATERSHED (SOUTH)  
MANAGEMENT DISTRICT A  
SCALE 1"=100'




MCPHERSON SQUARE LIBRARY  
601 E INDIANA AVE.  
PHILADELPHIA, PA 19134

**ARCHITECTS:**  
SMP Architects  
1600 Walnut Street, 2nd Floor  
Philadelphia, PA 19103  
215.985.4410  
www.smparchitects.com


**CIVIL ENGINEER:**  
KS ENGINEERS  
530 Walnut Street, Suite 460  
Philadelphia, PA 19106  
215.616.3060

**STRUCTURAL ENGINEER:**  
Ann Rothmann  
100 E Lancaster Avenue, Suite 203  
Wayne, PA 19087  
610.688.2566

**ROOFING CONSULTANT:**  
Steve McLaughlin  
210 Garden Avenue  
Somersdale, NJ 08083  
856.287.2424

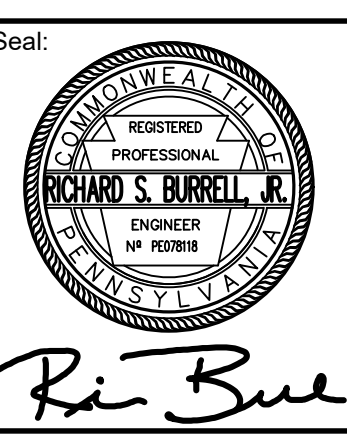


**PROTECT YOURSELF**

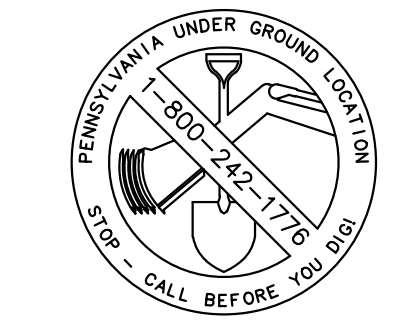

WHAT YOU DON'T KNOW CAN HURT YOU.  
CALL BEFORE YOU DIG!  
PENNSYLVANIA LAW REQUIRES 3 WORKING DAYS NOTICE FOR CONSTRUCTION PHASE & 10 WORKING DAYS IN DESIGN STAGE  
Pennsylvania One Call System, Inc.  
1-800-242-1776

ACT 187	
IT IS THE CONTRACTOR'S RESPONSIBILITY TO COMPLY WITH THE PENNSYLVANIA ACT 187 AND TO CONTACT THE "ONE CALL SYSTEM" THREE (3) WORKING DAYS (UNLESS OTHERWISE NOTED) PRIOR TO START OF CONSTRUCTION.	
PENNSYLVANIA ONE CALL: 1-800-242-1776	
PHILADELPHIA WATER DEPARTMENT 1101 MARKET STREET, 2ND FLOOR PHILADELPHIA, PENNSYLVANIA (215) 685-6270	VERIZON 900 RACE STREET PHILADELPHIA, PENNSYLVANIA 19107 (215) 351-8947
PHILADELPHIA GAS WORKS 800 W. MONTGOMERY AVENUE, 3RD FLOOR PHILADELPHIA, PENNSYLVANIA 19122 (215) 684-6796	COMCAST 1351 S. COLUMBUS BOULEVARD PHILADELPHIA, PENNSYLVANIA 19147 (215) 952-4935
PECO-CONSTRUCTION DEPARTMENT 2301 MARKET STREET PHILADELPHIA, PENNSYLVANIA 19103 (215) 731-3264	

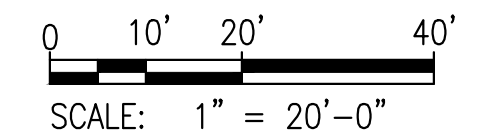

Drawing Title:  
**DEMOLITION PLAN**

Drawing No.:  
**C2.0**



**LEGEND**



EXISTING	
---	PROPERTY LINES
---	CONTOUR LINE
G	GAS LINE
W	POTABLE WATER
---	SEWER (COMBINED)
S	SANITARY SEWER
D	STORM DRAIN
T	TELECOM CONDUIT
E	ELECTRIC CONDUIT
OHW	ELECTRIC OVERHEAD LINE
X	CHAIN LINK FENCE
---	METAL FENCE
---	CURB
○	UNKNOWN MANHOLE
○	TELEPHONE MANHOLE
○	SANITARY MANHOLE
○	WATER MANHOLE
○	WATER VALVE
○	OIL FILL VALVE
○	FRESH AIR INLET
○	FIRE HYDRANT
○	UTILITY POLE/STREET LIGHT
○	LIGHTPOLE
○	TRAFFIC SIGNAL
○	INLET
○	AREA DRAIN
○	SIGN
○	TREE
○	FLAG POLE

**PROPOSED LEGEND**

---	PROPERTY LINE
---	EXISTING CONTOUR
---	PROPOSED CONTOUR
D	STORM SEWER
X	FENCE
S	SANITARY SEWER
W	WATER SERVICE
---	LIMIT OF DISTURBANCE (LOD) & DEP SITE BOUNDARY
---	ASPHALT CURB
○	INLET
○	OBSERVATION WELL
ORD	ROOF DRAIN
OCO	STORM DRAIN CLEANOUT
---	FULL DEPTH ASPHALT PAVING
---	GRASS AREA
---	CONCRETE SIDEWALK
---	LANDSCAPED AREA

**GENERAL NOTES:**

- PROPERTY DIMENSIONS ARE PER DEEDS OF RECORD AND STREET WIDTHS AS PER CITY PLAN NO. 18 AND ARE SHOWN IN PHILADELPHIA DISTRICT STANDARD. ALL OTHER DIMENSIONS ARE SHOWN IN U.S. SURVEY FEET.
- SURVEY INFORMATION OBTAINED FROM A FIELD SURVEY PERFORMED BY RODRIGUEZ CONSULTING, LLC ON 02/19/2020. SURVEY BASED ON P.A.S.P.C.S. (SOUTH ZONE) NAD83. BEARINGS SHOWN ARE PER CITY PLAN AND DEED OF RECORD. ELEVATIONS ARE REFERENCED TO CITY VERTICAL DATUM.
- EXISTING SITE CONDITIONS AND PROPERTY LINE ARE BASED ON PLAN AND SURVEY BY OTHERS:  
PLAN REFERENCE:  
#1 - PWD GSI PROJECT #50120, RECEIVED 11/26/2019
- SUBJECT TO ALL RESTRICTIONS, EASEMENTS AND/OR COVENANTS OF RECORD EITHER WRITTEN OR IMPLIED THAT MAY NOT APPEAR OF THIS PLAN.
- IF BUILDINGS ARE ON THIS PLAN, BUILDING OFFSET DISTANCES SHOWN ARE FOR THE PURPOSE OF CHECKING COMPLIANCE WITH ZONING AND DEED RESTRICTIONS ONLY. NO LIABILITY WILL BE ACCEPTED IF THESE DISTANCES ARE USED FOR ANY OTHER PURPOSES.
- UNDERGROUND UTILITIES AS SHOWN TAKEN FROM FIELD EVIDENCE AND PLANS AS PROVIDED BY THE VARIOUS UTILITY AUTHORITIES (PA ONE CALL SERIAL NO. 20200520979). THE ACCURACY REGARDING UTILITY LOCATION AND/OR DEPTH CANNOT BE GUARANTEED AND ADDITIONAL UNDERGROUND UTILITIES NOT DEPICTED ON THIS PLAN MAY EXIST. BEFORE EXCAVATIONS ARE BEGUN, THE PENNSYLVANIA ONE CALL SYSTEM AT 1-800-242-1776 SHALL BE CONTACTED AT LEAST 3-10 DAYS PRIOR TO COMMENCEMENT OF ANY DEMOLITION OR EXCAVATION ACTIVITIES IN ACCORDANCE WITH ALL APPLICABLE LAWS, RULES AND REGULATIONS.
- INFORMATION PERTAINING TO LOTS OTHER THAN THE SUBJECT PARCEL IS SHOWN FOR INFORMATIONAL PURPOSES ONLY.
- PROJECT SITE IS LOCATED WITHIN THE SP-PO-A DISTRICT.

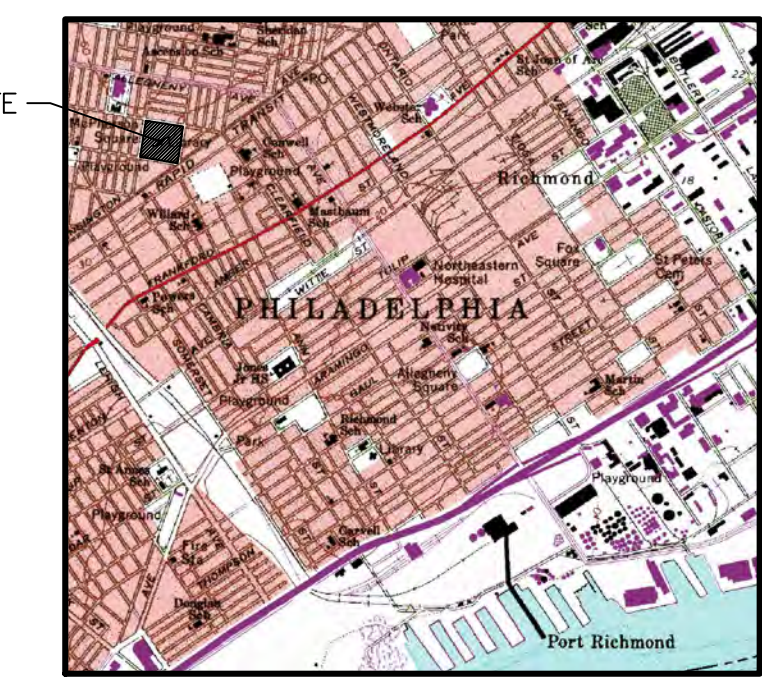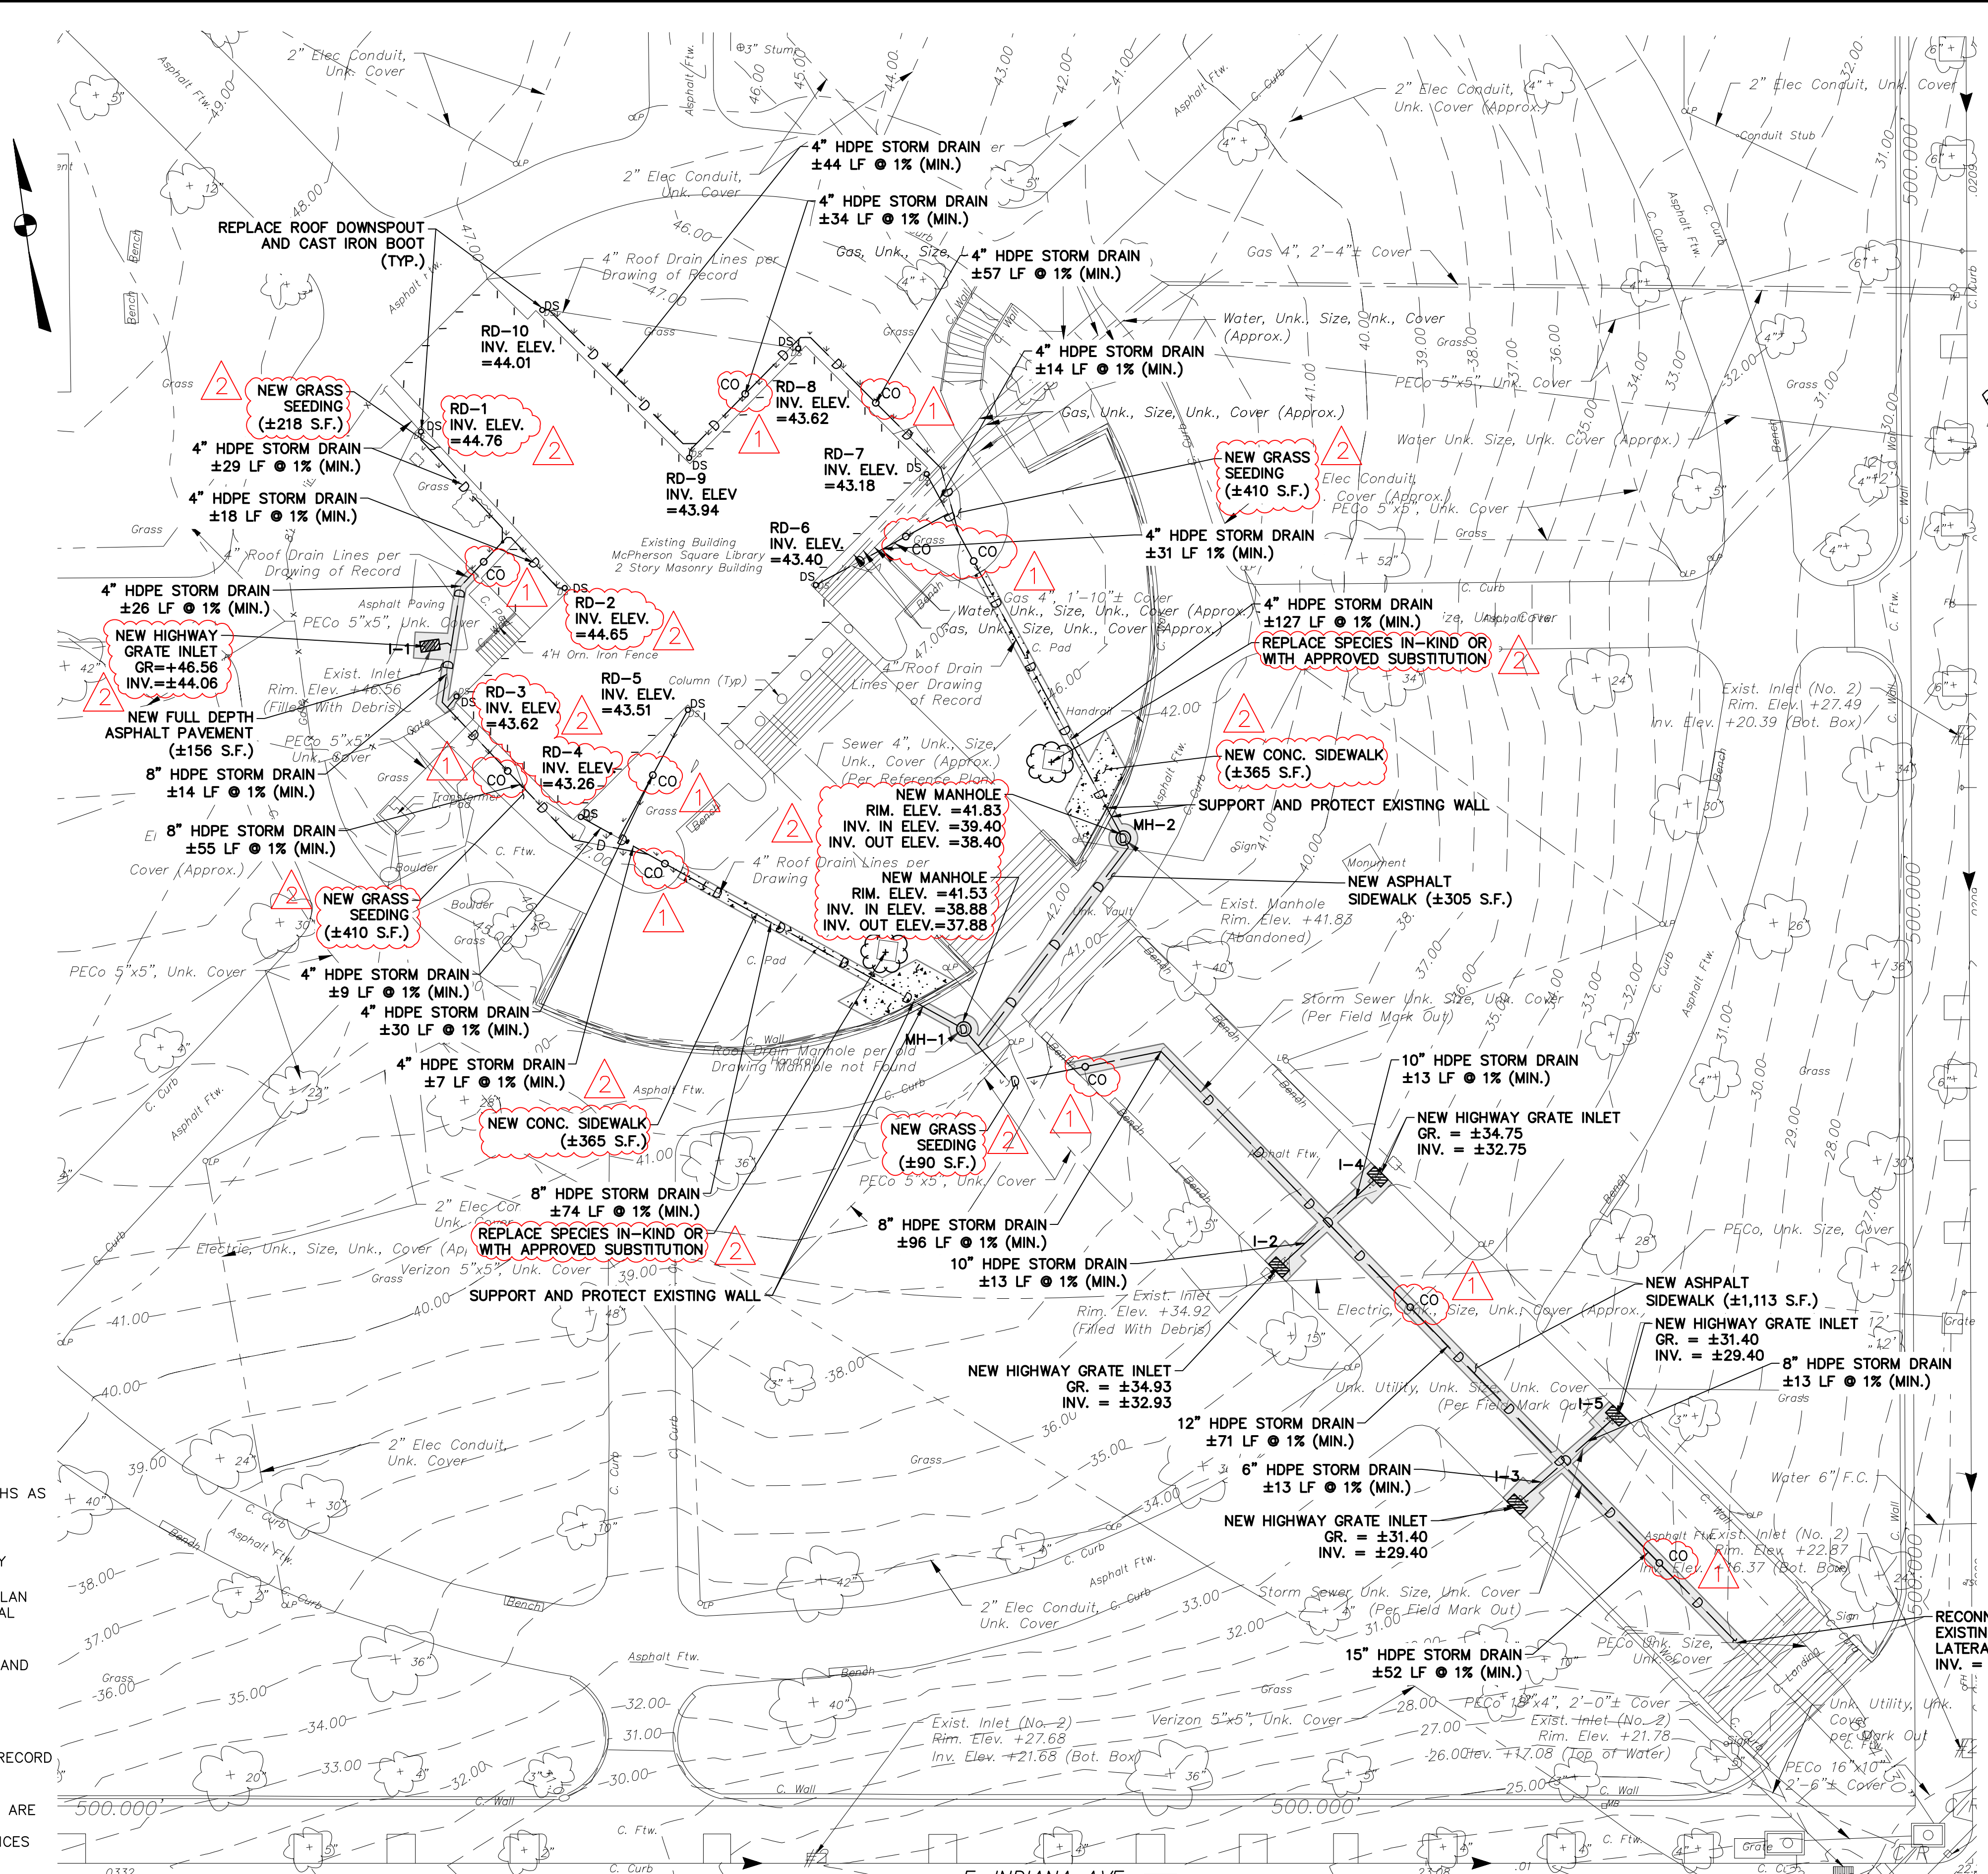

**VICINITY MAP**  
DELAWARE DIRECT WATERSHED (SOUTH)  
MANAGEMENT DISTRICT A  
SCALE 1"=100'




MCPHERSON SQUARE LIBRARY  
601 E INDIANA AVE.  
PHILADELPHIA, PA 19134

**ARCHITECTS:**  
SMP Architects  
1600 Walnut Street, 2nd Floor  
Philadelphia, PA 19103  
215.985.4410  
www.smparchitects.com

**CIVIL ENGINEER:**  
KS ENGINEERS  
530 Walnut Street, Suite 460  
Philadelphia, PA 19106  
215.616.3060

**STRUCTURAL ENGINEER:**  
Ann Rothmann  
100 E Lancaster Avenue, Suite 203  
Wayne, PA 19087  
610.688.2566


**ROOFING CONSULTANT:**  
Steve McLaughlin  
210 Garden Avenue  
Somerset, NJ 08083  
856.287.2424

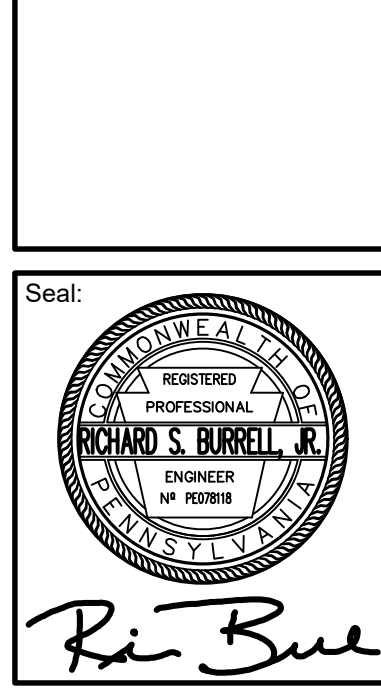

**PROTECT YOURSELF**  
PENNSYLVANIA UNDER GROUND LOC (UG) SYSTEM  
300-242-1776  
WHAT YOU DON'T KNOW CAN HURT YOU.  
CALL BEFORE YOU DIG!  
PENNSYLVANIA LAW REQUIRES 3 WORKING DAYS NOTICE FOR CONSTRUCTION PHASE & 10 WORKING DAYS IN DESIGN STAGE  
Pennsylvania One Call System, Inc.  
1-800-242-1776

LIMIT OF DISTURBANCE (LOD) SUMMARY			
ON-SITE	2,550 S.F.	0.059 ACRES	2
PUBLIC R.O.W.	-	-	
TOTAL	2,550 S.F.	0.059 ACRES	

ACT 187	
IT IS THE CONTRACTOR'S RESPONSIBILITY TO COMPLY WITH THE PENNSYLVANIA ACT 187 AND TO CONTACT THE "ONE CALL SYSTEM" THREE (3) WORKING DAYS (UNLESS OTHERWISE NOTED) PRIOR TO START OF CONSTRUCTION.	
PENNSYLVANIA ONE CALL: 1-800-242-1776	
PHILADELPHIA WATER DEPARTMENT 1101 MARKET STREET, 2ND FLOOR PHILADELPHIA, PENNSYLVANIA (215) 685-6270	VERIZON 900 RACE STREET PHILADELPHIA, PENNSYLVANIA 19107 (215) 351-8947
PHILADELPHIA GAS WORKS 800 W. MONTGOMERY AVENUE, 3RD FLOOR PHILADELPHIA, PENNSYLVANIA 19122 (215) 684-6796	COMCAST 1351 S. COLUMBUS BOULEVARD PHILADELPHIA, PENNSYLVANIA 19147 (215) 952-4935
PECO-CONSTRUCTION DEPARTMENT 2301 MARKET STREET PHILADELPHIA, PENNSYLVANIA 19103 (215) 731-3264	

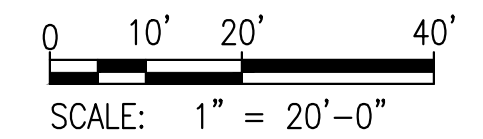

Date: 05/24/2024  
Drawing Title: PROPOSED SITE PLAN  
Drawing No.: C3.0



**LEGEND**


EXISTING		PROPERTY LINES
- - - - -	- - - - -	PROPERTY LINES
- - - - -	- - - - -	CONTOUR LINE
- - - - -	- - - - -	GAS LINE
- - - - -	- - - - -	POTABLE WATER
- - - - -	- - - - -	SEWER (COMBINED)
- - - - -	- - - - -	SANITARY SEWER
- - - - -	- - - - -	STORM DRAIN
- - - - -	- - - - -	TELECOM CONDUIT
- - - - -	- - - - -	ELECTRIC CONDUIT
- - - - -	- - - - -	ELECTRIC OVERHEAD LINE
- - - - -	- - - - -	CHAIN LINK FENCE
- - - - -	- - - - -	METAL FENCE
- - - - -	- - - - -	CURB
○	○	UNKNOWN MANHOLE
○	○	TELEPHONE MANHOLE
○	○	SANITARY MANHOLE
○	○	WATER MANHOLE
○	○	WATER VALVE
○	○	OIL FILL VALVE
○	○	FRESH AIR INLET
○	○	FIRE HYDRANT
○	○	UTILITY POLE/STREET LIGHT
○	○	LIGHTPOLE
○	○	TRAFFIC SIGNAL
○	○	INLET
○	○	AREA DRAIN
○	○	SIGN
○	○	TREE
○	○	FLAG POLE

**EROSION & SEDIMENT CONTROL LEGEND**


○ ○ ○ ○ ○	COMPOST FILTER SOCK, 12" DIAMETER
× × × × ×	SAFETY FENCE
□ □ □ □ □	TREE PROTECTION FENCE
- - - - -	LIMIT OF DISTURBANCE (LOD)
▨ ▨ ▨ ▨ ▨	RUMBLE PAD CONSTRUCTION ENTRANCE
⊠	FILTER BAG INLET PROTECTION

**EROSION AND SEDIMENT CONTROL (E&S) NOTES:**

- EXISTING CONCRETE AND BITUMINOUS PAVING TO BE SAW-CUT ALONG LIMIT OF DISTURBANCE LINE WITH A CLEAN CUT LINE TO A SUFFICIENT DEPTH TO ALLOW THE REMOVAL OF PAVING WITHOUT DISTURBING THE EXISTING PAVING THAT IS TO REMAIN
- THE CONTRACTOR SHALL REMOVE FROM THE SITE ALL DEBRIS, RUBBISH AND OTHER MATERIALS RESULTING FROM DEMOLITION AND SHALL SAFELY AND LEGALLY DISPOSE OF ALL THESE ITEMS IN ACCORDANCE WITH APPLICABLE LOCAL, FEDERAL, STATE AND REGULATORY AUTHORITY HAVING JURISDICTION. RECYCLING MUST BE DONE IN ACCORDANCE WITH APPLICABLE REGULATIONS. BURNING OF ANY DEMOLISHED MATERIALS ON-SITE SHALL NOT BE PERMITTED. RECYCLING OF DEMOLITION DEBRIS SHALL BE APPROVED BY THE OWNER. ALL EXISTING FILL TO BE REMOVED FROM SITE IN ACCORDANCE WITH THE PA DEP MANAGEMENT OF FILL POLICY AND REGULATIONS.
- COMPOST FILTER SOCK ON PAVING TO BE WEIGHTED DOWN BY OBJECTS OF CONSIDERABLE MASS (SAND BAGS, CONCRETE BLOCK OR OTHER SUITABLE MATERIAL). COMPOST FILTER SOCK TO BE INSTALLED DOWNSTREAM OF ALL EARTH MOVING ACTIVITIES.
- RUMBLE PAD CONSTRUCTION ENTRANCE TO BE SIZED IN ACCORDANCE WITH PA DEP MINIMUM REQUIREMENTS OF 50' L X 20' W AND BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.
- CONSTRUCTION, DEMOLITION AND EARTHWORK DUST CONTROL TO BE COMPLETED IN ACCORDANCE WITH THE CITY OF PHILADELPHIA DUST CONTROL REQUIREMENTS (AIR MANAGEMENT REGULATION (AMR) II, SECTION IX.) AND TO INCLUDE BUT NOT LIMITED TO:
  - NOTIFY OCCUPANTS OF NEARBY PROPERTIES, IN WRITING 10 DAYS BEFORE ENGAGING IN EARTHWORK, CONSTRUCTION AND DEMOLITION ACTIVITIES.
  - USE OF VACUUM OR SIMILAR SUCTION SYSTEMS TO CAPTURE DUST KICKED UP BY POWER TOOLS WHEN GRINDING OR CUTTING.
  - APPLICATION OF WATER OR APPROVED DUST CONTROL SUPPRESSANT DURING EXCAVATION, DEMOLITION AND/OR CONSTRUCTION TO SUPPRESS DUST FORMATION.
  - COVERING AND WETTING OF STOCKPILES EARTH, SAND, GRAVEL AND OTHER SIMILAR CONSTRUCTION MATERIALS.
  - ALL PERIMETER FENCING MUST HAVE DUST CONTROL FABRIC AND MUST MEASURE A MINIMUM OF 5 FT IN HEIGHT FROM THE BOTTOM OF FENCING.
  - 10 MILE PER HOUR SPEED LIMIT FOR ALL EQUIPMENT AND TRUCKS TRAVELING WITHIN THE WORK SITE.
  - WETTING AND SWEEPING OF ROADWAYS / ACCESS ROAD IN A WORK SITE TO PREVENT DUST FORMATION.
- PERMANENT INLET PROTECTION TO BE INSTALLED ON ALL INLETS THAT DRAIN TO THE UNDERGROUND STORMWATER MANAGEMENT SYSTEMS IN ACCORDANCE WITH THE SPECIFICATIONS.

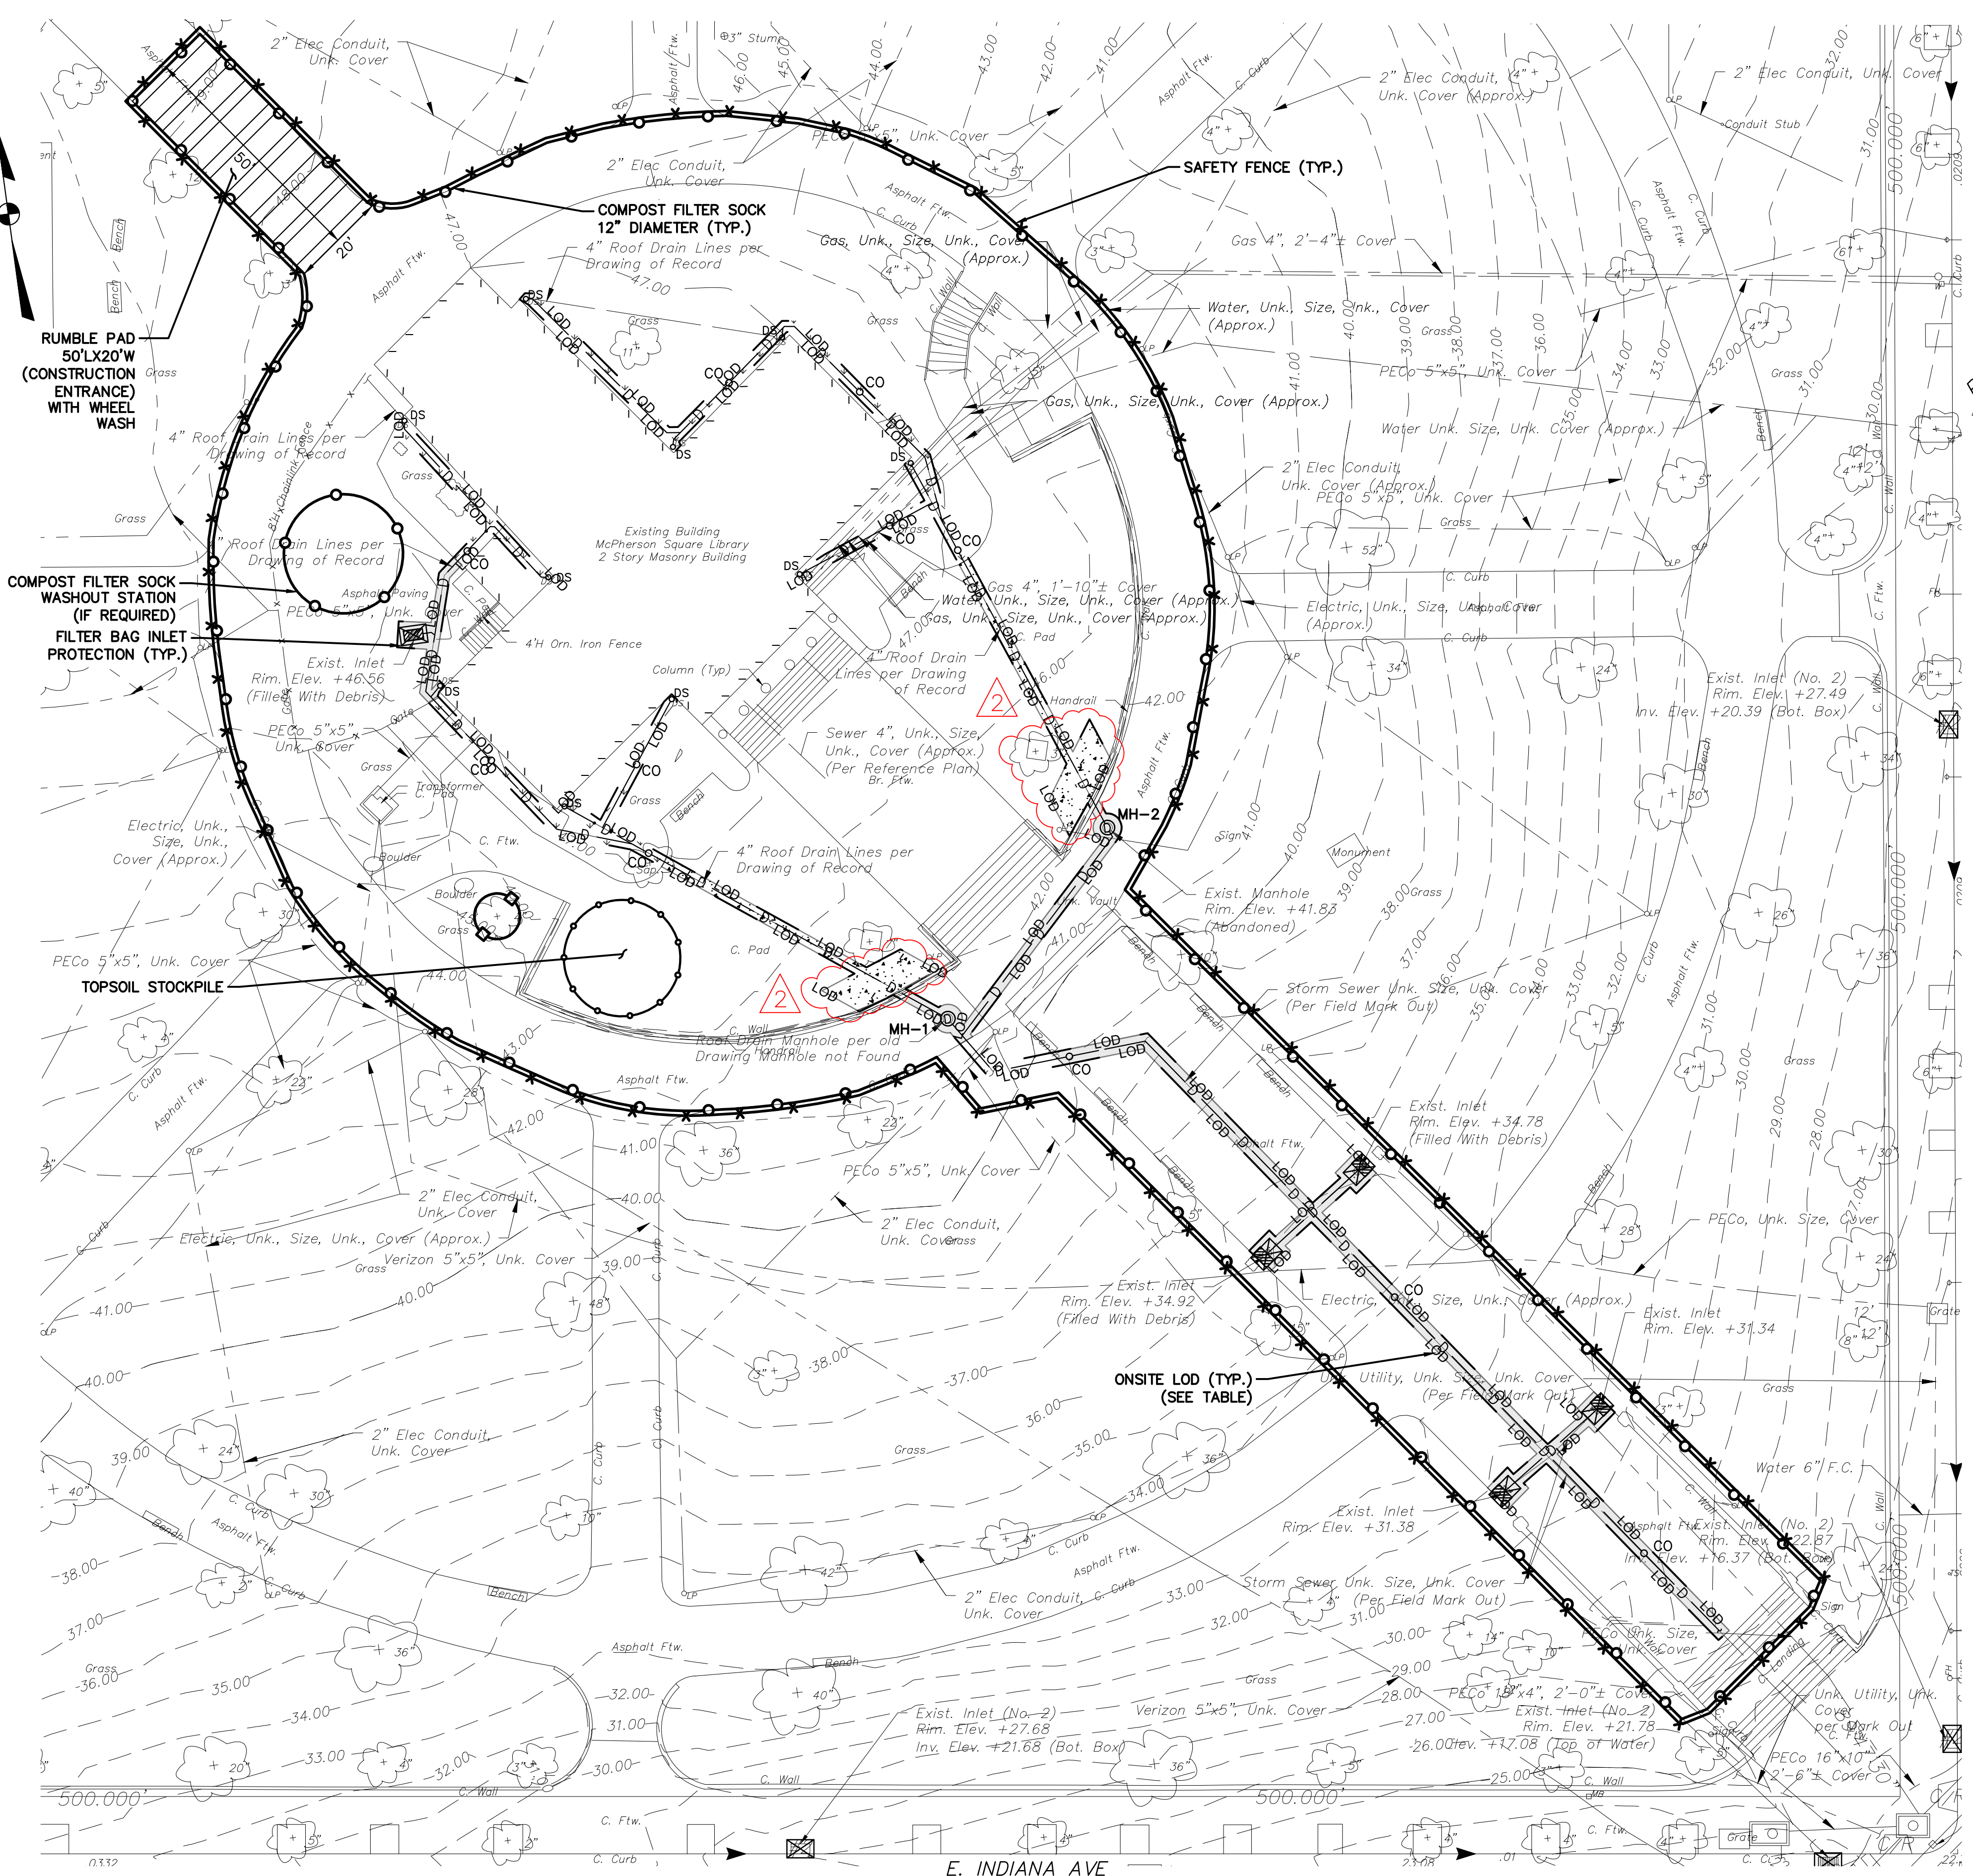

LIMIT OF DISTURBANCE (LOD) SUMMARY		
ON-SITE	2,550 S.F.	0.059 ACRES
PUBLIC R.O.W.	-	-
TOTAL	2,550 S.F.	0.059 ACRES

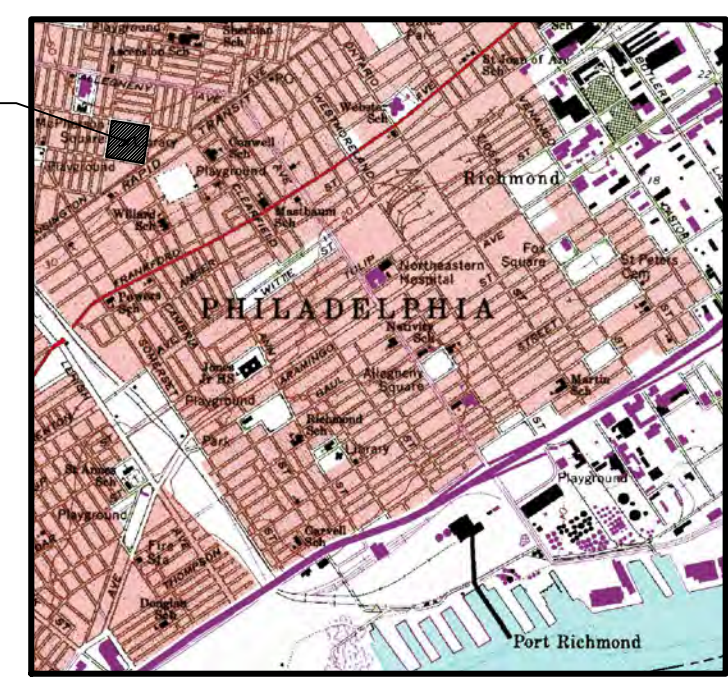

**VICINITY MAP**  
DELAWARE DIRECT WATERSHED (SOUTH)  
MANAGEMENT DISTRICT A  
SCALE 1"=100'




**MCPHERSON SQUARE LIBRARY**  
601 E INDIANA AVE.  
PHILADELPHIA, PA 19134

**ARCHITECTS:**  
SMP Architects  
1600 Walnut Street, 2nd Floor  
Philadelphia, PA 19103  
215.985.4410  
www.smparchitects.com


**CIVIL ENGINEER:**  
KS ENGINEERS  
530 Walnut Street, Suite 460  
Philadelphia, PA 19106  
215.616.3060

**STRUCTURAL ENGINEER:**  
Ann Rothmann  
100 E Lancaster Avenue, Suite 203  
Wayne, PA 19087  
610.688.2566

**ROOFING CONSULTANT:**  
Steve McLaughlin  
210 Garden Avenue  
Somerdale, NJ 08083  
856.287.2424

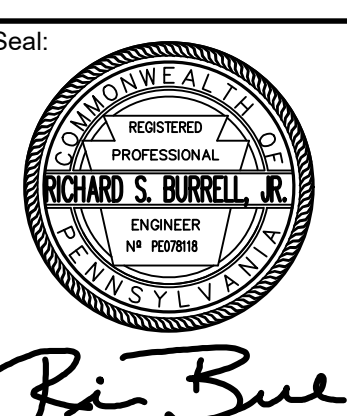


**PROTECT YOURSELF**

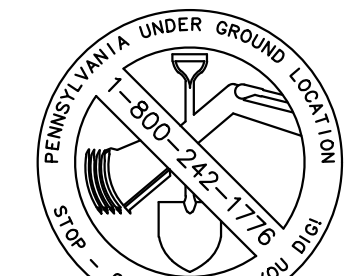


WHAT YOU DON'T KNOW CAN HURT YOU.  
CALL BEFORE YOU DIG!  
PENNSYLVANIA LAW REQUIRES 3 WORKING DAYS NOTICE FOR CONSTRUCTION PHASE & 10 WORKING DAYS IN DESIGN STAGE  
Pennsylvania One Call System, Inc.  
1-800-242-1776

ACT 187	
IT IS THE CONTRACTOR'S RESPONSIBILITY TO COMPLY WITH THE PENNSYLVANIA ACT 187 AND TO CONTACT THE "ONE CALL SYSTEM" THREE (3) WORKING DAYS (UNLESS OTHERWISE NOTED) PRIOR TO START OF CONSTRUCTION. PENNSYLVANIA ONE CALL: 1-800-242-1776	
PHILADELPHIA WATER DEPARTMENT 1101 MARKET STREET, 2ND FLOOR PHILADELPHIA, PENNSYLVANIA (215) 685-6270	VERIZON 900 RACE STREET PHILADELPHIA, PENNSYLVANIA 19107 (215) 351-8947
PHILADELPHIA GAS WORKS 800 W. MONTGOMERY AVENUE, 3RD FLOOR PHILADELPHIA, PENNSYLVANIA 19122 (215) 684-6796	COMCAST 1351 S. COLUMBUS BOULEVARD PHILADELPHIA, PENNSYLVANIA 19147 (215) 952-4935
PECO-CONSTRUCTION DEPARTMENT 2301 MARKET STREET PHILADELPHIA, PENNSYLVANIA 19103 (215) 731-3264	

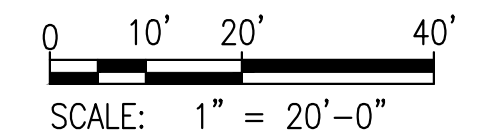


Date: 05/24/2024  
Drawing Title: EROSION AND SEDIMENT CONTROL PLAN  
Drawing No.: C6.0



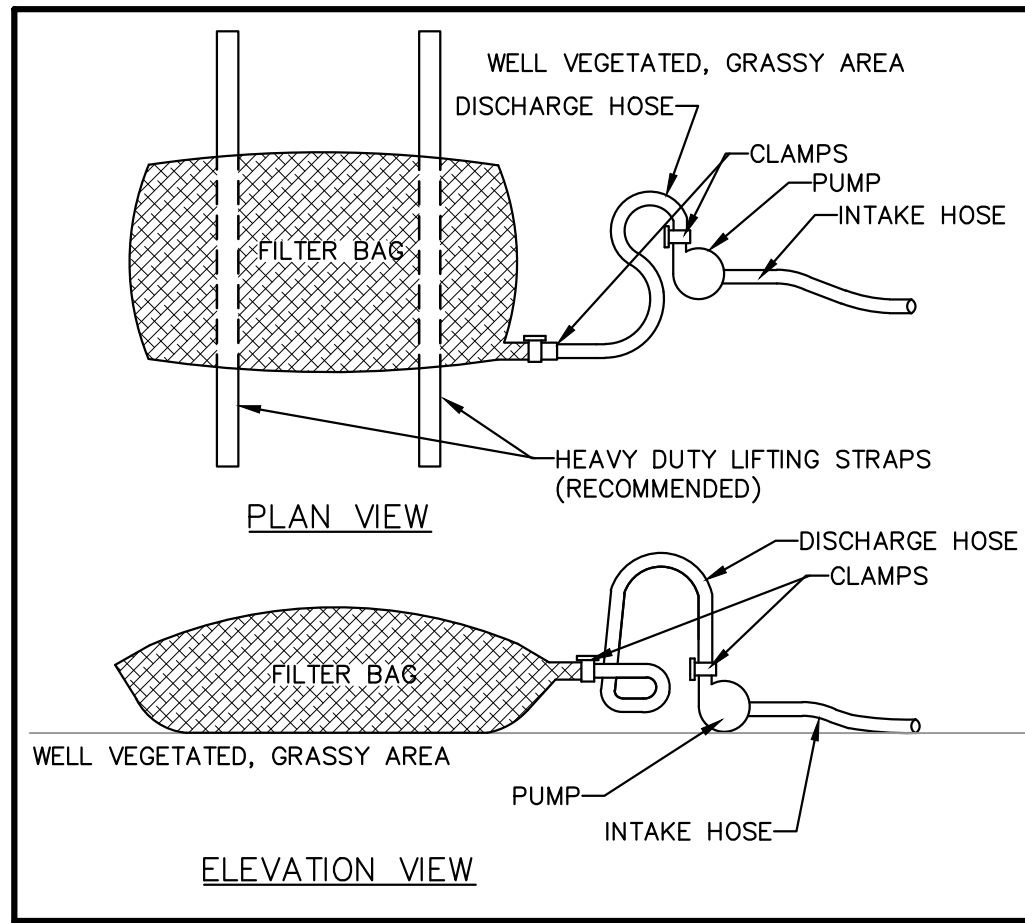


PUMPED WATER FILTER BAG

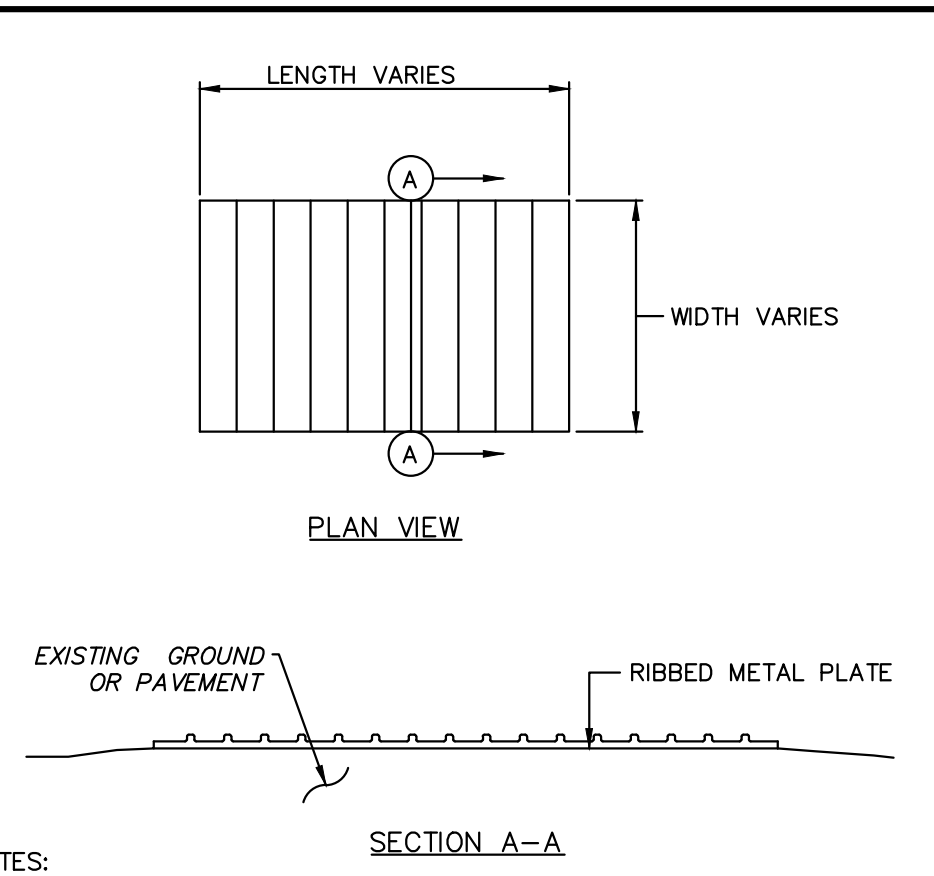


- NOTES:
- PRE-CONSTRUCTED RUMBLE PADS ARE TO BE USED IN LIEU OF ROCK CONSTRUCTION ENTRANCE. RUMBLE PAD SHALL BE INSTALLED ACCORDING TO MANUFACTURER'S RECOMMENDATIONS AND A SUFFICIENT NUMBER OF PADS SHALL BE INSTALLED TO PROVIDE FOR A MINIMUM OF FOUR (4) TIRE REVOLUTIONS WHILE ON THE PAD. MORE PADS MAY BE NEEDED DEPENDING ON SITE CONDITIONS. ACCUMULATED MATERIALS SHOULD BE CLEANED FROM THE PADS DAILY (MORE OFTEN IF NECESSARY) AND DISPOSED IN THE MANNER SPECIFIED BY THE PLAN.
  - MINIMUM SIZE 50'L X 20'W

RUMBLE PAD (CONSTRUCTION ENTRANCE)

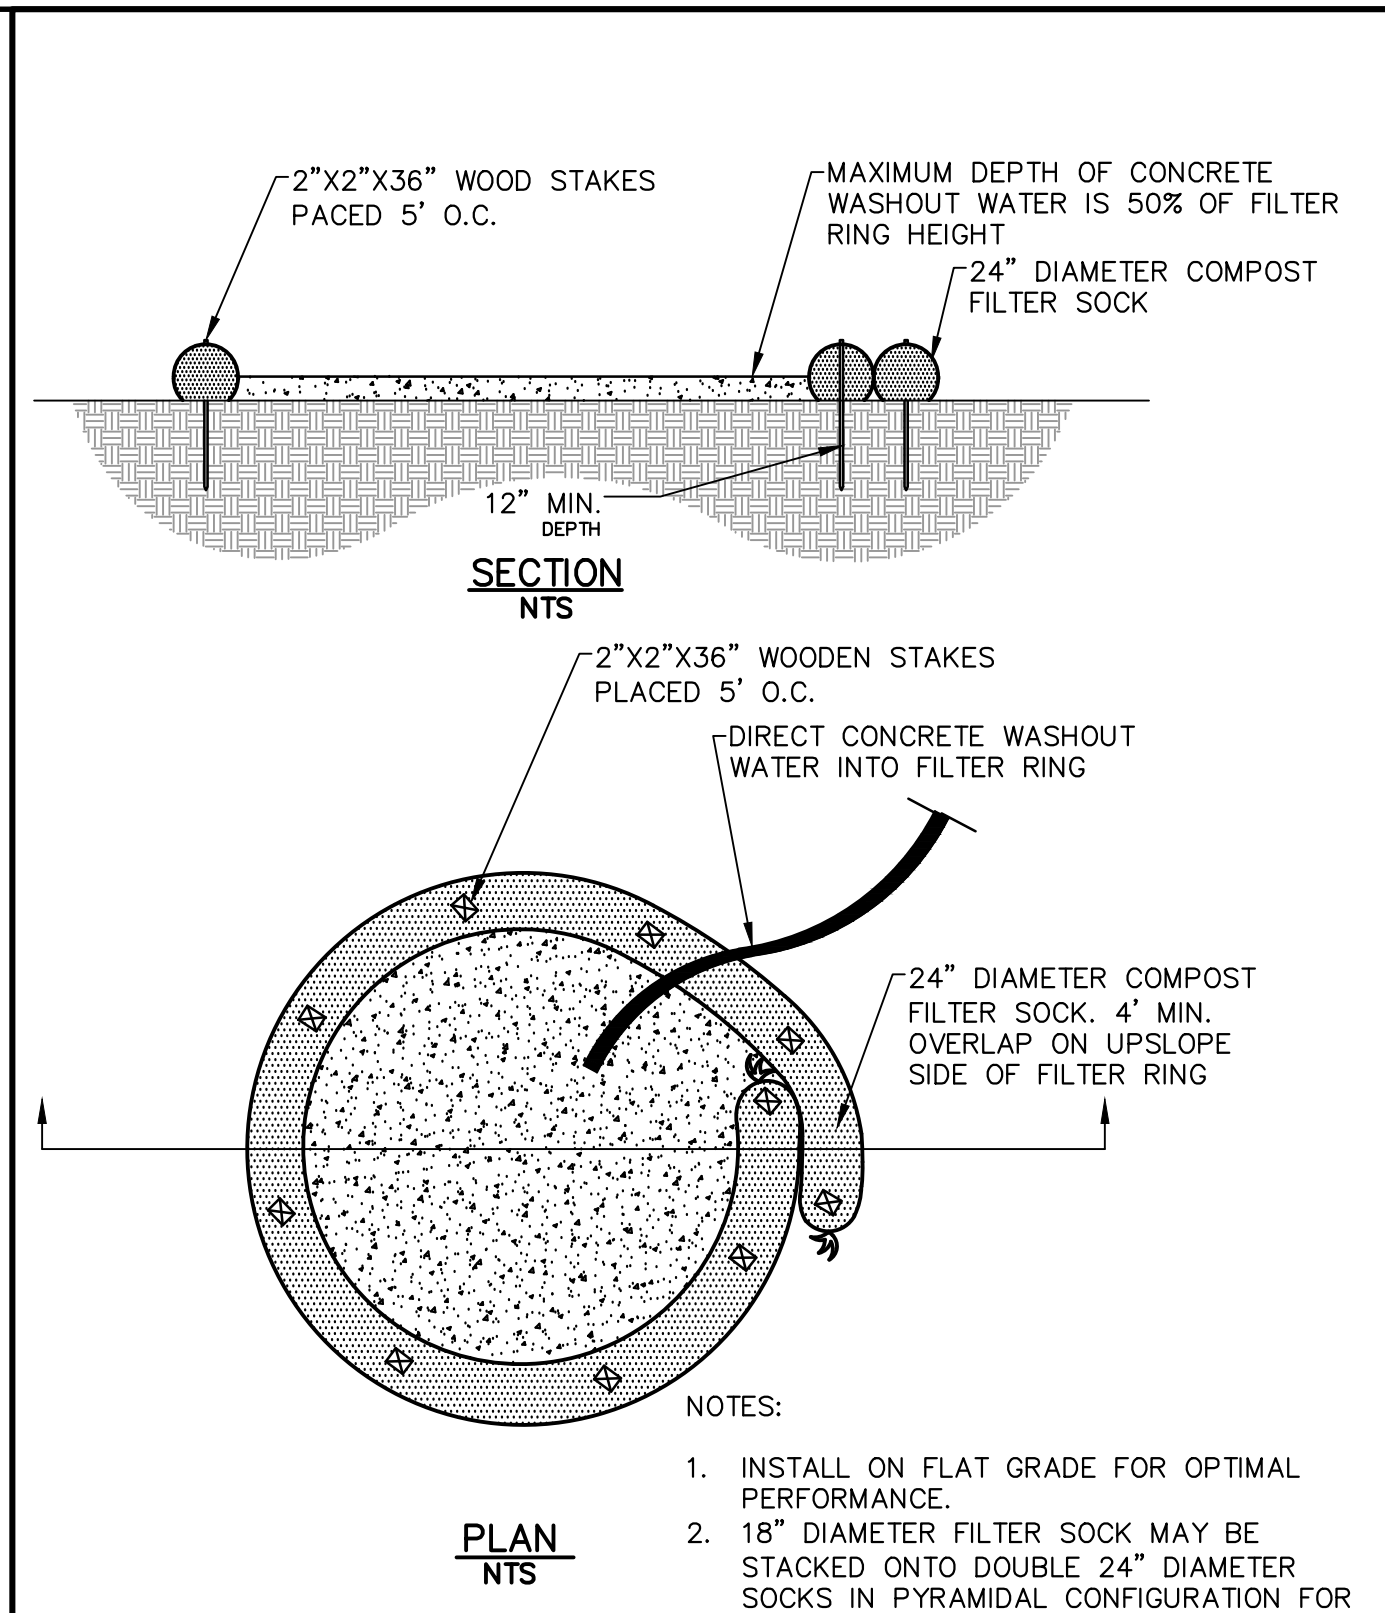

- NOTES:
- INSTALL ON FLAT GRADE FOR OPTIMAL PERFORMANCE.
  - 18" DIAMETER FILTER SOCK MAY BE STACKED ONTO DOUBLE 24" DIAMETER SOCKS IN PYRAMIDAL CONFIGURATION FOR ADDED HEIGHT.

COMPOST SOCK WASHOUT STATION

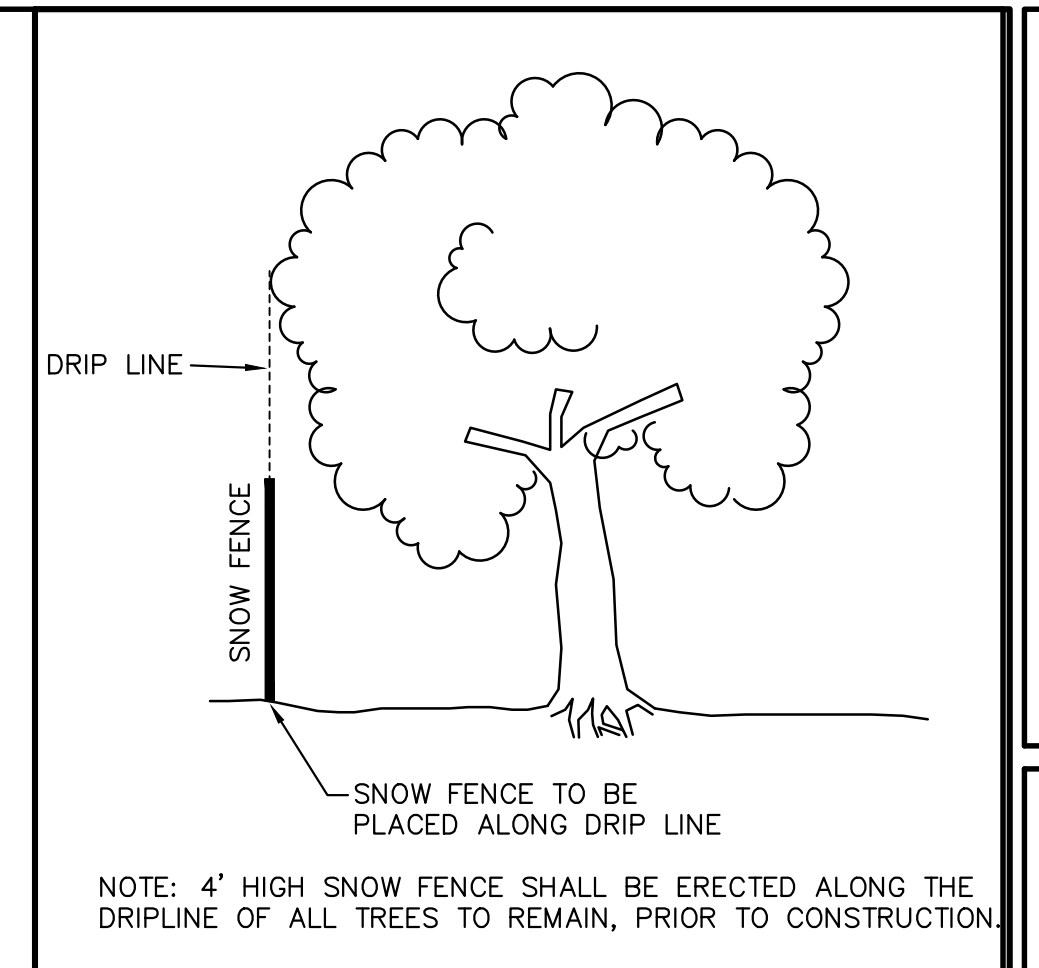

NOTE: 4' HIGH SNOW FENCE SHALL BE ERECTED ALONG THE DRIPLINE OF ALL TREES TO REMAIN, PRIOR TO CONSTRUCTION.

TREE PROTECTION DETAIL

TABLE 4.1  
Compost Sock Fabric Minimum Specifications

Material Type	3 mil HDPE	5 mil HDPE	5 mil HDPE	Multi-Filament Polypropylene (MFPP)	Heavy Duty Multi-Filament Polypropylene (HDMFPP)
Material Characteristics	Photo-degradable	Photo-degradable	Bio-degradable	Photo-degradable	Photo-degradable
Sock Diameters	12", 16"	24", 24"	12", 18", 24"	12", 18", 24", 32"	18", 24", 32"
Mesh Opening	3/8"	3/8"	3/8"	3/8"	1/8"
Tensile Strength		26 psi	26 psi	44 psi	202 psi
Ultraviolet Stability % Original Strength (ASTM G-155)	23% at 1000 hr.	23% at 1000 hr.		100% at 1000 hr.	100% at 1000 hr.
Minimum Functional Longevity	6 months	9 months	6 months	1 year	2 years


Two-ply systems

System	HDPE biaxial net
Inner Containment Netting	Continuously wound
	Fusion-welded junctures
	3/4" x 3/4" Max. aperture size
Outer Filtration Mesh	Composite Polypropylene Fabric
	Woven layer and non-woven fleece mechanically fused via needle punch
	3/16" Max. aperture size

Sock fabrics composed of burlap may be used on projects lasting 6 months or less.

TABLE 4.2  
Compost Standards

Organic Matter Content	80% - 100% (dry weight basis)
Organic Portion	Fibrous and elongated
pH	5.5 - 8.0
Moisture Content	35% - 55%
Particle Size	98% pass through 1" screen
Soluble Salt Concentration	5.0 dS/m (mmhos/cm) Maximum

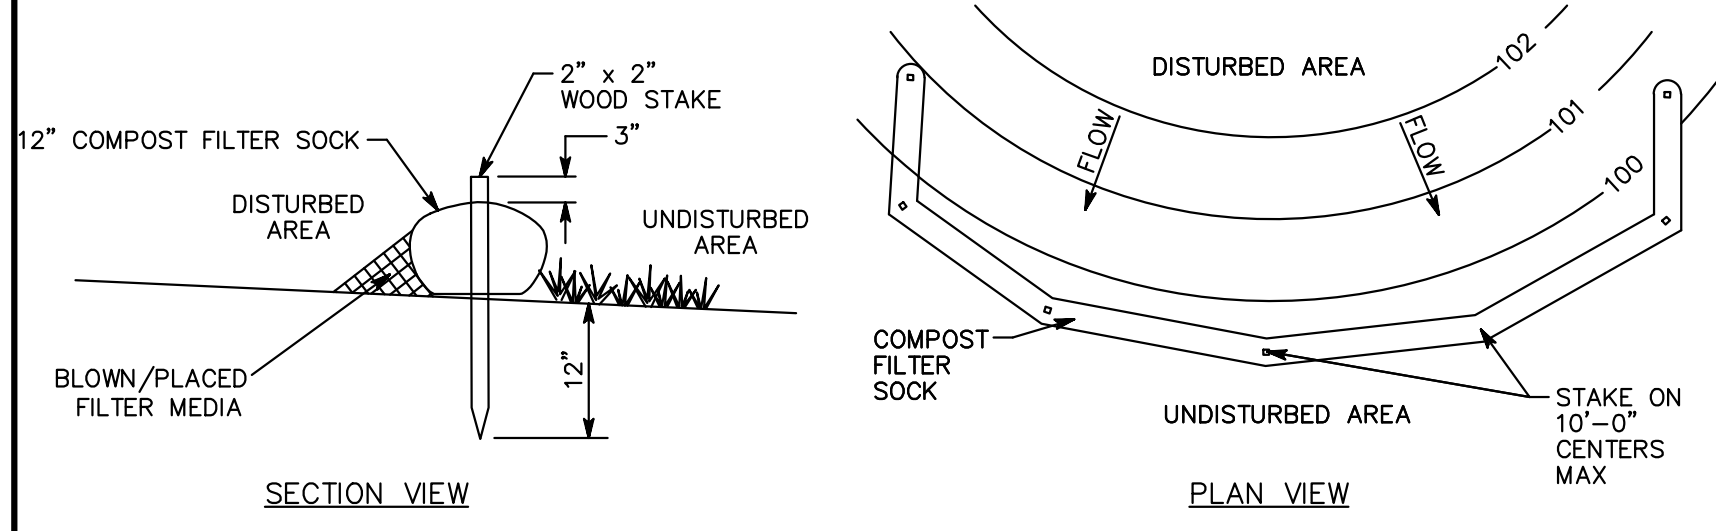

- REMOVE DEPOSITS WHEN SEDIMENT ACCUMULATION IS ONE HALF THE HEIGHT OF THE EXPOSED COMPOST FILTER SOCK.
- PLACE COMPOST FILTER SOCK ON LEVEL GRADE. EXTEND BOTH ENDS OF THE COMPOST FILTER SOCK AT LEAST 8'-0" UPSLOPE AT 45 DEGREES TO THE MAIN ALIGNMENT.
- REPLACE BIODEGRADABLE FILTER SOCK AFTER 6 MONTHS; PHOTODEGRADABLE AFTER 12 MONTHS.
- ALL DIMENSIONS ARE IN U.S. CUSTOMARY UNITS.
- CONTRACTOR SHALL PROVIDE SAND BAGS, CONCRETE BLOCKS, OR OTHER SUITABLE MATERIAL TO STABILIZE COMPOST FILTER SOCK ON PAVED AREAS AND PREVENT IT FROM MOVING OR SHIFTING.
- STABILIZING DEVICES SHALL BE SPACED 10 FEET ON CENTER OR AS RECOMMENDED BY THE MANUFACTURER, WHICHEVER IS LESS.
- SOCKS SHALL BE INSPECTED WEEKLY AND AFTER EACH RUNOFF EVENT. DAMAGED SOCKS SHALL BE REPAIRED ACCORDING TO MANUFACTURER'S SPECIFICATIONS OR REPLACED WITHIN 24 HOURS OF INSPECTION.
- TRAFFIC SHALL NOT BE PERMITTED TO CROSS FILTER SOCKS.

COMPOST FILTER SOCK, 12" DIAMETER

TOPSOIL APPLICATION

Graded areas should be scarified or otherwise loosened to a depth of 3 to 5 inches to permit bonding of the topsoil to the surface areas and to provide a roughened surface to prevent topsoil from sliding down slope.


Topsoil should be uniformly distributed across the disturbed area to a depth of 4 to 6 inches minimum - 2 inches on fill outcrops. Spreading should be done in such a manner that sodding or seeding can proceed with a minimum of additional preparation or tillage. Irregularities in the surface resulting from topsoil placement should be corrected in order to prevent formation of depressions unless such depressions are part of the PCSM plan.

Topsoil should not be placed while the topsoil or subsoil is in a frozen or muddy condition, when the subsoil is excessively wet, or in a condition that may otherwise be detrimental to proper grading and seedbed preparation. Compacted soils should be scarified 6 to 12 inches along contour wherever possible prior to seeding.

TABLE 11.1  
Cubic Yards of Topsoil Required for Application to Various Depths


Depth (in)	Per 1,000 Square Feet	Per Acre
1	3.1	134
2	6.2	268
3	9.3	403
4	12.4	537
5	15.5	672
6	18.6	806
7	21.7	940
8	24.8	1,074

Adapted from VA/DSVVC.

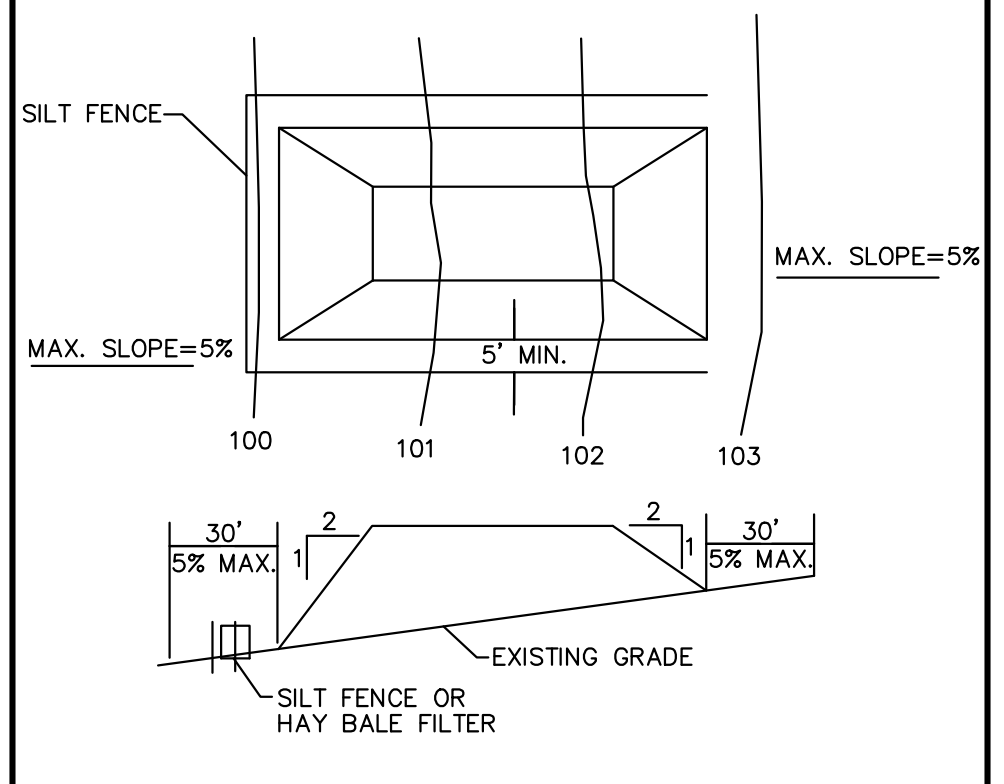


- NOTES:
- PLACE STOCKPILES AT LOCATIONS AS SHOWN ON THE SOIL EROSION AND SEDIMENT CONTROL PLAN.
  - ALL SIDE SLOPES SHALL BE 2 TO 1 OR FLATTER.
  - STOCKPILE SHALL RECEIVE A VEGETATIVE COVER IN ACCORDANCE WITH MINIMUM STABILIZATION REQUIRED.
  - SILT FENCE SHALL BE INSTALLED AS DETAILED HEREON.
  - STOCKPILE NOT TO EXCEED 20 FEET IN HEIGHT.

TEMPORARY STOCKPILE

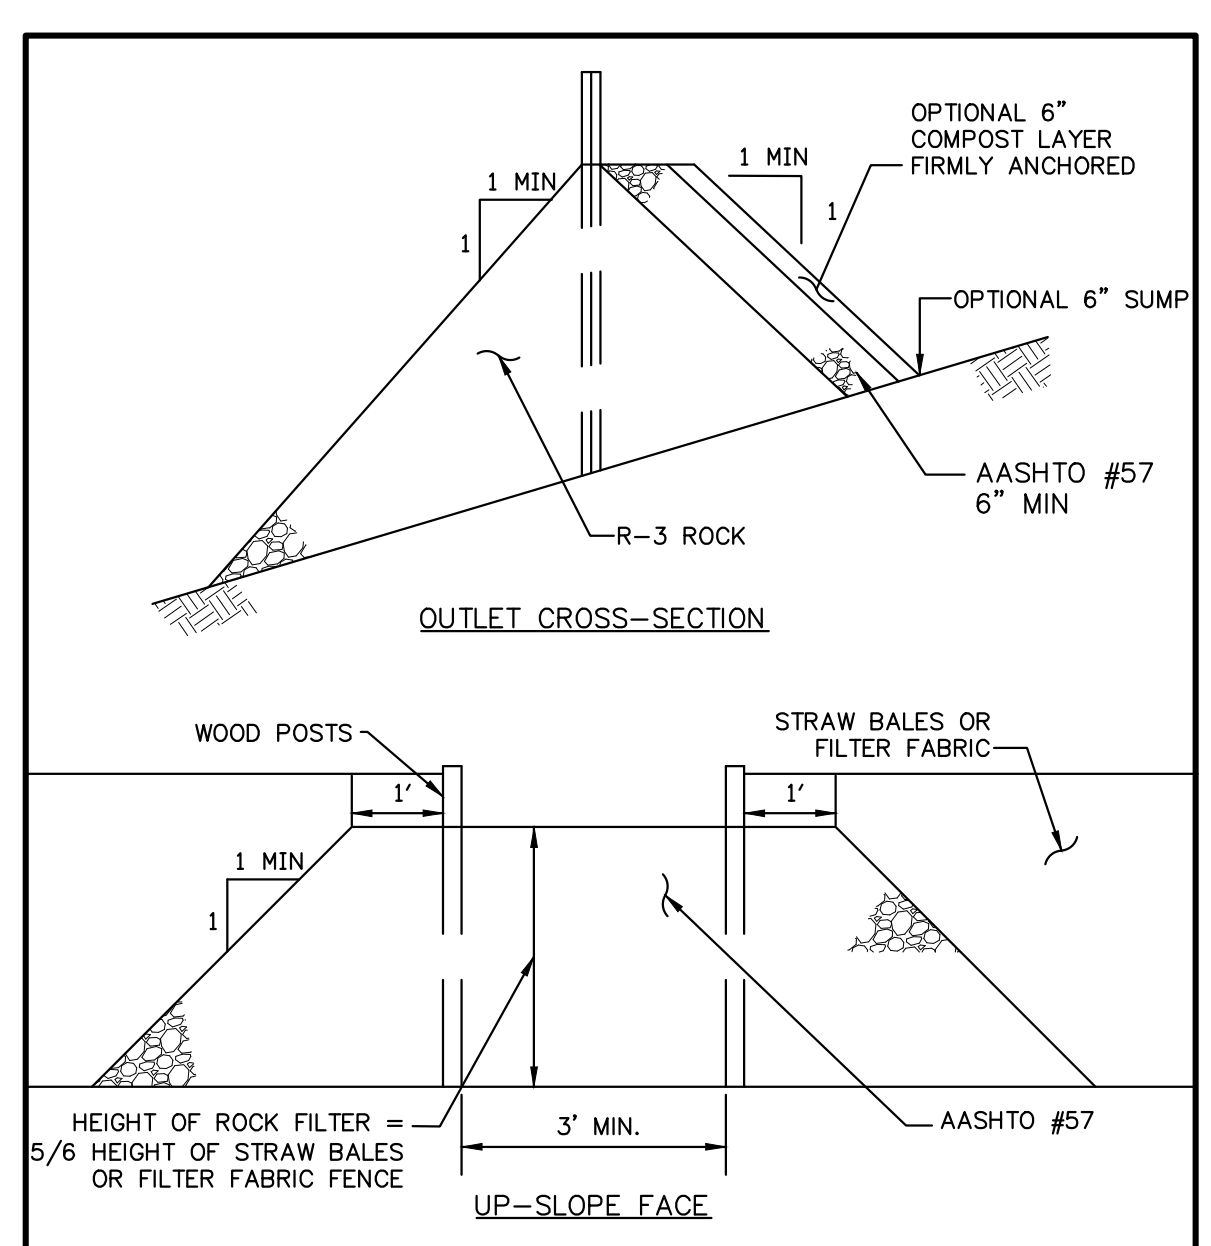

- NOTES:
- A rock filter outlet shall be installed where failure of a silt fence or straw barrier has occurred due to concentrated flow. Anchored compost layer shall be used on upslope face in HQ and EV watersheds.
  - Sediment must be removed when accumulations reach 1/3 the height of the outlet.

ROCK FILTER OUTLET (IF REQUIRED)

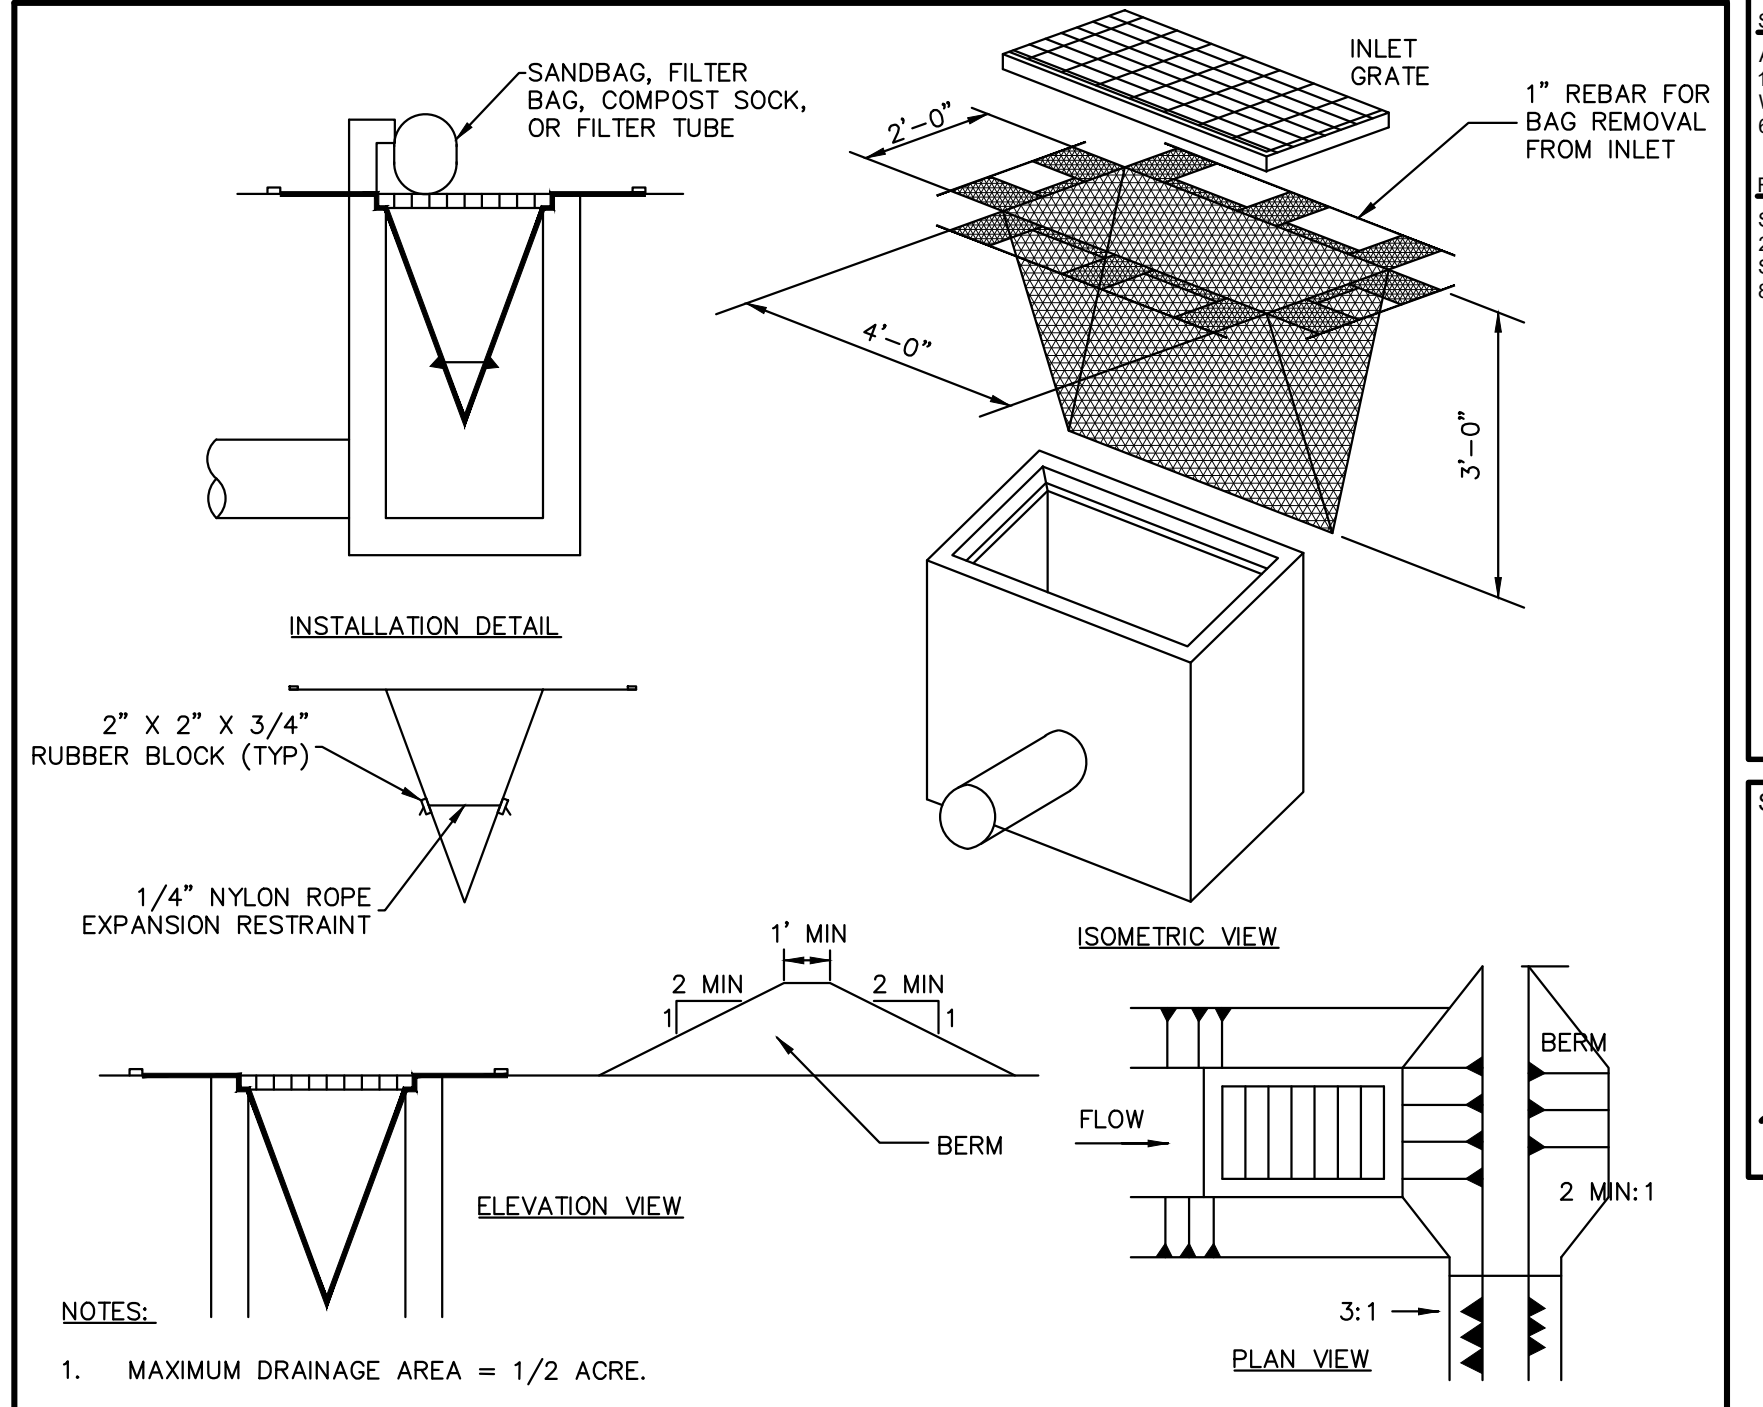

- NOTES:
- MAXIMUM DRAINAGE AREA = 1/2 ACRE.
  - INLET PROTECTION IS NOT REQUIRED FOR INLET TRIBUTARY TO SEDIMENT BASIN OR TRAP. BERMS REQUIRED FOR ALL INSTALLATIONS.
  - EARTHEN BERM IN ROADWAY SHALL BE MAINTAINED UNTIL ROADWAY IS STONED. ROAD SUBBASE BERM ON ROADWAY SHALL BE MAINTAINED UNTIL ROADWAY IS PAVED. EARTHEN BERM IN CHANNEL SHALL BE MAINTAINED UNTIL PERMANENT STABILIZATION IS COMPLETED OR TO REMAIN PERMANENTLY.
  - DO NOT USE ON MAJOR PAVED ROADWAYS WHERE PONDING MAY CAUSE TRAFFIC HAZARDS

FILTER BAG INLET PROTECTION




MCPHERSON SQUARE LIBRARY  
601 E INDIANA AVE.  
PHILADELPHIA, PA 19134

ARCHITECTS:  
SMP Architects  
1600 Walnut Street, 2nd Floor  
Philadelphia, PA 19103  
215 985 4410  
www.smparchitects.com

CIVIL ENGINEER:  
KS ENGINEERS  
530 Walnut Street, Suite 460  
Philadelphia, PA 19106  
215 616 3060

STRUCTURAL ENGINEER:  
Ann Rothmann  
100 E Lancaster Avenue, Suite 203  
Wayne, PA 19087  
610 688 2566

ROOFING CONSULTANT:  
Steve McLaughlin  
210 Garden Avenue  
Somerville, NJ 08853  
856 297 2424

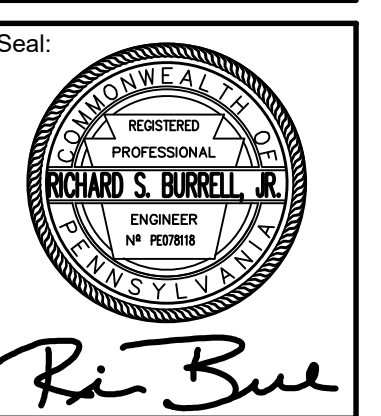

Date: 05/24/2024

Drawing Title:  
EROSION AND SEDIMENT CONTROL DETAILS

Drawing No.:  
C6.1



**STANDARD EROSION AND SEDIMENT CONTROL NOTES:**

1. AN INDUSTRIAL WASTE PERMIT WILL BE REQUIRED SHOULD PUMPING TO CITY-OWNED INFRASTRUCTURE BECOME NECESSARY DURING CONSTRUCTION. ALL PUMPING OF WATER FROM ANY WORK AREA SHALL BE DONE ACCORDING TO THE PROCEDURE DESCRIBED IN THIS PLAN, OVER UNDISTURBED, VEGETATED AREAS.
2. INLET PROTECTION SHOULD BE PROVIDED FOR ALL INLETS OWNED BY PWD THAT ARE LOCATED WITHIN ONE BLOCK OF THE PROJECT SITE.
3. PWD IS NOT RESPONSIBLE FOR ANY CLEANING OR REPAIRS NEEDED ON CITY-OWNED INFRASTRUCTURE DUE TO FAILURE OF ANY EROSION AND SEDIMENT CONTROL PRACTICES. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE THAT ALL EROSION AND SEDIMENT CONTROL PRACTICES ARE FUNCTIONING IN ACCORDANCE WITH THE APPROVED PLANS.
4. INSPECTION AND MAINTENANCE OF ALL EROSION AND SEDIMENT CONTROL BEST MANAGEMENT PRACTICES SHALL OCCUR ON A WEEKLY BASIS, BEFORE ANY ANTICIPATED PRECIPITATION EVENTS, AND AFTER ALL PRECIPITATION EVENTS.
5. THE MAXIMUM HEIGHT FOR STOCKPILES AREAS SHALL BE 20 FEET. THE MAXIMUM SIDE SLOPE FOR STOCKPILE AREAS SHALL NOT EXCEED 2:1.
6. THE ROCK CONSTRUCTION ENTRANCE THICKNESS SHALL BE CONSTANTLY MAINTAINED ON-SITE. A STOCKPILE SHALL BE MAINTAINED ON-SITE FOR THIS PURPOSE. AT THE END OF EACH CONSTRUCTION DAY, ALL SEDIMENT DEPOSITED ON PAVED ROADWAYS SHALL BE REMOVED AND RETURNED TO THE CONSTRUCTION SITE. IN NO CASE SHALL THE SEDIMENT BE WASHED, SHOVELED, OR SWEEP INTO ANY ROADSIDE DITCH, STORM SEWER, OR SURFACE WATER.
7. FILTER FABRIC FENCE SHOULD BE INSTALLED AT LEVEL GRADE. BOTH ENDS OF EACH FENCE SECTION SHOULD BE EXTENDED AT LEAST 8 FEET UPSLOPE AT 45 DEGREES TO THE MAIN BARRIER ALIGNMENT. SUPPORT STAKES SHALL BE SPACED AT A MAXIMUM OF 8 FEET. SEDIMENT MUST BE REMOVED WHEN ACCUMULATIONS REACH 1/2 THE ABOVE-GROUND HEIGHT OF THE FILTER FENCE.
8. ANY FENCE SECTION WHICH HAS BEEN UNDERMINED OR TOPPED MUST BE IMMEDIATELY REPLACED WITH A ROCK FILTER OUTLET. SEDIMENT MUST BE REMOVED WHEN ACCUMULATIONS REACH 1/3 THE HEIGHT OF THE OUTLET.
9. EROSION CONTROL BLANKETING SHALL BE INSTALLED ON ALL SLOPES 3H:1V OR STEEPER WITHIN 50 FEET OF A SURFACE WATER AND ON ALL OTHER DISTURBED AREAS SPECIFIED ON THE PLAN MAPS AND/OR DETAIL SHEETS.
10. IMMEDIATELY UPON DISCOVERING UNFORESEEN CIRCUMSTANCES POSING THE POTENTIAL FOR ACCELERATED EROSION AND/OR SEDIMENT POLLUTION, THE OPERATOR SHALL IMPLEMENT APPROPRIATE BEST MANAGEMENT PRACTICES TO MINIMIZE THE POTENTIAL FOR EROSION AND SEDIMENT POLLUTION AND NOTIFY PWD AND PA DEP.
11. UNTIL THE SITE IS STABILIZED, ALL E&S BMP'S SHALL BE MAINTAINED PROPERLY. MAINTENANCE SHALL INCLUDE INSPECTIONS OF ALL E&S BMP'S PRIOR TO ANY ANTICIPATED STORM EVENT, AFTER EACH RUNOFF EVENT AND ON A WEEKLY BASIS. ALL PREVENTATIVE AND REMEDIAL MAINTENANCE WORK, INCLUDING CLEAN OUT, REPAIR, REPLACEMENT, REGRADING, RESEEDING, REMULCHING, AND RENEWING, MUST BE PERFORMED IMMEDIATELY. IF THE E&S BMP'S FAIL TO PERFORM AS EXPECTED, REPLACEMENT BMP'S, OR MODIFICATIONS OF THOSE INSTALLED, WILL BE REQUIRED.
12. ALL EARTH DISTURBANCES, INCLUDING CLEARING AND GRUBBING, AS WELL AS CUTS AND FILLS, SHALL BE DONE IN ACCORDANCE WITH THE APPROVED E&S PLAN. A COPY OF THE APPROVED DRAWINGS MUST BE AVAILABLE AT THE PROJECT SITE AT ALL TIMES. PWD SHALL BE NOTIFIED OF ANY CHANGES TO THE APPROVED PLAN PRIOR TO IMPLEMENTATION OF THOSE CHANGES. PWD MAY REQUIRE A WRITTEN SUBMITTAL OF THOSE CHANGES FOR REVIEW AND APPROVAL AT ITS DISCRETION.
13. AT LEAST THREE (3) DAYS PRIOR TO STARTING ANY EARTH DISTURBANCE ACTIVITIES, OR EXPANDING INTO AN AREA PREVIOUSLY UNMARKED, THE PENNSYLVANIA ONE CALL SYSTEM INC. SHALL BE NOTIFIED AT 1-800-242-1776 FOR THE LOCATION OF EXISTING UNDERGROUND UTILITIES.
14. ALL EARTH DISTURBANCE ACTIVITIES SHALL PROCEED IN ACCORDANCE WITH THE SEQUENCE PROVIDED ON THE PLAN DRAWINGS. DEVIATION FROM THAT SEQUENCE MUST BE APPROVED IN WRITING BY PWD AND THE PA DEP PRIOR TO IMPLEMENTATION.
15. AREAS TO BE FILLED ARE TO BE CLEARED, GRUBBED, AND STRIPPED OF TOPSOIL TO REMOVE TREES, VEGETATION, ROOTS, AND OTHER OBJECTIONABLE MATERIAL.
16. CLEARING, GRUBBING, AND TOPSOIL STRIPPING SHALL BE LIMITED TO THOSE AREAS DESCRIBED IN EACH STAGE OF THE CONSTRUCTION SEQUENCE. GENERAL SITE CLEARING, GRUBBING, AND TOPSOIL STRIPPING MAY NOT COMMENCE IN ANY STAGE OF THE PROJECT UNTIL THE E&S BMP'S SPECIFIED BY THE BMP'S SEQUENCE FOR THAT STAGE HAVE BEEN INSTALLED AND ARE FUNCTIONING AS DESCRIBED IN THIS E&S PLAN.
17. AT NO TIME SHALL CONSTRUCTION VEHICLES BE ALLOWED TO ENTER AREAS OUTSIDE THE LIMIT OF DISTURBANCE BOUNDARIES SHOWN ON THE PLAN MAPS. THESE AREAS MUST BE CLEARLY MARKED AND FENCED OFF BEFORE CLEARING AND GRUBBING OPERATIONS BEGIN.
18. A LOG SHOWING DATES THAT E&S BMP'S WERE INSPECTED AS WELL AS ANY DEFICIENCIES FOUND AND THE DATE THEY WERE CORRECTED SHALL BE MAINTAINED ON THE SITE AND BE MADE AVAILABLE TO PWD AT THE TIME OF INSPECTION.
19. ALL SEDIMENT REMOVED FROM BMP'S SHALL BE DISPOSED OF IN THE FOLLOWING MANNER: REMOVAL AND DISPOSAL TO BE AT AN OFF-SITE LOCATION IN ACCORDANCE WITH ALL LOCAL, STATE AND FEDERAL REGULATIONS.
20. AREAS WHICH ARE TO BE TOPSOILED SHALL BE SCARIFIED TO A MINIMUM DEPTH OF THREE TO FIVE INCHES — SIX TO 12 INCHES ON COMPACTED SOILS — PRIOR TO PLACEMENT OF TOPSOIL. AREAS TO BE VEGETATED SHALL HAVE A MINIMUM FOUR INCHES OF TOPSOIL IN PLACE PRIOR TO SEEDING AND MULCHING. FILL OUTSLOPES SHALL HAVE A MINIMUM OF TWO INCHES OF TOPSOIL.

21. ALL FILLS SHALL BE COMPACTED AS REQUIRED TO REDUCE EROSION, SLIPPAGE, SETTLEMENT, SUBSIDENCE, OR OTHER RELATED PROBLEMS. FILL INTENDED TO SUPPORT BUILDINGS, STRUCTURES, AND CONDUITS, ETC. SHALL BE COMPACTED IN ACCORDANCE WITH LOCAL REQUIREMENTS OR CODES.
22. ALL EARthen FILLS MUST BE PLACED IN COMPACTED LAYERS NOT TO EXCEED NINE INCHES IN THICKNESS.
23. FILL MATERIALS SHALL BE FREE OF FROZEN PARTICLES, BRUSH, ROOTS, SOD, OR OTHER FOREIGN OR OBJECTIONABLE MATERIALS THAT WOULD INTERFERE WITH OR PREVENT CONSTRUCTION OF SATISFACTORY FILLS.
24. FROZEN MATERIALS OR SOFT, MUCKY, OR HIGHLY COMPRESSIBLE MATERIALS SHALL NOT BE INCORPORATED INTO FILLS.
25. FILL SHALL NOT BE PLACED ON SATURATED OR FROZEN SURFACES.
26. SEEPS OR SPRINGS ENCOUNTERED DURING CONSTRUCTION SHALL BE HANDLED IN ACCORDANCE WITH THE STANDARD AND SPECIFICATION FOR SUBSURFACE DRAIN OR OTHER APPROVED METHOD.
27. ALL GRADED AREAS SHALL BE PERMANENTLY STABILIZED IMMEDIATELY UPON REACHING FINISHED GRADE. CUT SLOPES IN COMPETENT BEDROCK AND ROCK FILLS NEED NOT BE VEGETATED. SEEDED AREAS WITHIN 50 FEET OF A SURFACE WATER, OR AS OTHERWISE SHOWN ON THE PLAN DRAWINGS, SHALL BE BLANKETED ACCORDING TO THE STANDARDS OF THIS PLAN.
28. IMMEDIATELY AFTER EARTH DISTURBANCE ACTIVITIES CEASE IN ANY AREA OR SUB-AREA OF THE PROJECT, THE OPERATOR SHALL STABILIZE ALL DISTURBED AREAS. DURING NON-GERMINATING MONTHS, MULCH OR PROTECTIVE BLANKETING SHALL BE APPLIED AS DESCRIBED IN THE PLAN. AREAS NOT AT FINISHED GRADE, WHICH WILL BE REACTIVATED WITHIN ONE YEAR, MAY BE STABILIZED IN ACCORDANCE WITH THE TEMPORARY STABILIZATION SPECIFICATIONS. THOSE AREAS WHICH WILL NOT BE REACTIVATED WITHIN ONE YEAR SHALL BE STABILIZED IN ACCORDANCE WITH THE PERMANENT STABILIZATION SPECIFICATIONS.
29. PERMANENT STABILIZATION IS DEFINED AS A MINIMUM UNIFORM, PERENNIAL 70% VEGETATIVE COVER OR OTHER PERMANENT NON-VEGETATIVE COVER WITH A DENSITY SUFFICIENT TO RESIST ACCELERATED EROSION. CUT AND FILL SLOPES SHALL BE CAPABLE OF RESISTING FAILURE DUE TO SLUMPING, SLIDING, OR OTHER MOVEMENTS.
30. E&S BMP'S SHALL REMAIN FUNCTIONAL AS SUCH UNTIL ALL AREAS TRIBUTARY TO THEM ARE PERMANENTLY STABILIZED OR UNTIL THEY ARE REPLACED BY ANOTHER BMP'S APPROVED BY PWD AND PA DEP.
31. AFTER FINAL SITE STABILIZATION HAS BEEN ACHIEVED, TEMPORARY E&S BMP'S MUST BE REMOVED OR CONVERTED TO PERMANENT POST-CONSTRUCTION STORMWATER MANAGEMENT PRACTICES. AREAS DISTURBED DURING REMOVAL OR CONVERSION OF THE E&S BMP'S SHALL BE STABILIZED IMMEDIATELY. IN ORDER TO ENSURE RAPID REVEGETATION OF DISTURBED AREAS, SUCH REMOVAL/CONVERSIONS ARE TO BE DONE ONLY DURING THE GERMINATING SEASON.
32. SEDIMENT BASINS AND/OR TRAPS SHALL BE KEPT FREE OF ALL CONSTRUCTION WASTE, WASH WATER, AND OTHER DEBRIS HAVING POTENTIAL TO CLOG THE BASIN/TRAP OUTLET STRUCTURES AND/OR POLLUTE THE SURFACE WATERS. (WHEN APPLICABLE)
33. DURING CONSTRUCTION, THE SELECTED CONTRACTOR IS EXPECTED TO FOLLOW THE PCSMP APPROVED BY PWD (WHERE APPLICABLE). NO CHANGE OR DEVIATION FROM THE APPROVED PCSMP IS PERMITTED WITHOUT PRIOR APPROVAL FROM PWD.
34. ALL WORK ASSOCIATED WITH PWD WATER CONVEYANCE AND SEWER INFRASTRUCTURE SHALL BE DONE IN ACCORDANCE WITH THE CITY OF PHILADELPHIA WATER DEPARTMENT "WATER MAIN STANDARD DETAILS AND CORROSION CONTROL SPECIFICATIONS", 1985 EDITION, AND "STANDARD DETAILS AND STANDARD SPECIFICATIONS FOR SEWERS", 1985 EDITION.
35. CONTACT PWD WATER TRANSPORT RECORDS (1101 MARKET STREET, 2ND FLOOR, PHONE: 215-685-8271) FOR ADDITIONAL APPROVALS AND PERMITS REQUIRED FOR ALL WATER SERVICES, METERS, AND CONNECTIONS TO THE EXISTING AND/OR PROPOSED PWD FACILITIES.
36. ALL BUILDING MATERIALS AND WASTES SHALL BE REMOVED FROM THE SITE AND RECYCLED OR DISPOSED OF IN ACCORDANCE WITH THE PADEP'S SOLID WASTE MANAGEMENT REGULATIONS AT 25 PA CODE 280.1 ET SEQ., 271.1 AND 287.1 ET SEQ. NO BUILDING MATERIALS OR WASTES OR UNUSED BUILDING MATERIALS SHALL BE BURNED, BURIED, DUMPED, OR DISCHARGED AT THE SITE.
37. A DISTURBANCE PERMIT WILL BE REQUIRED WHEN COMPLETELY DEMOLISHING A BUILDING OR STRUCTURE THAT IS MORE THAN THREE (3) STORIES, GREATER THAN FORTY (40) FEET TALL, OR ENCOMPASSES MORE THAN TEN THOUSAND (10,000) SQUARE FEET; COMPLETELY OR PARTIALLY DEMOLISHING ANY BUILDING OR STRUCTURE BY IMPLICATION; OR ENGAGING IN EARTHWORKS, DEFINED AS "CLEARING, GRUBBING, OR EARTH DISTURBANCE OF ANY LAND EXCESS OF 5,000 SQUARE FEET."

**SITE STABILIZATION METHODS (TEMPORARY & PERMANENT STABILIZATION)**

1. STRAW MULCH MUST BE APPLIED AT 3.0 TONS PER ACRE.
2. MULCH WITH MULCH CONTROL NETTING OR EROSION CONTROL BLANKETS MUST BE INSTALLED ON ALL SLOPES GREATER THAN 3:1.
3. STRAW MULCH SHALL BE APPLIED IN LONG STRANDS, NOT CHOPPED OR FINELY BROKEN.

**TEMPORARY SEEDING**

1. THE FOLLOWING SURFACES OF THE SITE SHALL BE TEMPORARILY SEEDED AND MULCHED:

- A. THE SURFACE OF TOPSOIL STOCKPILES.
  - B. THE SURFACE OF EXPOSED EARTH AREAS THAT WILL BE EXPOSED WITHOUT CONSTRUCTION ACTIVITY THEREON.
1. SEEDING SHALL OCCUR IMMEDIATELY AFTER ESTABLISHMENT OF THE TOPSOIL STOCKPILES OR ROUGH GRADED AREAS. THE FOLLOWING SHALL BE PLANTED:  
A. 40 LBS./ACRE ANNUAL RYE GRASS — COMMON, 100% P.L.S.
  2. PREPARE AREAS TO BE SEEDDED AS FOLLOWS:  
A. REMOVE ALL DEBRIS, INCLUDING LARGE STONES. APPLY LIME AT A RATE OF 3 TONS PER ACRE AND FERTILIZER AT THE RATE OF 50-50 PER ACRE AND WORK INTO SOIL.  
B. SOW SEED AT THE INDICATED RATE. DIVIDE SEED INTO TWO EQUAL LOTS. SOW ONE LOT IN ONE DIRECTION. SOW SECOND LOT AT RIGHT ANGLE TO FIRST. RAKE SEEDED AREA SLIGHTLY. ROLL SURFACE LIGHTLY TO FIRM SOIL AROUND SEED.
  3. PLACE CLEAN DRY STRAW OR HAY MULCH WITHIN 48 HOURS AFTER SEEDING. PLACE AT THE RATE OF 3 TONS PER ACRE.
  4. SEEDING DATES SHALL BE BETWEEN MARCH 1 AND NOVEMBER 15.

**TEMPORARY MULCHING**

1. MULCH PROPOSED LANDSCAPE AREAS OR TOPSOIL STOCKPILES IF EARTHWORK IS COMPLETED OUTSIDE OF THE RECOMMENDED PLANTING SEASONS FOR TEMPORARY SEEDING OR DUE TO UNFAVORABLE WEATHER CONDITIONS.
2. MULCH SHALL BE APPLIED IMMEDIATELY FOLLOWING THE ESTABLISHMENT OF THE TOPSOIL STOCKPILE OR ROUGH GRADING.
3. MULCH WITH SUITABLE FIBROUS GROUND, SHREDDED AGED HARDWOOD, PINE WOOD BARK OR STRAW, UNIFORM AND CONTINUOUSLY TO A LOOSE DEPTH OF 3 INCHES MINIMUM. ANCHOR AS REQUIRED.
4. PROPERLY MAINTAIN MULCHED AREAS UNTIL PERMANENT STABILIZATION MEASURES ARE COMPLETE. REAPPLY MULCH MATERIALS WHICH BECOME DISLOADED AS INITIAL OR MODIFIED RATES AS NECESSARY. IF A SLOPE FAILURE OCCURS WHICH REQUIRES REDRESSING, EXCAVATION, OR THE ESTABLISHMENT OF A NEW SLOPE, REPLACE MULCH AS NECESSARY.

**PERMANENT SEEDING**

1. PERMANENT SEEDING SHALL OCCUR IMMEDIATELY AFTER THE FINAL GRADING IS COMPLETED. THE FOLLOWING SEED SHALL BE PLACED UNLESS OTHERWISE SPECIFIED ON THE PLANS OR DIRECTED IN THE FIELD. THE FOLLOWING SEED MIX SHALL BE USED:  
A. 40% PERENNIAL RYE GRASS  
B. 3% RED TOP  
C. 20% CHAMPION PERENNIAL RYE GRASS QUANTITIES ARE OF PURE LIVE SEED (P.L.S.) SPREAD AT A RATE OF 63 LBS. PER ACRE.
2. REMOVE ALL DEBRIS, INCLUDING LARGE STONES. TILL SOIL TO A DEPTH OF FOUR INCHES TO SIX INCHES. APPLY LIME AT A RATE OF 4 TONS PER ACRE. APPLY COMMERCIAL 10-20-20 FERTILIZER AT A RATE OF 930 LBS. PER ACRE. WORK FERTILIZER INTO TOP INCH OF SOIL.
3. SEED ONLY AT THE FOLLOWING TIMES:  
A. SPRING: MARCH 1 TO APRIL 30  
B. LATE SUMMER/EARLY FALL: AUGUST 15 TO NOVEMBER 15
4. DIVIDE SEED INTO TWO EQUAL LOTS. SOW ONE LOT IN ONE DIRECTION. SOW SECOND LOT AT RIGHT ANGLE TO FIRST LOT. RAKE SEEDED AREA SLIGHTLY. ROLL SURFACE LIGHTLY TO FIRM SOIL AROUND SEED.
5. MULCH SEEDED AREAS WITH STRAW OR HAY AT THE RATE OF 3 TONS PER ACRE. ANCHOR MULCH. COMPLY WITH THE REQUIREMENTS OF SECTION 805 — MULCHING, PENNDOT PUBLICATION 408. ANCHOR MULCH AS SPECIFIED.
6. MULCHING SHALL BE DONE AT THE MINIMUM RATE OF 3 TONS PER ACRE WITH SALT HAY, HAY OR STRAW MULCHES. PLACE MULCH IMMEDIATELY AFTER SEEDING OR WITHIN 48 HOURS AFTER SEEDING IS COMPLETED. PROPERLY MAINTAIN MULCHED AREAS UNTIL THE ENTIRE PROJECT HAS BEEN COMPLETED. PROMPTLY REAPPLY MULCH MATERIALS WHICH BECOME DISLOADED OR LOST DUE TO WIND, RAIN, OR OTHER CAUSES AT INITIAL RATES OR AS DIRECTED.
7. LIQUID MULCH BINDERS MAY BE USED TO ANCHOR SALT HAY, HAY OR STRAW MULCHES. A. APPLICATIONS SHOULD BE HEAVIER AT EDGES WHERE WIND CATCHES THE MULCH IN VALLEYS AND AT CRESTS OF BANKS. REMAINDER OF AREAS SHOULD BE UNIFORM IN APPEARANCE.  
B. USE ONE OF THE FOLLOWING: EMULSIFIED ASPHALT, CLASS E-1 OR E-6. APPLY 31 GALLONS PER 1,000 SQUARE YARDS ON SLOPES LESS THAN 8 FEET HIGH. ON SLOPES 8 FEET HIGH OR MORE, USE 58 GALLONS PER 1,000 SQUARE YARDS.  
C. OUTBACK ASPHALT, CLASS RC-250. APPLY 31 GALLONS PER 1,000 SQUARE YARDS ON FLAT AREAS AND ON SLOPES LESS THAN 8 FEET HIGH. ON SLOPES 8 FEET HIGH OR MORE, USE 58 GALLONS PER 1,000 SQUARE YARDS.  
D. NATURAL VEGETABLE GUM BLENDED WITH GELLING AND HARDENING AGENTS (TERRA TACK, AR) AS MANUFACTURED BY GRASS GROWERS COMPANY OR EQUAL. APPLY 25 LBS. PER 1,000 SQUARE YARDS.
11. INSTALL PROPOSED SITE IMPROVEMENTS.
12. WATER PUMPED FROM WORK AREAS SHOULD BE TREATED FOR SEDIMENT REMOVAL PRIOR TO DISCHARGING TO A "SURFACE WATER".
13. AS SOON AS SLOPES, CHANNEL DITCHES AND OTHER DISTURBED AREAS REACH FINAL GRADE, THEY MUST BE STABILIZED. CESSATION OF ACTIVITY FOR FOUR (4) DAYS OR LONGER REQUIRES TEMPORARY STABILIZATION.
14. TOPSOIL AND SEED GRASSED AREAS. INSTALL PLANTS AND TREES.
15. SWEEP PAVED AREAS DAILY TO PREVENT TRACKING OF SOIL OFF-SITE.
16. UPON COMPLETION OF ALL EARTH DISTURBANCE ACTIVITIES AND PERMANENT STABILIZATION OF ALL DISTURBED AREAS, THE OWNER AND/OR OPERATOR SHALL CONTACT INSPECTIONS COORDINATOR OF PWD (OFFICE: 215-685-6387) FOR A FINAL INSPECTION PRIOR TO REMOVAL ON THE E&S BMP'S.
17. REMOVE SOIL EROSION MEASURES AFTER SITE HAS BEEN INSPECTED AND STABILIZED.

**MAINTENANCE PROGRAM**

2. THE OWNER WILL BE RESPONSIBLE FOR THE MAINTENANCE OF ALL PERMANENT CONTROL MEASURES.
3. UNTIL THE SITE IS STABILIZED, ALL EROSION AND SEDIMENT BMP'S MUST BE MAINTAINED PROPERLY. MAINTENANCE MUST INCLUDE INSPECTIONS OF ALL EROSION AND SEDIMENT CONTROL BMP'S AFTER EACH RUNOFF EVENT AND ON A WEEKLY BASIS. ALL PREVENTATIVE AND REMEDIAL MAINTENANCE WORK, INCLUDING CLEAN OUT, REPAIR, REPLACEMENT, REGRADING, RESEEDING, REMULCHING, AND RENEWING, MUST BE DONE IMMEDIATELY. IF EROSION AND SEDIMENT CONTROL BMP'S FAIL TO PERFORM AS EXPECTED, REPLACEMENT BMP'S, OR MODIFICATIONS TO THOSE INSTALLED WILL BE REQUIRED.
4. SEDIMENT REMOVED FROM BMP'S SHALL BE DISPOSED OF AT AN OFF-SITE LOCATION IN ACCORDANCE WITH ALL LOCAL, STATE AND FEDERAL REGULATIONS.
5. SOIL SEDIMENT REMOVED FROM SILT FENCE DURING REGULAR MAINTENANCE WILL BE INCORPORATED BACK INTO THE EARTHWORK AS FILL ON THE SITE. SOIL SEDIMENT MATERIAL SHALL BE DISTRIBUTED ON-SITE WITHOUT CHANGING DRAINAGE PATTERNS DURING A SPECIFIC CONSTRUCTION STAGE. SILT FENCE INSTALLED ON THE PROJECT SITE SHALL BE MAINTAINED AS FOLLOWS:  
A. THE FENCE CONDITION WILL BE INSPECTED ONCE A WEEK OR AFTER EVERY STORM EVENT, WHICHEVER COMES FIRST. ANY NECESSARY REPAIRS WILL BE MADE IMMEDIATELY.  
B. ACCUMULATED SEDIMENTS WILL BE REMOVED AS REQUIRED TO KEEP THE FENCE FUNCTIONAL. DEPOSITS WILL BE REMOVED WHERE ACCUMULATIONS REACH ONE-HALF THE ABOVE-GROUND HEIGHT OF THE FENCE.  
C. UNDERCUTTING OR EROSION OF THE TOE ANCHOR WILL BE REPLACED IMMEDIATELY WITH ROCK FILTER OUTLETS.  
D. ANY MANUFACTURER'S RECOMMENDATIONS WILL BE ADHERED TO WHEN REPLACING FILTER FABRIC FENCE DUE TO WEATHERING.
6. AT THE END OF EACH CONSTRUCTION DAY, ANY SEDIMENT DEPOSITED ON PUBLIC ROADWAYS, WILL BE REMOVED AND RETURNED TO THE CONSTRUCTION SITE. WASHING OF THE ROADWAY WITH WATER WILL NOT BE PERMITTED.
7. OTHER BMP'S  
A. SEDIMENT MUST BE REMOVED FROM STORM WATER INLET PROTECTION AFTER EACH RUNOFF EVENT.

**CONSTRUCTION SEQUENCE:**

1. AT LEAST 7 DAYS PRIOR TO STARTING ANY EARTH DISTURBANCE ACTIVITIES, THE OPERATOR SHALL INVITE ALL CONTRACTORS INVOLVED IN EARTH MOVING ACTIVITIES, THE LANDOWNER, ALL APPROPRIATE CITY OFFICIALS, THE EROSION AND SEDIMENT CONTROL PREPARER, AND REPRESENTATIVE OF THE CITY OF PHILADELPHIA EROSION AND SEDIMENT CONTROL OFFICE TO AN ON-SITE MEETING. INCLUDE A REPRESENTATIVE FROM PWD'S EROSION AND SEDIMENT CONTROL INSPECTION GROUP BY CONTACTING THE INSPECTIONS COORDINATOR OF PWD (OFFICE 215-685-6387).
2. AT LEAST 3 DAYS BEFORE STARTING ANY EARTH DISTURBANCE ACTIVITIES, ALL CONTRACTORS INVOLVED IN THOSE ACTIVITIES SHALL NOTIFY THE PENNSYLVANIA ONE CALL SYSTEM INCORPORATED AT 1-800-242-1776 FOR BURIED UTILITY LOCATIONS.
3. CONSTRUCTION FENCE TO BE INSTALLED AROUND THE PERMETER OF THE WORK AREA. THE CONTRACTOR SHALL COORDINATE THE LOCATION OF THE FENCE WITH THE OWNER AND/OR ENGINEER. CONSTRUCTION FENCE LOCATION SHALL BE INSTALLED TO PROTECT THE PUBLIC FROM LAND DISTURBANCE ACTIVITIES AND TO MAINTAIN PEDESTRIAN ACCESS.
4. INSTALL COMPOST FILTER SOCK DOWNHILL FROM ALL EARTH MOVING ACTIVITIES AND AS SHOWN ON THE PLAN. ALTHOUGH OFF SITE AREAS ARE PAVED, COMPOST FILTER SOCK OR OTHER EROSION CONTROL PRACTICES SHALL BE INSTALLED AROUND THE PERMETER OF THE WORK AREA AS SHOWN ON THE PLAN.
5. INSTALL INLET PROTECTION AS SHOWN ON THE PLAN. EXISTING INLETS SHALL BE PROTECTED THROUGHOUT THE DURATION OF THE CONSTRUCTION.
6. INSTALL CONSTRUCTION ENTRANCE AS SHOWN AND IN ACCORDANCE WITH THE CONSTRUCTION ENTRANCE DETAIL.
7. CLEAR AND GRUB SITE. DEMOLISH EXISTING PAVING, CURBING, AND FENCING AS REQUIRED. SAWCUT PAVED AREAS AS NEEDED TO MINIMIZE EARTH DISTURBANCE. EXCAVATE TRENCHES FOR PROPOSED SEWER CONNECTIONS. DEMOLISHED MATERIAL SHALL BE REMOVED FROM THE SITE AND DISCARDED IN ACCORDANCE WITH APPLICABLE CITY, STATE, AND FEDERAL REGULATIONS.
8. ROUGH GRADE SUBBASE TO REQUIRED DEPTHS.
9. INSTALL ALL INLETS AND PIPING IN ACCORDANCE WITH THE PLAN DRAWINGS. PHOTOGRAPH INLETS SHOWING THE PROPERLY INSTALLED SUMP (WITH TAPE MEASURE AS SIZE REFERENCE) AND TRAP/HOOD (INCLUDING GROUTING) IN ACCORDANCE WITH THE CONSTRUCTION CERTIFICATION PACKAGE. CONFIRM, MEASURE, AND PHOTOGRAPH INLET AND INLET SUMP DEPTHS IN ACCORDANCE WITH THE CONSTRUCTION CERTIFICATION PACKAGE. INSTALL AND PHOTOGRAPH TRAPS/HOODS AS INDICATED ON THE PLANS IN ACCORDANCE WITH THE CONSTRUCTION CERTIFICATION PACKAGE. INSTALL INLET PROTECTION ON INLETS AS THEY BECOME FUNCTIONAL.
10. REMOVE ANY ACCUMULATED DEBRIS OR SEDIMENT THAT HAS TAKEN PLACE AFTER THE APPROVAL OF THE SUBGRADE.
11. INSTALL PROPOSED SITE IMPROVEMENTS.
12. WATER PUMPED FROM WORK AREAS SHOULD BE TREATED FOR SEDIMENT REMOVAL PRIOR TO DISCHARGING TO A "SURFACE WATER".
13. AS SOON AS SLOPES, CHANNEL DITCHES AND OTHER DISTURBED AREAS REACH FINAL GRADE, THEY MUST BE STABILIZED. CESSATION OF ACTIVITY FOR FOUR (4) DAYS OR LONGER REQUIRES TEMPORARY STABILIZATION.
14. TOPSOIL AND SEED GRASSED AREAS. INSTALL PLANTS AND TREES.
15. SWEEP PAVED AREAS DAILY TO PREVENT TRACKING OF SOIL OFF-SITE.
16. UPON COMPLETION OF ALL EARTH DISTURBANCE ACTIVITIES AND PERMANENT STABILIZATION OF ALL DISTURBED AREAS, THE OWNER AND/OR OPERATOR SHALL CONTACT INSPECTIONS COORDINATOR OF PWD (OFFICE: 215-685-6387) FOR A FINAL INSPECTION PRIOR TO REMOVAL ON THE E&S BMP'S.
17. REMOVE SOIL EROSION MEASURES AFTER SITE HAS BEEN INSPECTED AND STABILIZED.




MCPHERSON SQUARE  
LIBRARY  
601 E INDIANA AVE.  
PHILADELPHIA, PA 19134

ARCHITECTS  
SMP Architects  
1600 Walnut Street, 2nd Floor  
Philadelphia, PA 19103  
215 985 4410  
www.smparchitects.com

CIVIL ENGINEER:  
KS ENGINEERS  
530 Walnut Street, Suite 460  
Philadelphia, PA 19106  
215 616 3060

STRUCTURAL ENGINEER:  
Ann Rothmann  
100 E Lancaster Avenue, Suite 203  
Wayne, PA 19087  
610 688 2566

ROOFING CONSULTANT:  
Steve McLaughlin  
210 Garden Avenue  
Somersdale, NJ 08083  
856 287 2424

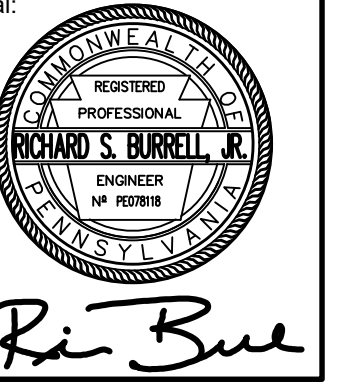


Date: 05/24/2024


Drawing Title:  
EROSION AND  
SEDIMENT  
CONTROL NOTES

Drawing No.:  
C6.2




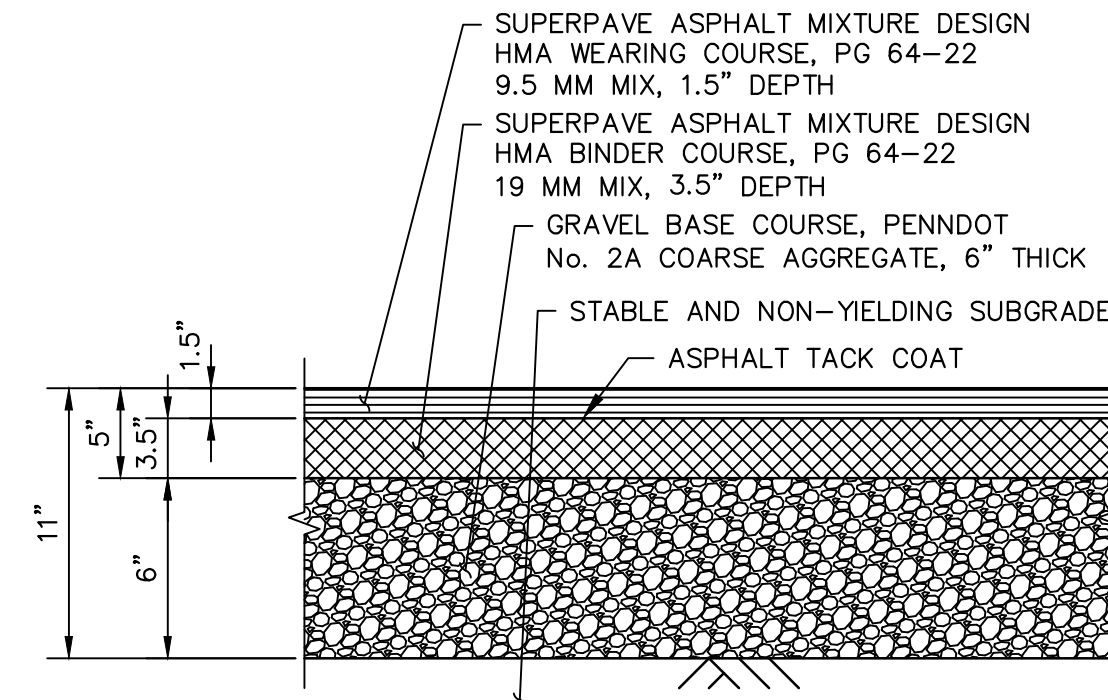

**FULL DEPTH ASPHALT PAVEMENT**  
SCALE: N.T.S.

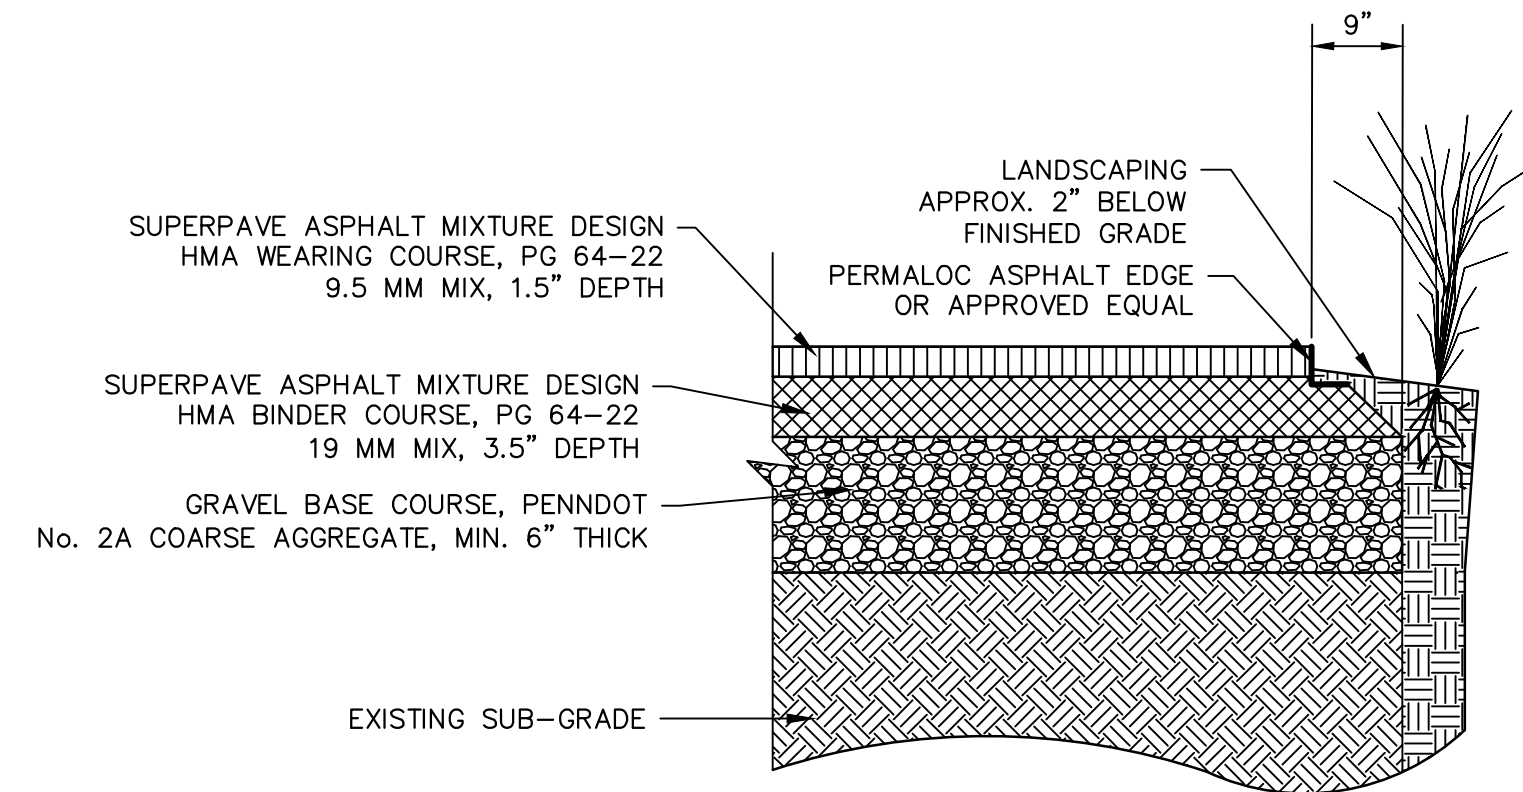


**FULL DEPTH PAVING AT LANDSCAPED EDGES**  
SCALE: N.T.S.

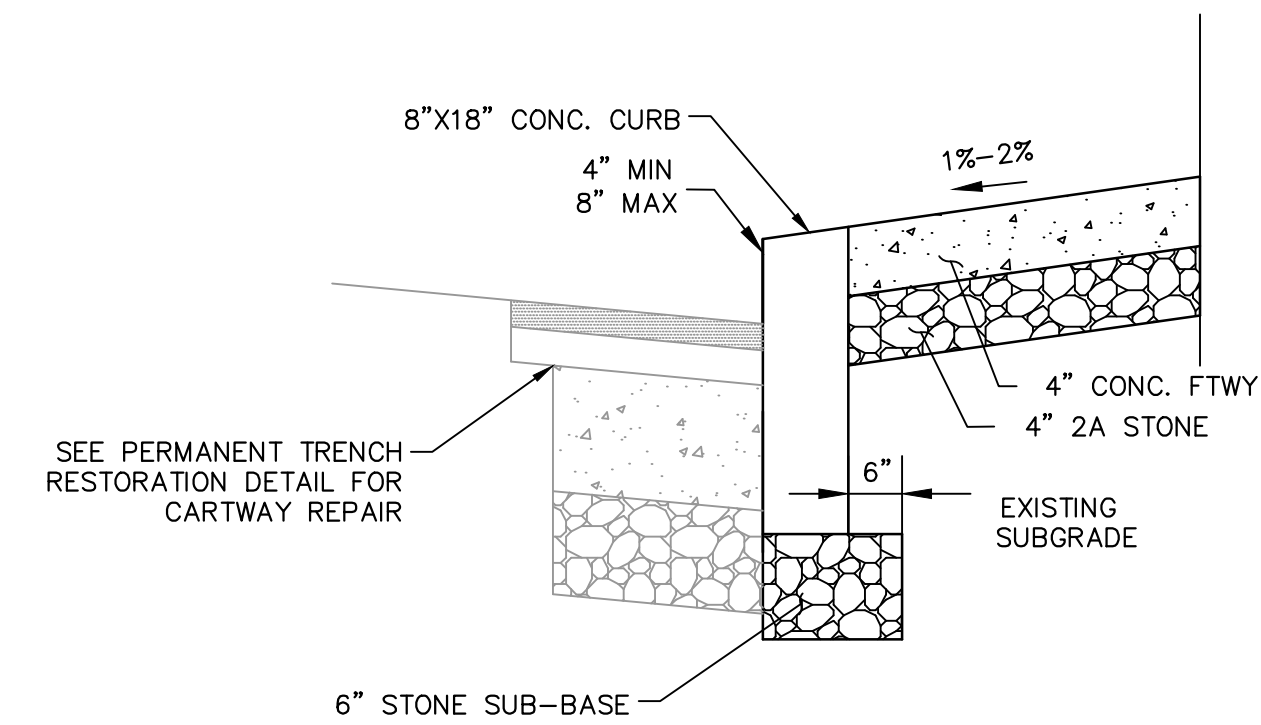


- NOTES:**
1. SAW-CUT EXISTING BITUMINOUS PAVING AT THE CARTWAY.
  2. REMOVE EXISTING CURB AND SIDEWALK TO BE REPLACED.
  3. REPLACE NEW CONCRETE CURB AND SIDEWALK.
  4. REPLACE SAW-CUT PORTION OF CARTWAY WITH NEW BITUMINOUS PAVEMENT.
  5. USE THIS DETAIL AT REPLACEMENT OF EXISTING SIDEWALKS AND CURBS.
  6. COMPLY WITH CITY OF PHILADELPHIA STANDARDS.

**CONCRETE CURB AND FOOTWAY DETAIL**  
SCALE: N.T.S.

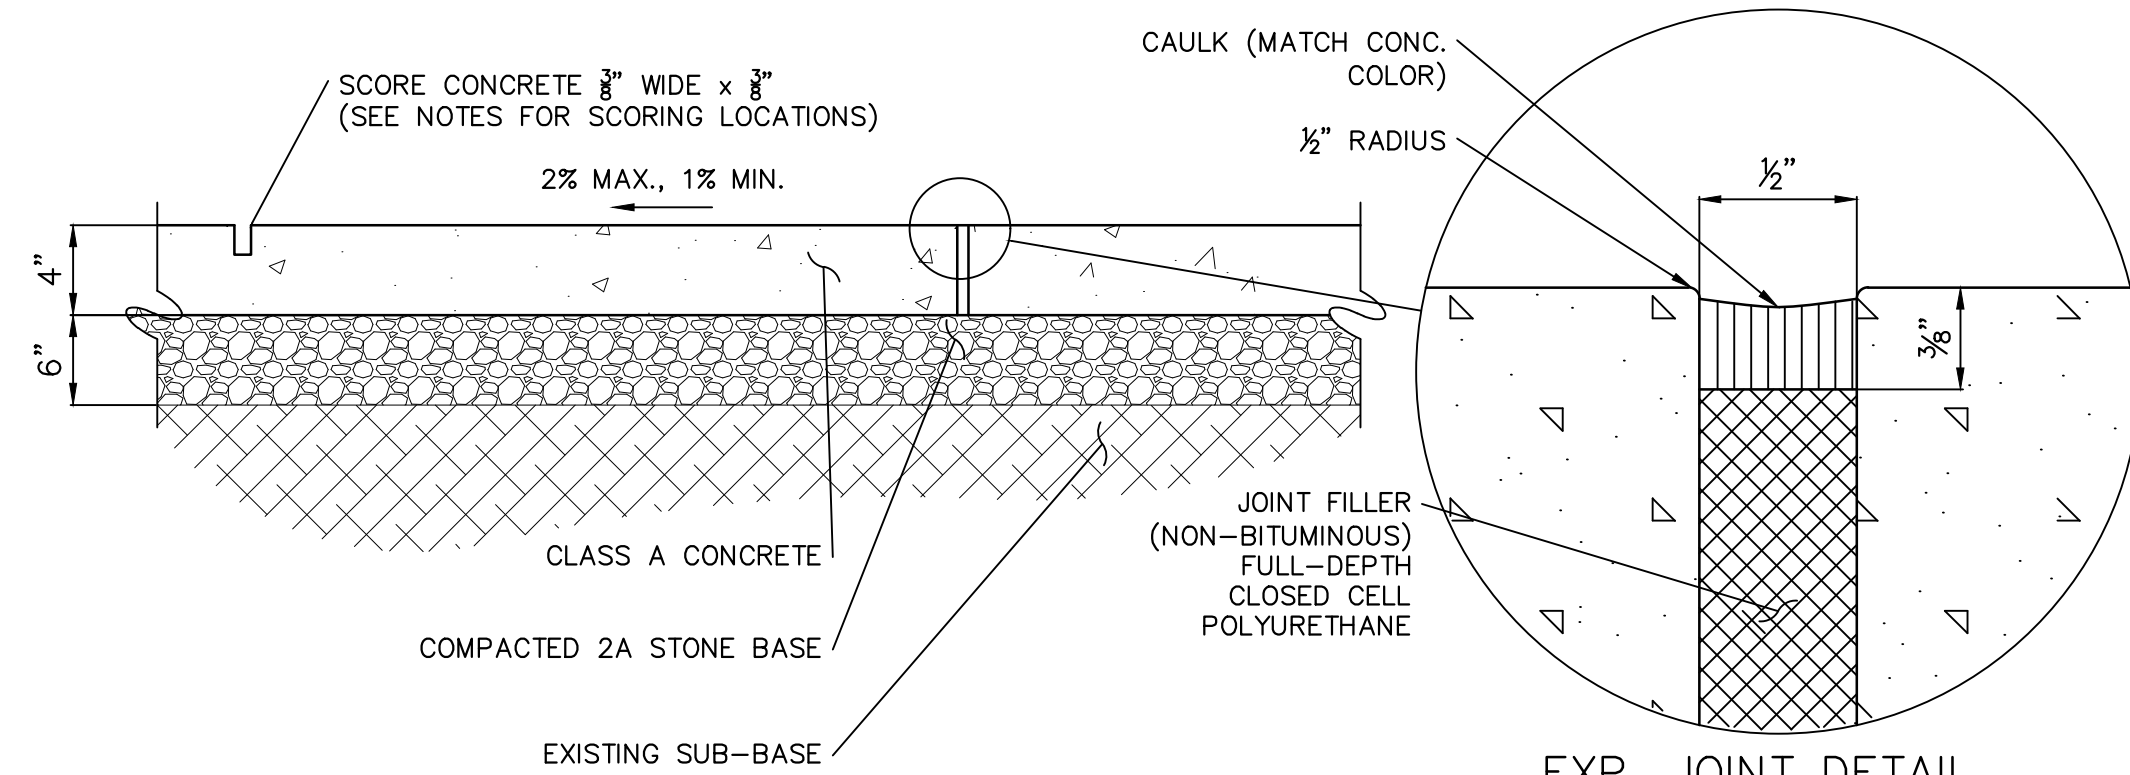


- NOTES:**
1. SPACE EXPANSION JOINTS 20' O.C. UNLESS SHOWN OTHERWISE ON PLANS.
  2. INSTALL EXPANSION JOINTS WHERE WALK ABUTS OTHER STRUCTURES.
  3. CONCRETE WALKWAY SHALL BE SCORED ON A 5' X 5' GRID, PERPENDICULAR TO THE CURBLINE.

**CONCRETE FOOTWAY DETAIL**  
SCALE: N.T.S.

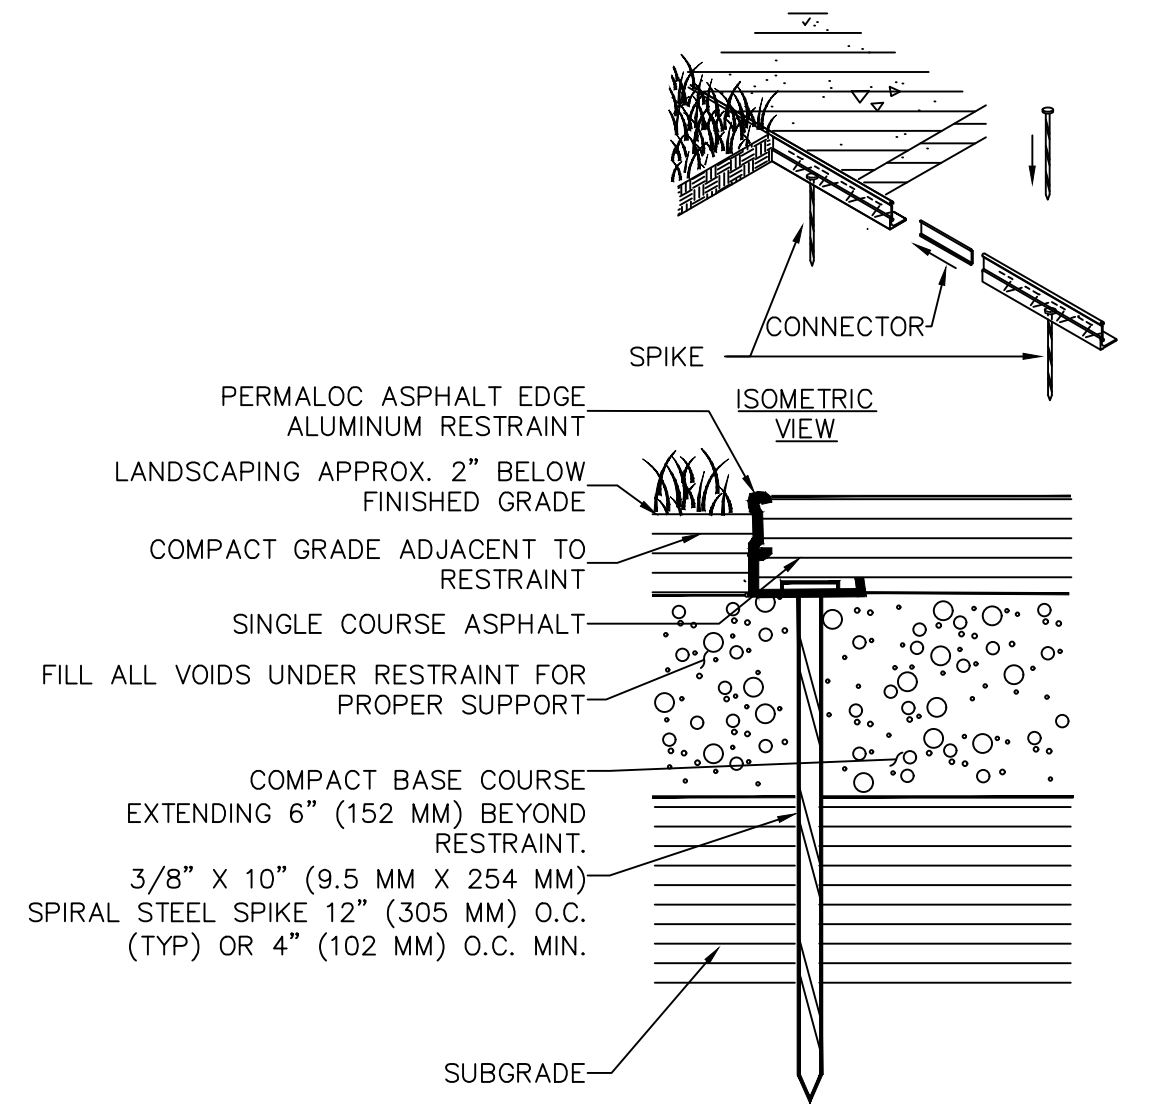

- NOTES:**
1. INSTALL PER MANUFACTURER'S "INSTALLATION GUIDELINES".
  2. 8'-0" (2.44 M) SECTIONS CONNECTED WITH 4" (102 MM) SLIDING CONNECTOR.
  3. MAINTAIN 3/8" (9.5 MM) GAP BETWEEN SECTIONS TO ALLOW FOR PRODUCT EXPANSION IN EXTREME TEMPERATURES.
  4. CORNERS: NOTCH BASE ONLY AND FORM A CONTINUOUS CORNER.

**ASPHALT EDGING DETAIL**  
SCALE: N.T.S.

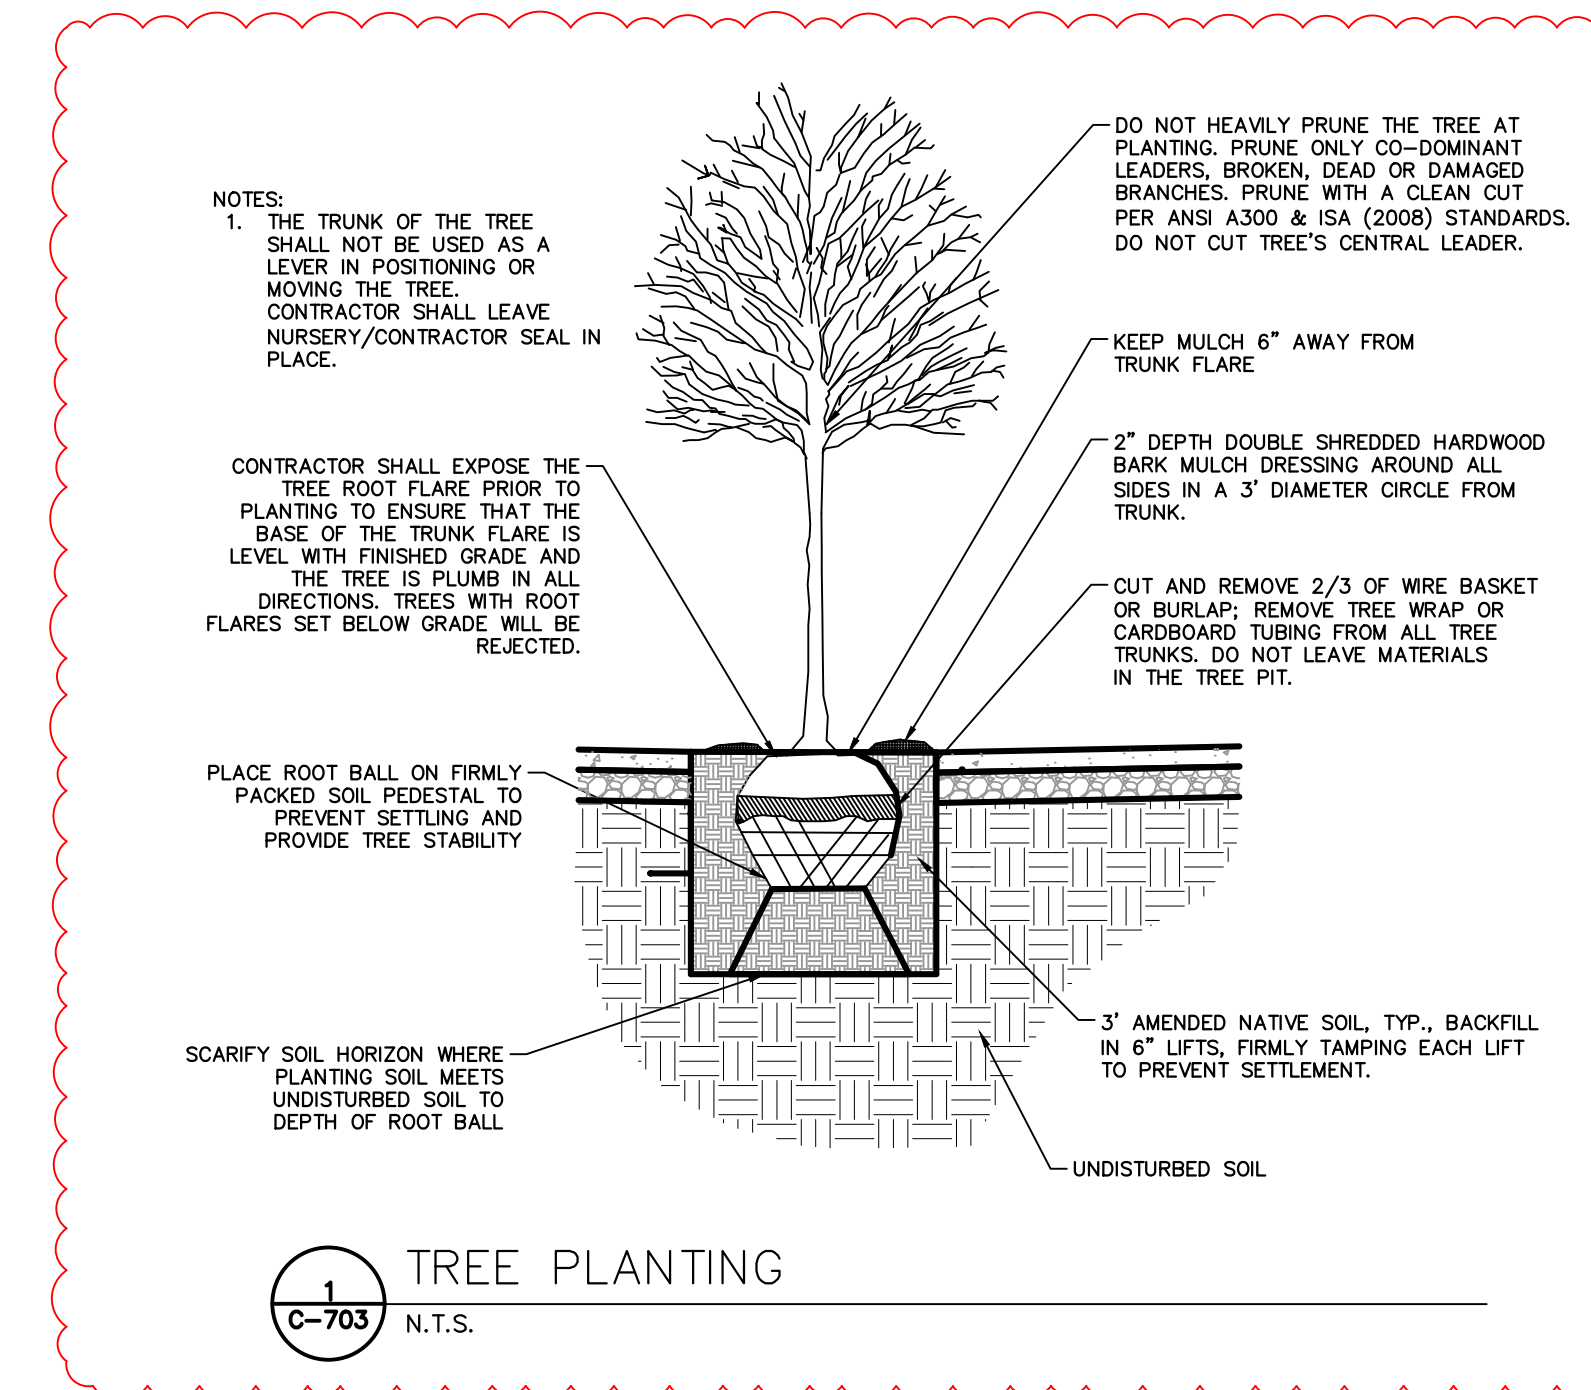

- NOTES:**
1. THE TRUNK OF THE TREE SHALL NOT BE USED AS A LEVER IN POSITIONING OR MOVING THE TREE. CONTRACTOR SHALL LEAVE NURSERY/CONTRACTOR SEAL IN PLACE.


CONTRACTOR SHALL EXPOSE THE TREE ROOT FLARE PRIOR TO PLANTING TO ENSURE THAT THE BASE OF THE TRUNK FLARE IS LEVEL WITH FINISHED GRADE AND THE TREE IS PLUMB IN ALL DIRECTIONS. TREES WITH ROOT FLARES SET BELOW GRADE WILL BE REJECTED.

PLACE ROOT BALL ON FIRMLY PACKED SOIL PEDESTAL TO PREVENT SETTLING AND PROVIDE TREE STABILITY


SCARIFY SOIL HORIZON WHERE PLANTING SOIL MEETS UNDISTURBED SOIL TO DEPTH OF ROOT BALL

**TREE PLANTING**  
SCALE: N.T.S.





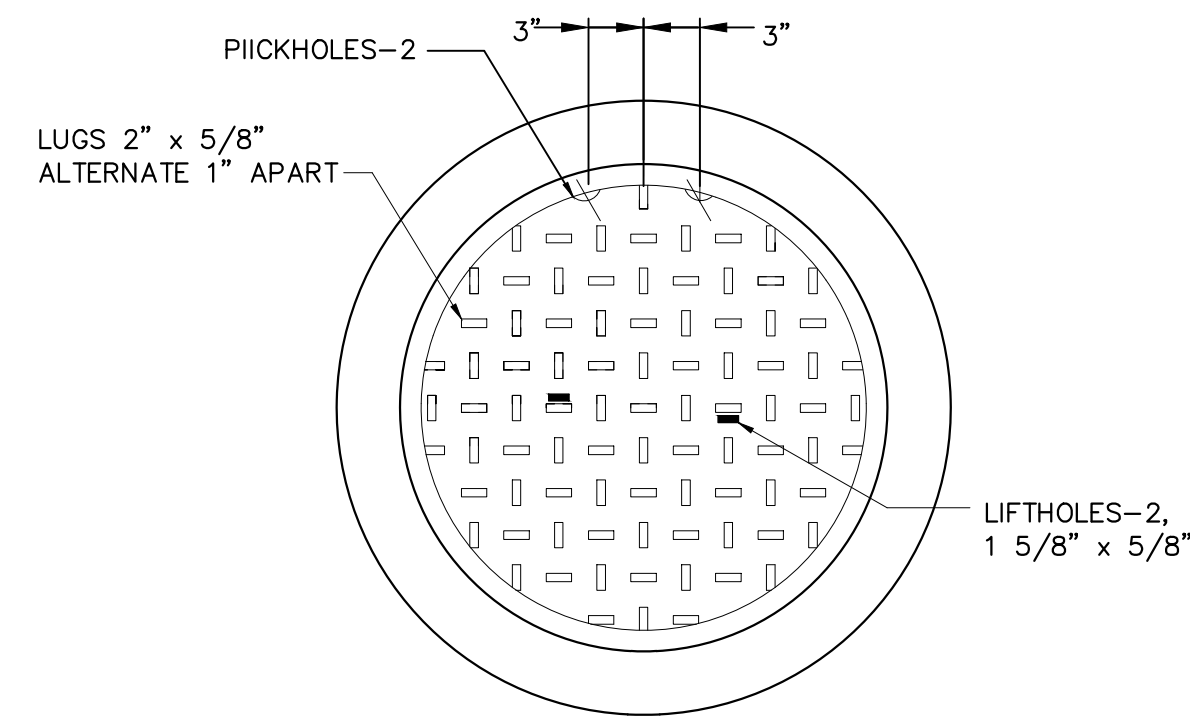


**GRAY MANHOLE FRAME AND COVER**  
SCALE: N.T.S.

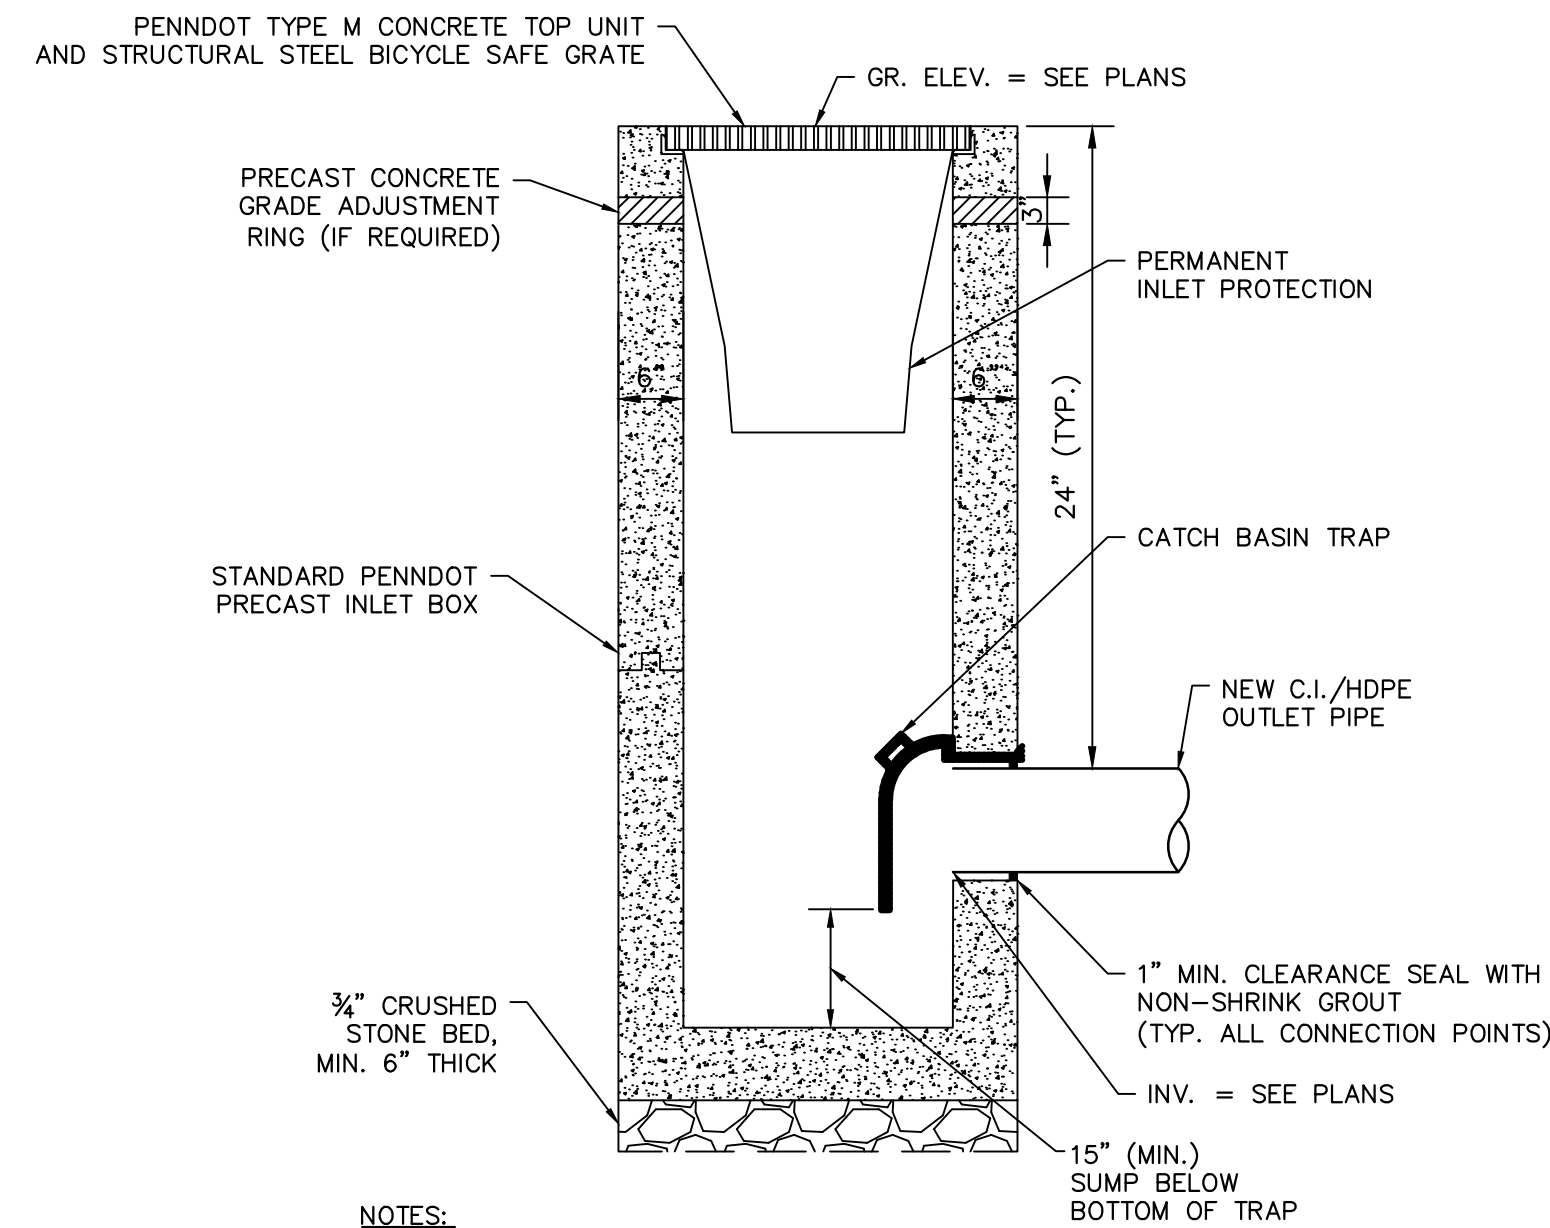


- NOTES:**
1. COMPLY WITH PENNDOT STANDARDS.
  2. USE PRECAST PENNDOT INLET BOX WITH 3'-9 1/2" x 2' INTERIOR DIMENSIONS AND 6" THICK WALLS.
  3. SEAL INLET TRAP WITH NON-SHRINK, NON-METALLIC MORTAR. APPLY BITUMIN-TYPE SEALING COMPOUND TO JOINT.
  4. PROPOSED INLET TRAP MUST BE AIR TIGHT.
  5. USE PENNDOT STANDARD INLET BOX OR APPROVED EQUAL.

**HIGHWAY GRATE INLET**  
SCALE: N.T.S.

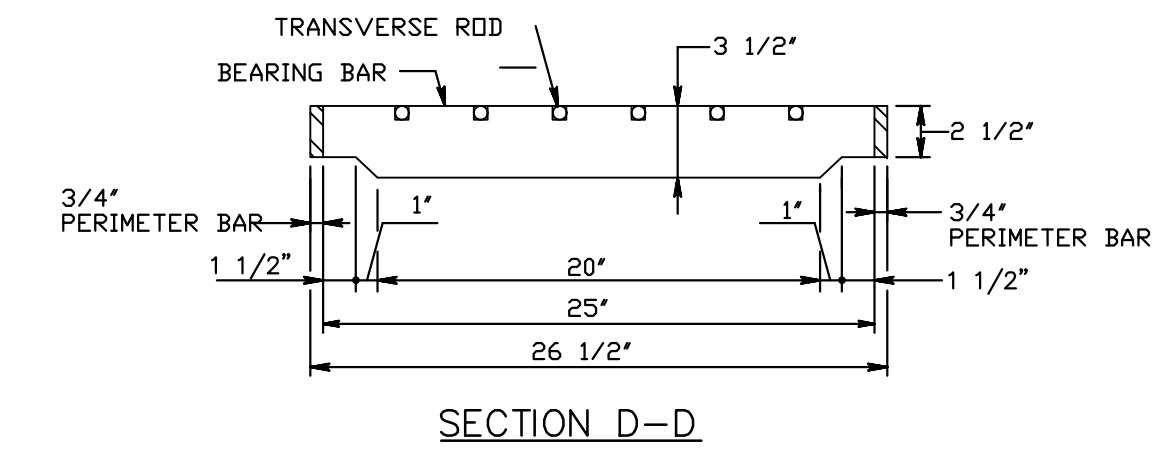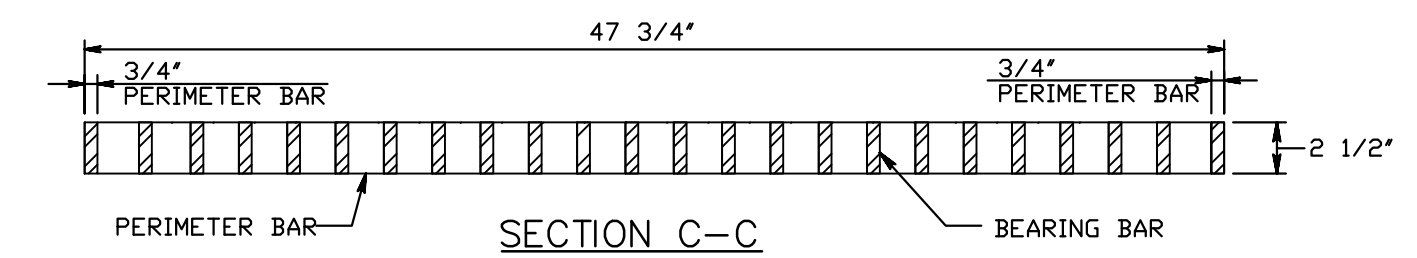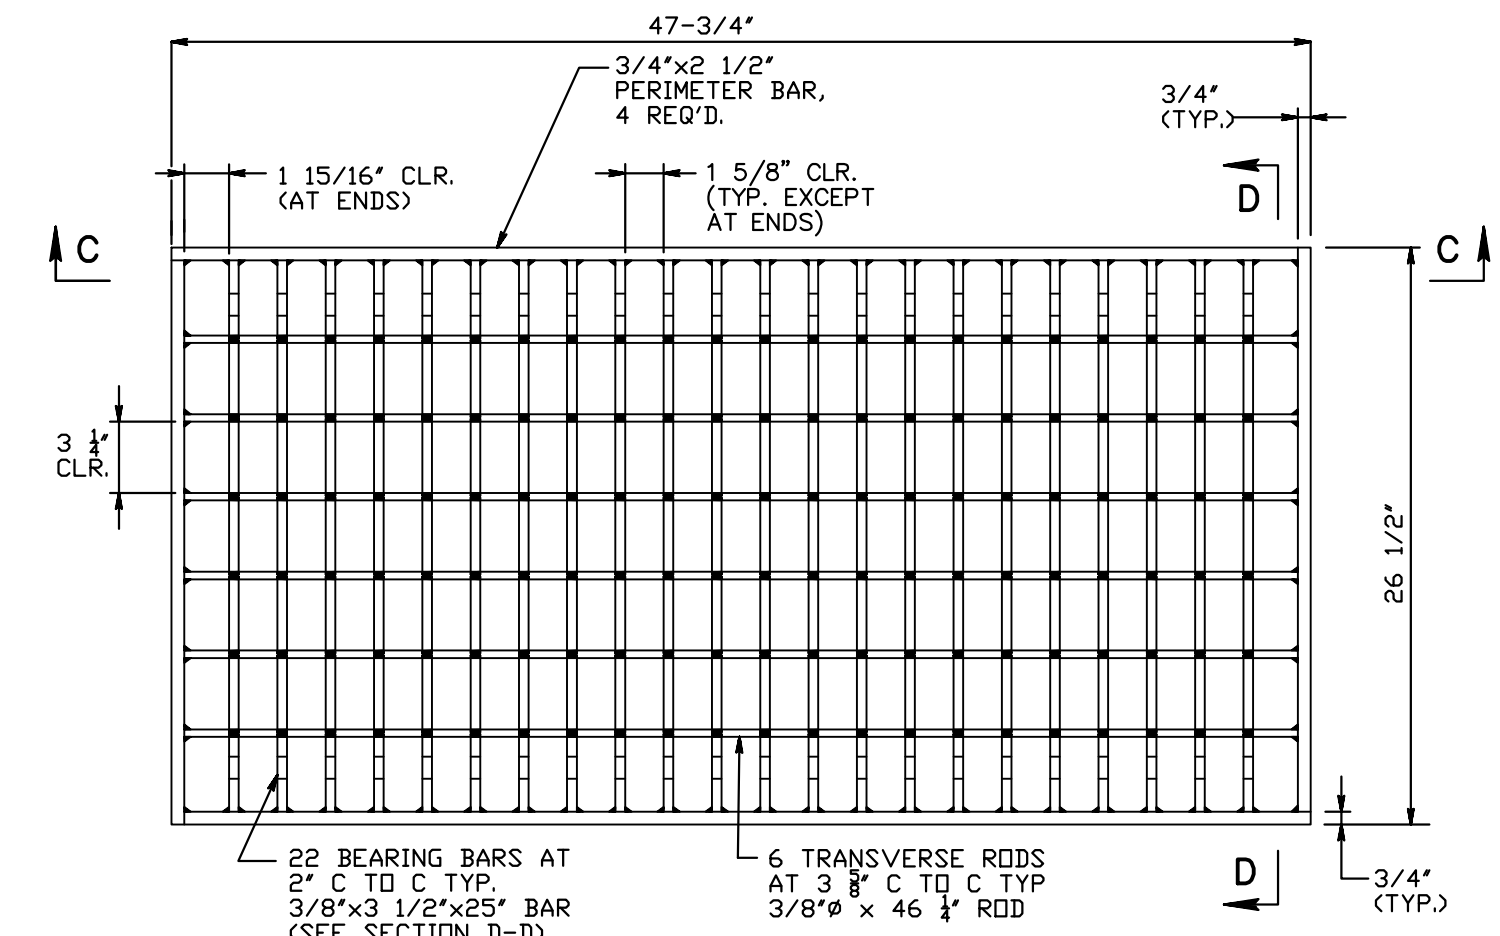


**STRUCTURAL STEEL BICYCLE SAFE GRATE**  
SCALE: N.T.S.

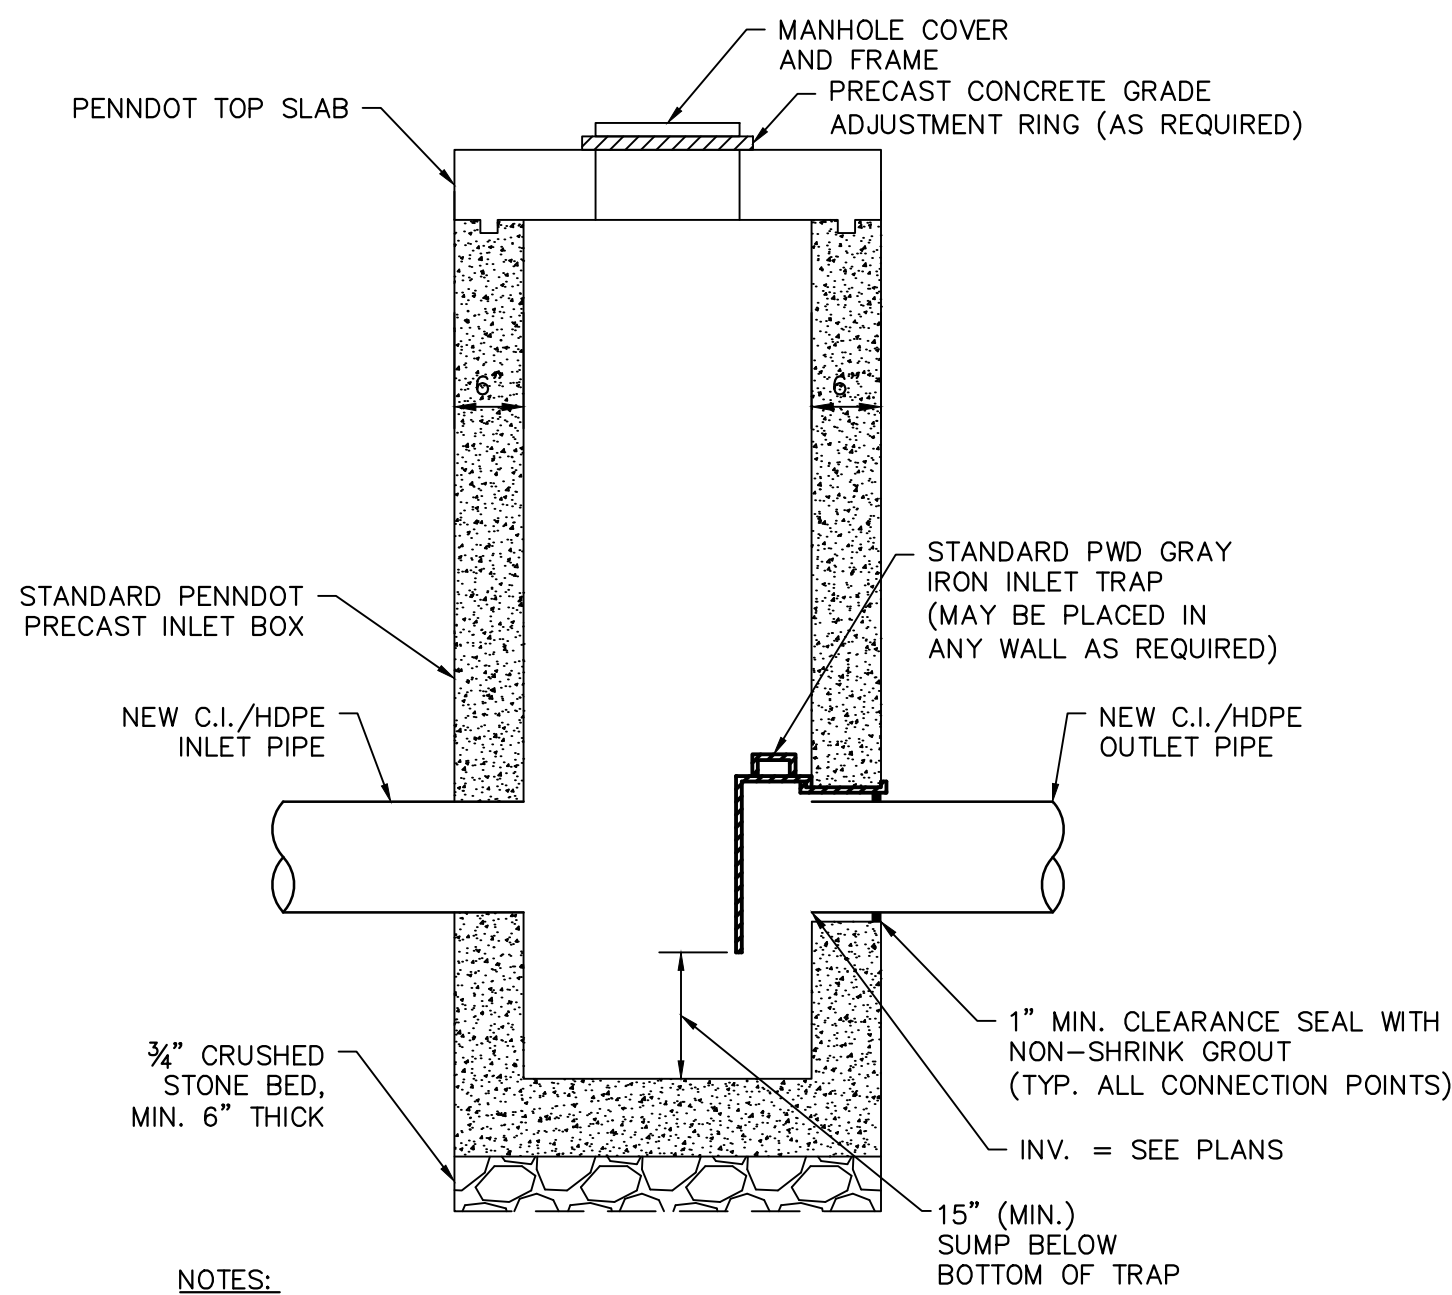

- NOTES:**
1. COMPLY WITH PENNDOT STANDARDS.
  2. USE PRECAST PENNDOT INLET BOX WITH 3'-9 1/2" x 2' INTERIOR DIMENSIONS AND 6" THICK WALLS.
  3. SEAL INLET TRAP WITH NON-SHRINK, NON-METALLIC MORTAR. APPLY BITUMIN-TYPE SEALING COMPOUND TO JOINT.
  4. PROPOSED INLET TRAP MUST BE AIR TIGHT.
  5. USE PENNDOT STANDARD INLET BOX OR APPROVED EQUAL.

**STANDARD MANHOLE**  
SCALE: N.T.S.

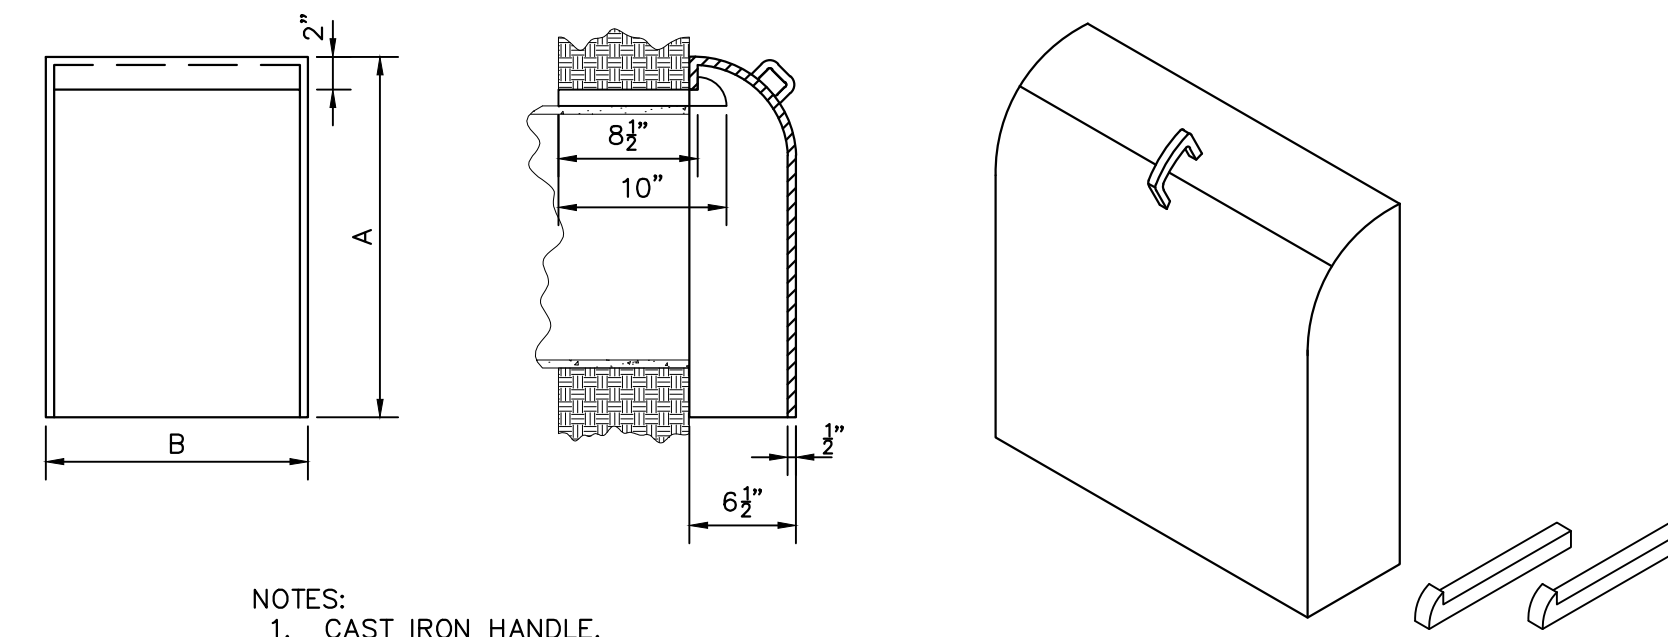


- NOTES:**
1. CAST IRON HANDLE.
  2. LOCATE BOTTOM OF TRAP MINIMUM 6" BELOW FLOW LINE.
  3. INSTALL ON FLAT WALL ONLY.


R-3701 CATCH BASIN TRAP - ALL DIMENSIONS IN INCHES				
CATALOG NO.	A (IN)	B (IN)	PIPE SIZE (IN)	SETTING METHOD
R-3701-6	16	12	UP TO 6	ON 2 HOOKS
R-3701-8	18	12	8	ON 2 HOOKS
R-3701-10	20	12	10	ON 2 HOOKS
R-3701-12	22	16	12	ON 2 HOOKS
R-3701-15	25	19	15	ON 2 HOOKS
R-3701-18	28	22	18	ON 2 HOOKS

**STANDARD INLET TRAP**  
SCALE: N.T.S.




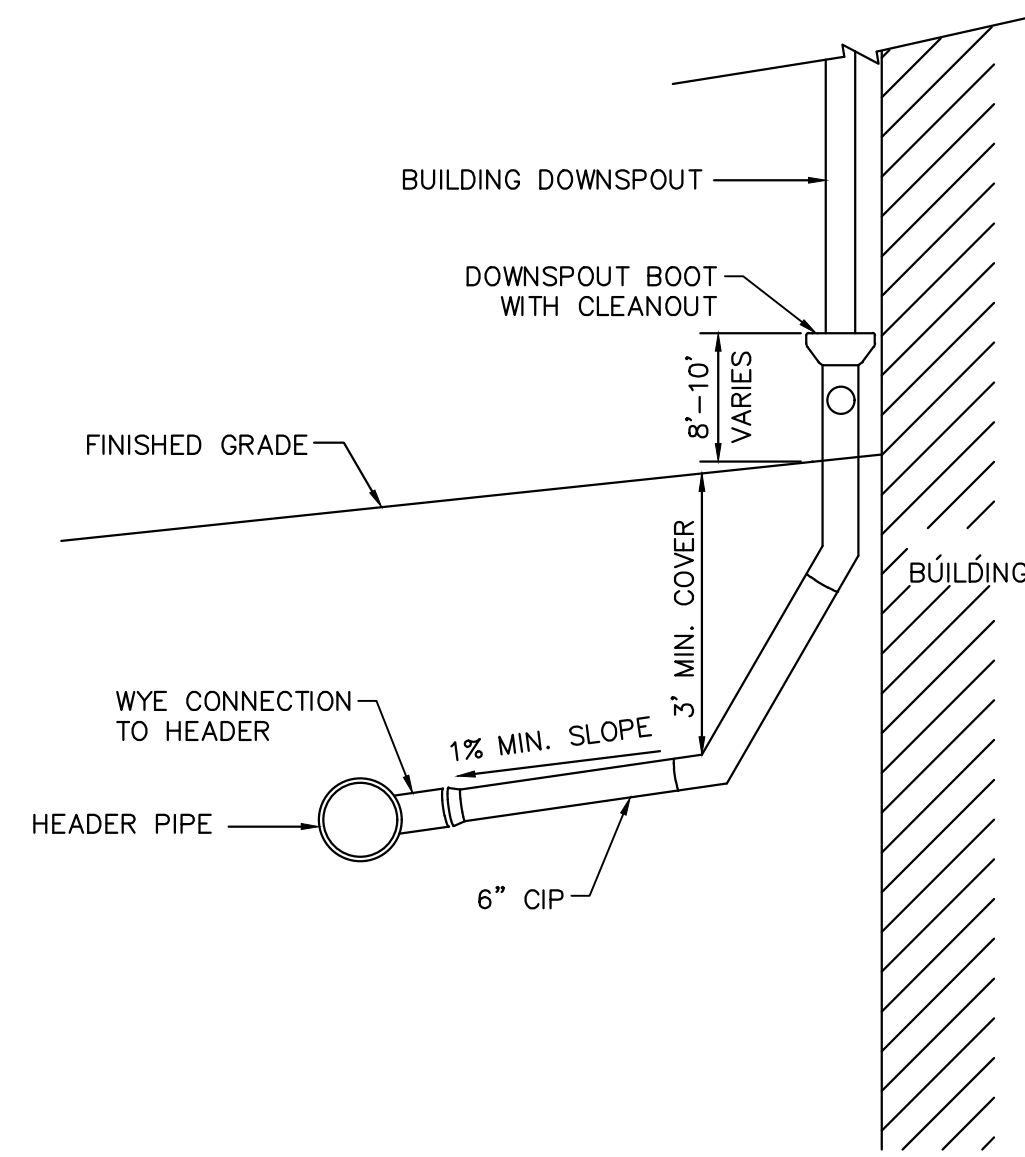


**DOWNSPOUT LATERAL CONNECTION**  
SCALE: N.T.S.

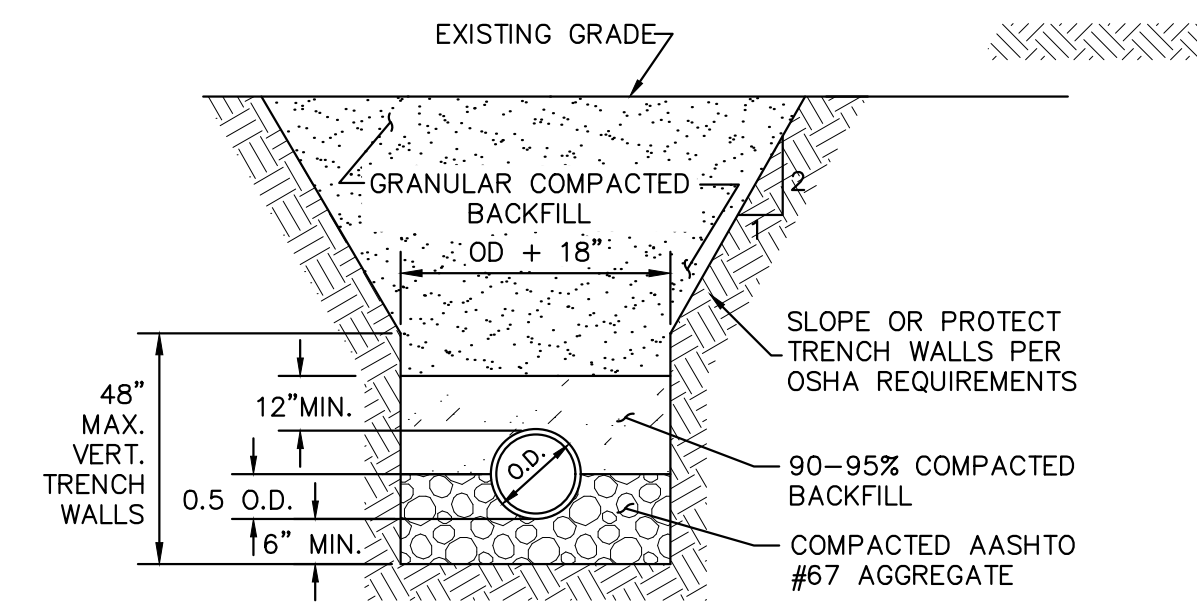

**TRENCH RESTORATION (IN GRASS)**  
SCALE: N.T.S.

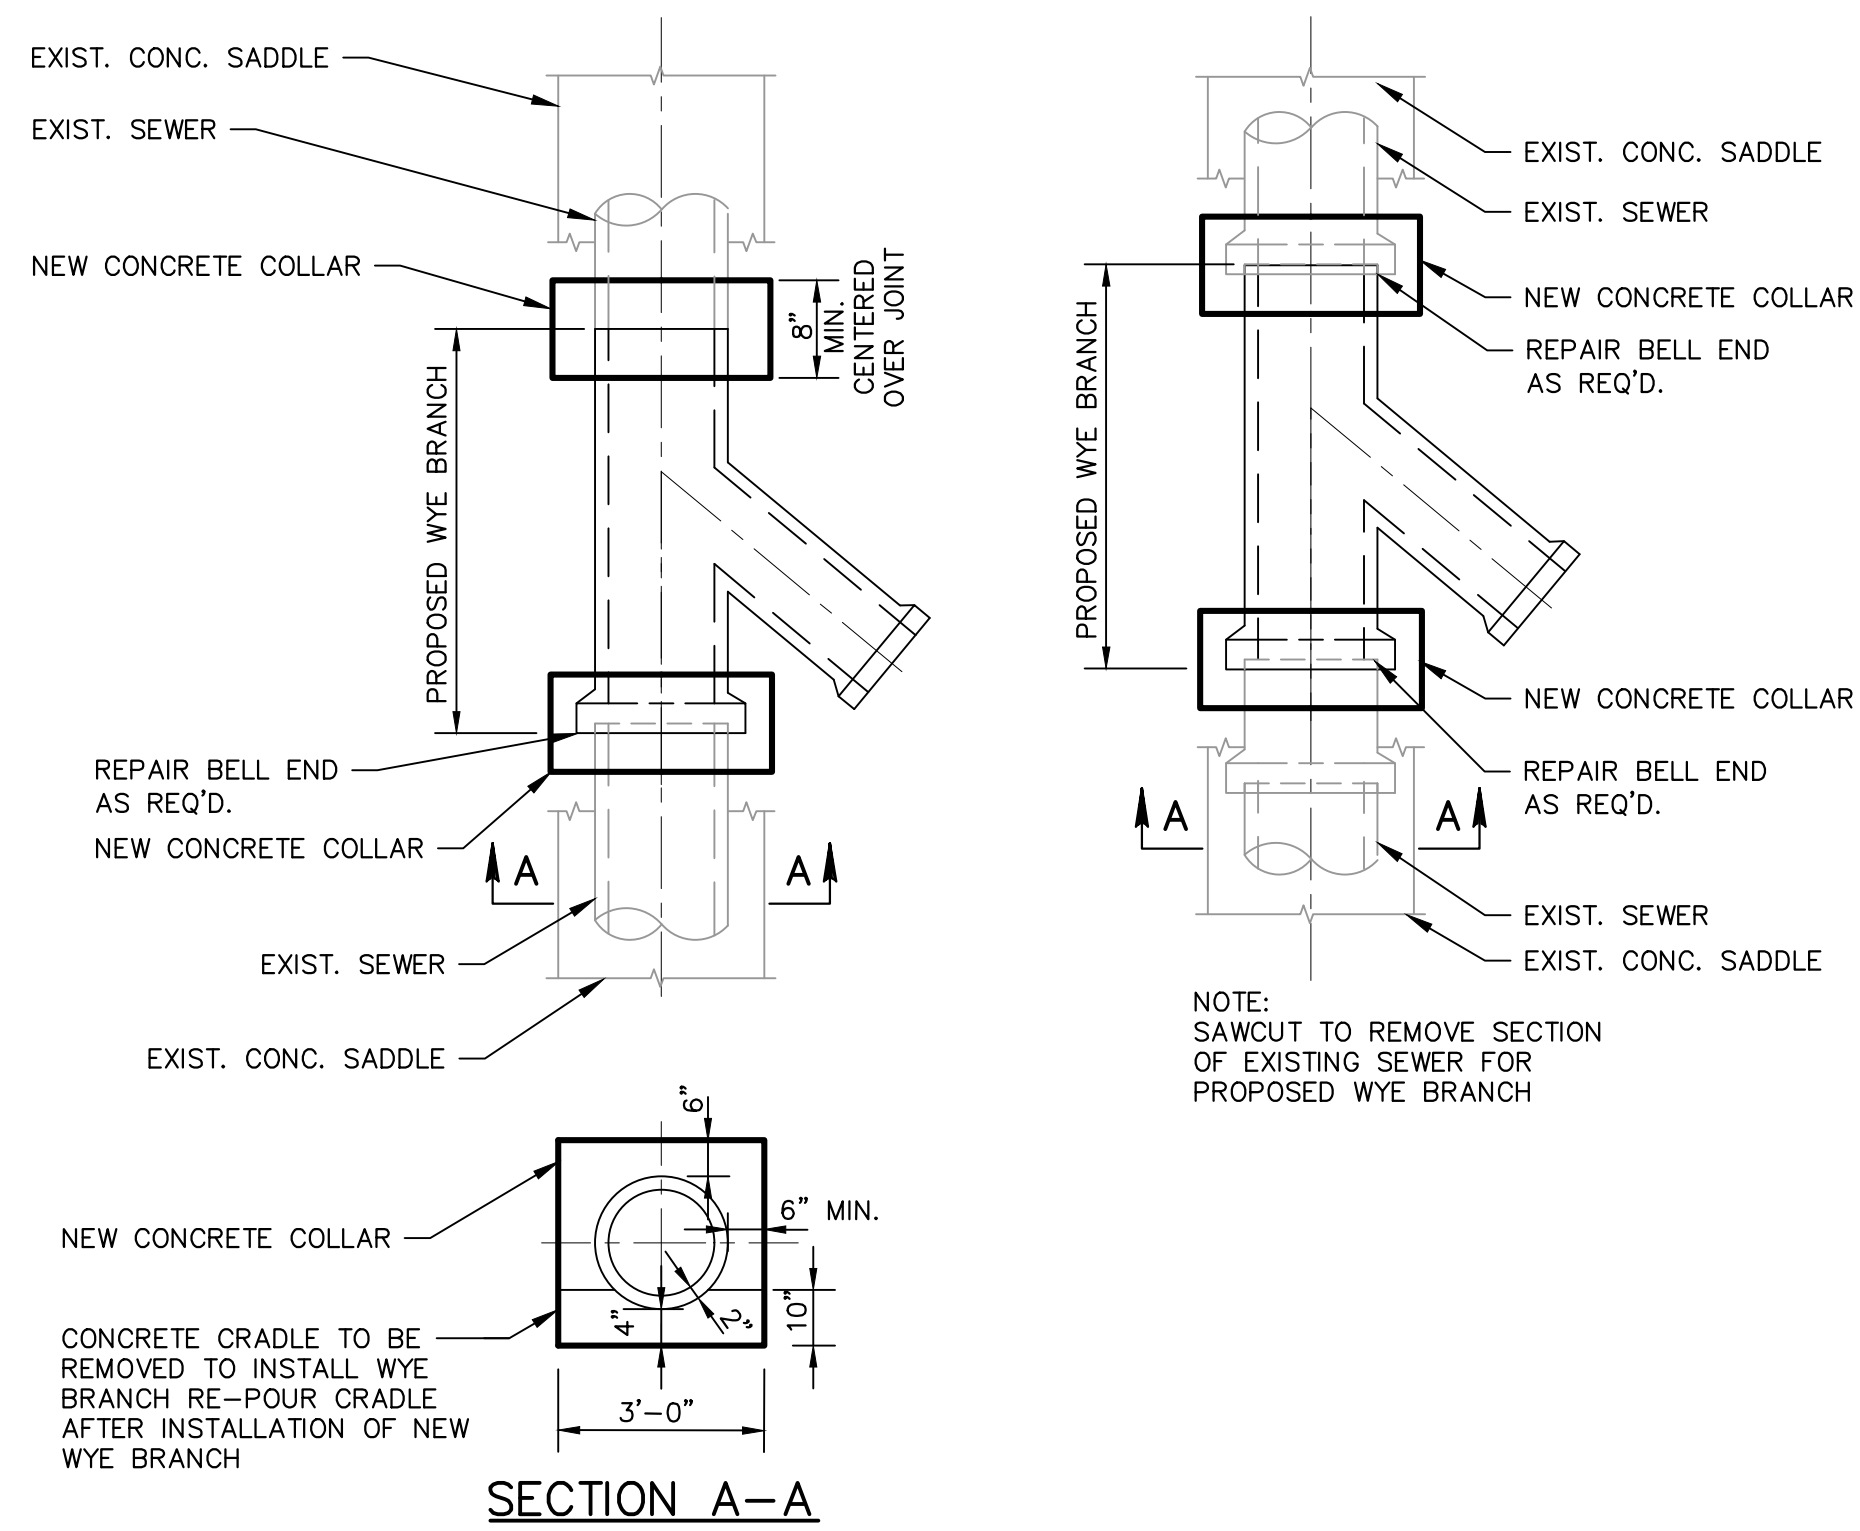

**PREFABRICATED WYE BRANCH DETAIL**  
SCALE: N.T.S.

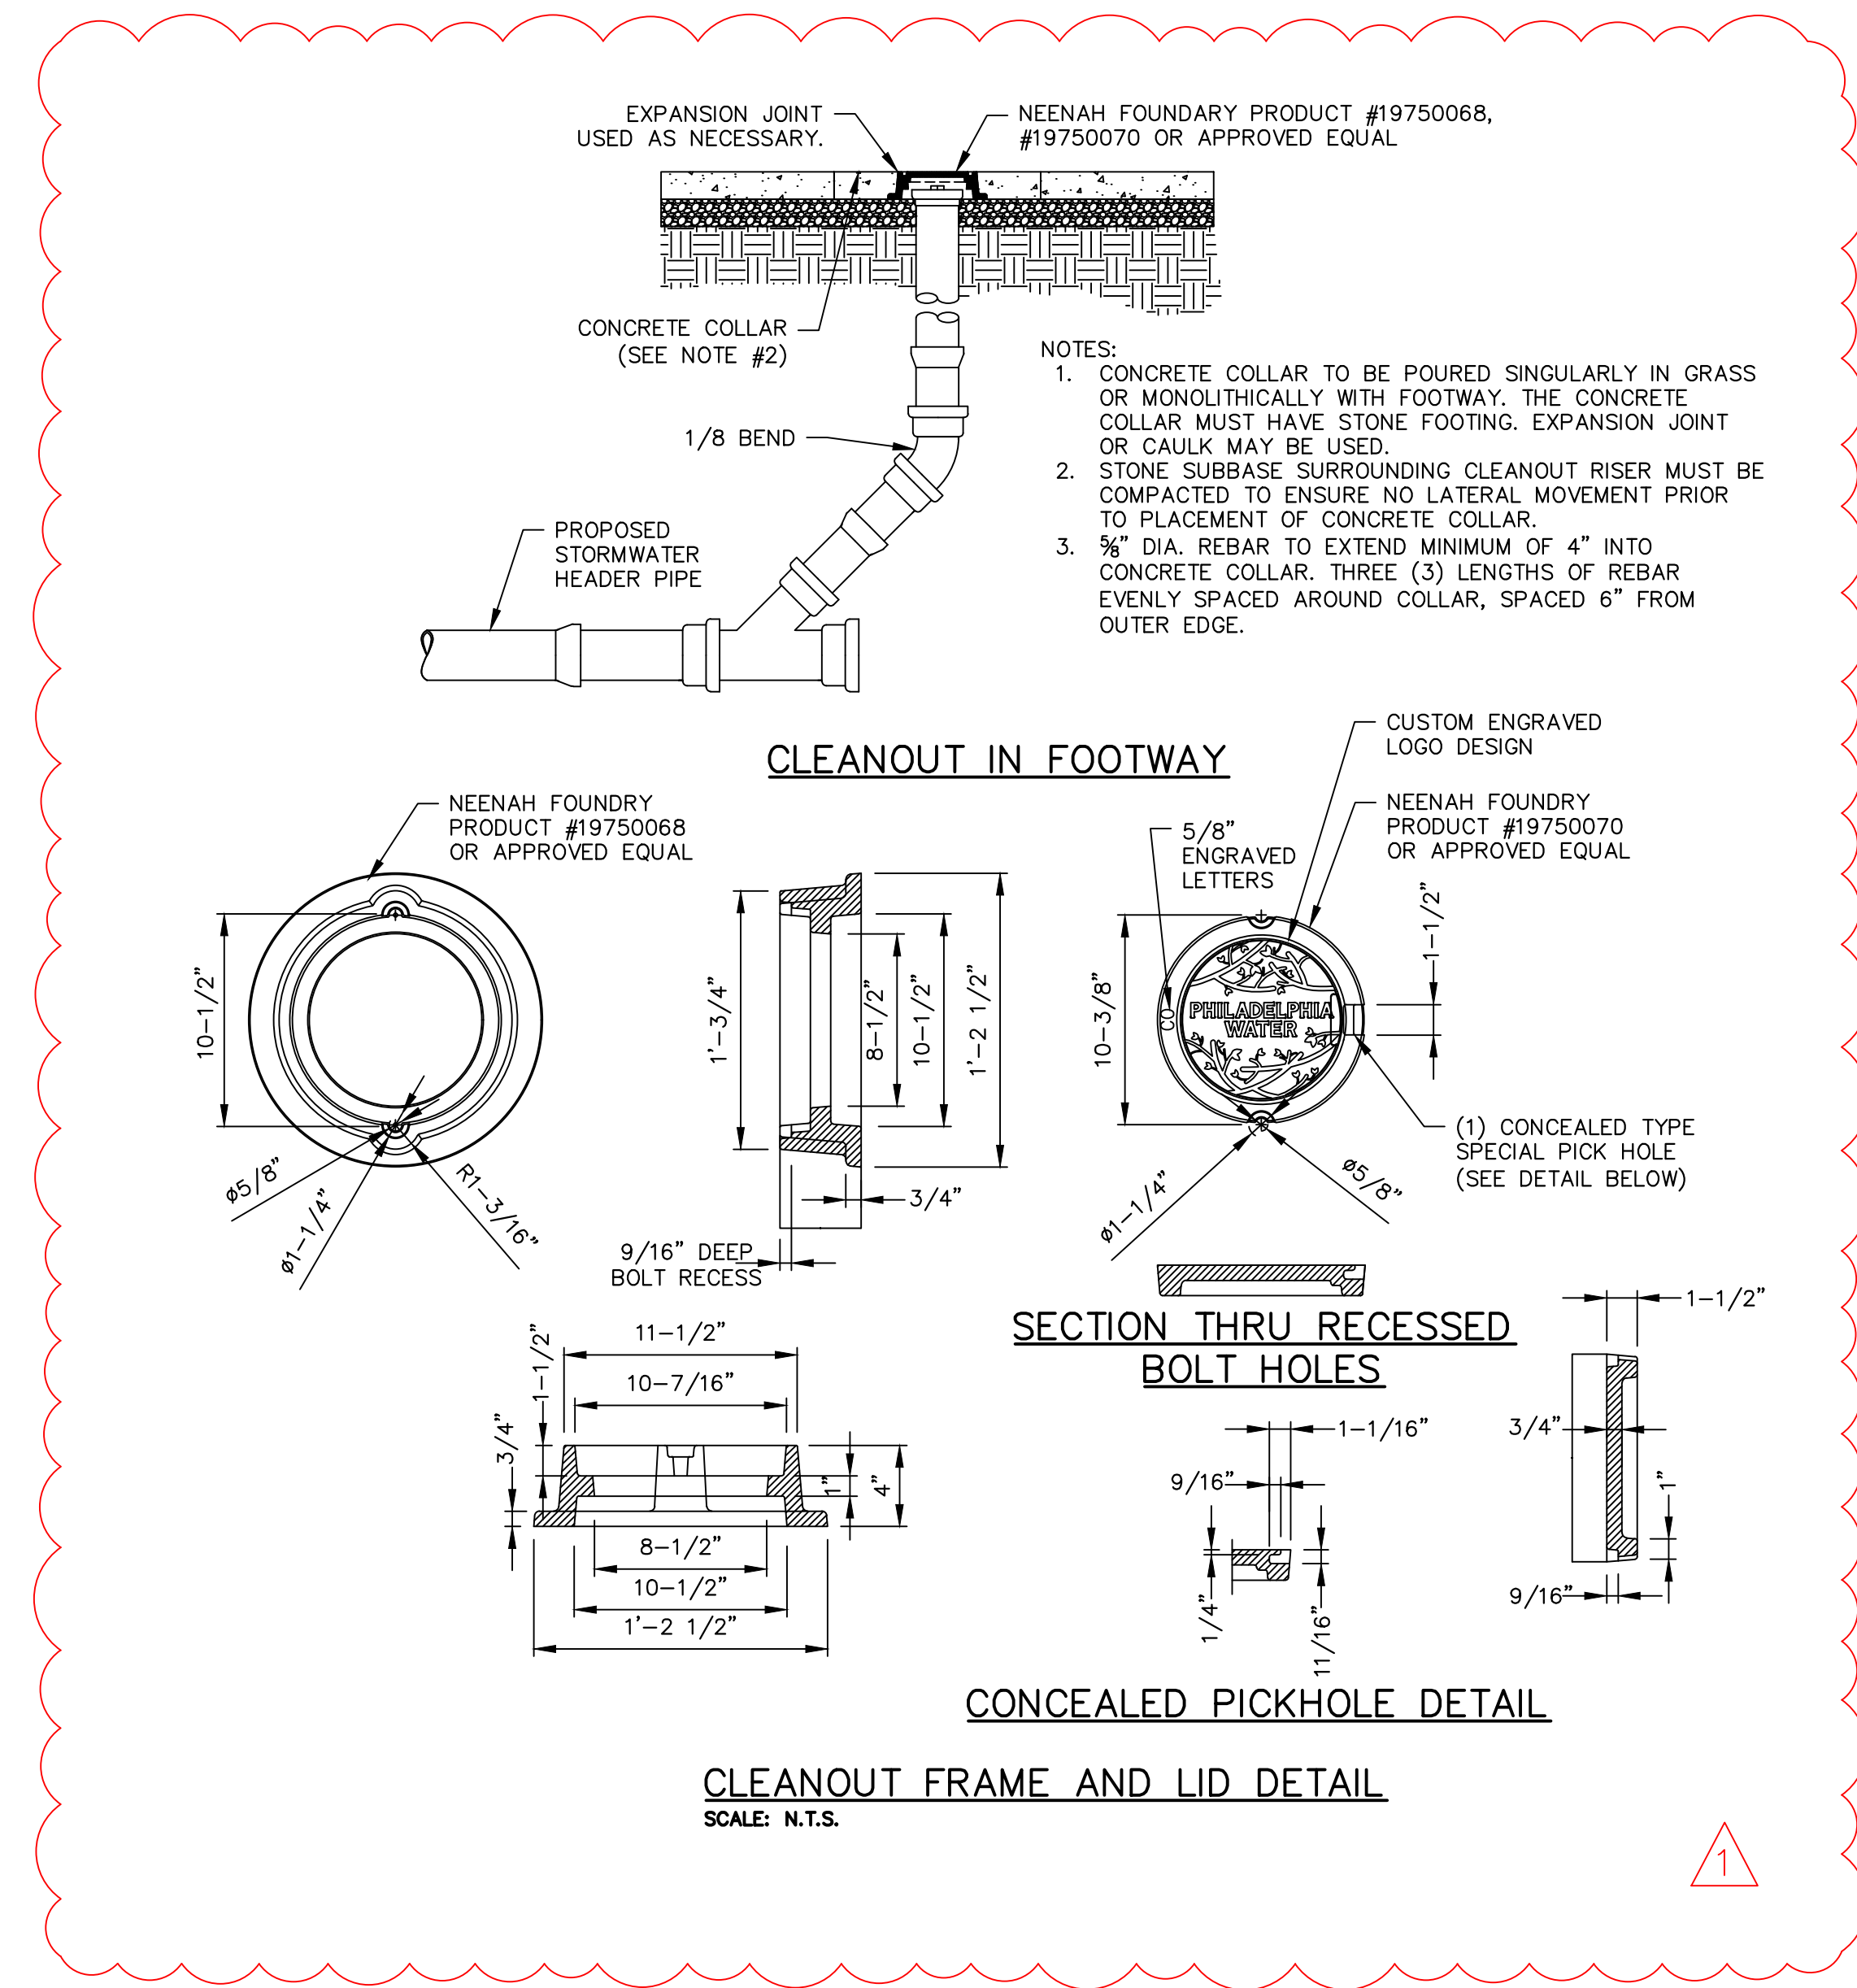

**CLEANOUT FRAME AND LID DETAIL**  
SCALE: N.T.S.




MCPHERSON SQUARE LIBRARY  
601 E INDIANA AVE.  
PHILADELPHIA, PA 19134

**ARCHITECTS:**  
SMP Architects  
1600 Walnut Street, 2nd Floor  
Philadelphia, PA 19103  
215 955 4410  
www.smparchitects.com

**CIVIL ENGINEER:**  
KS ENGINEERS  
530 Walnut Street, Suite 460  
Philadelphia, PA 19106  
215 616 3060

**STRUCTURAL ENGINEER:**  
Ann Rothmann  
100 E Lancaster Avenue, Suite 203  
Wayne, PA 19087  
610 688 2566

**ROOFING CONSULTANT:**  
Steve McLaughlin  
210 Garden Avenue  
Somersdale, NJ 08083  
856 287 2424

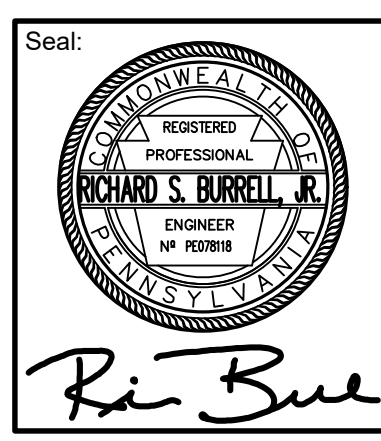


Date: 05/24/2024


Drawing Title:  
**UTILITY DETAILS**

Drawing No.:  
**C8.1**




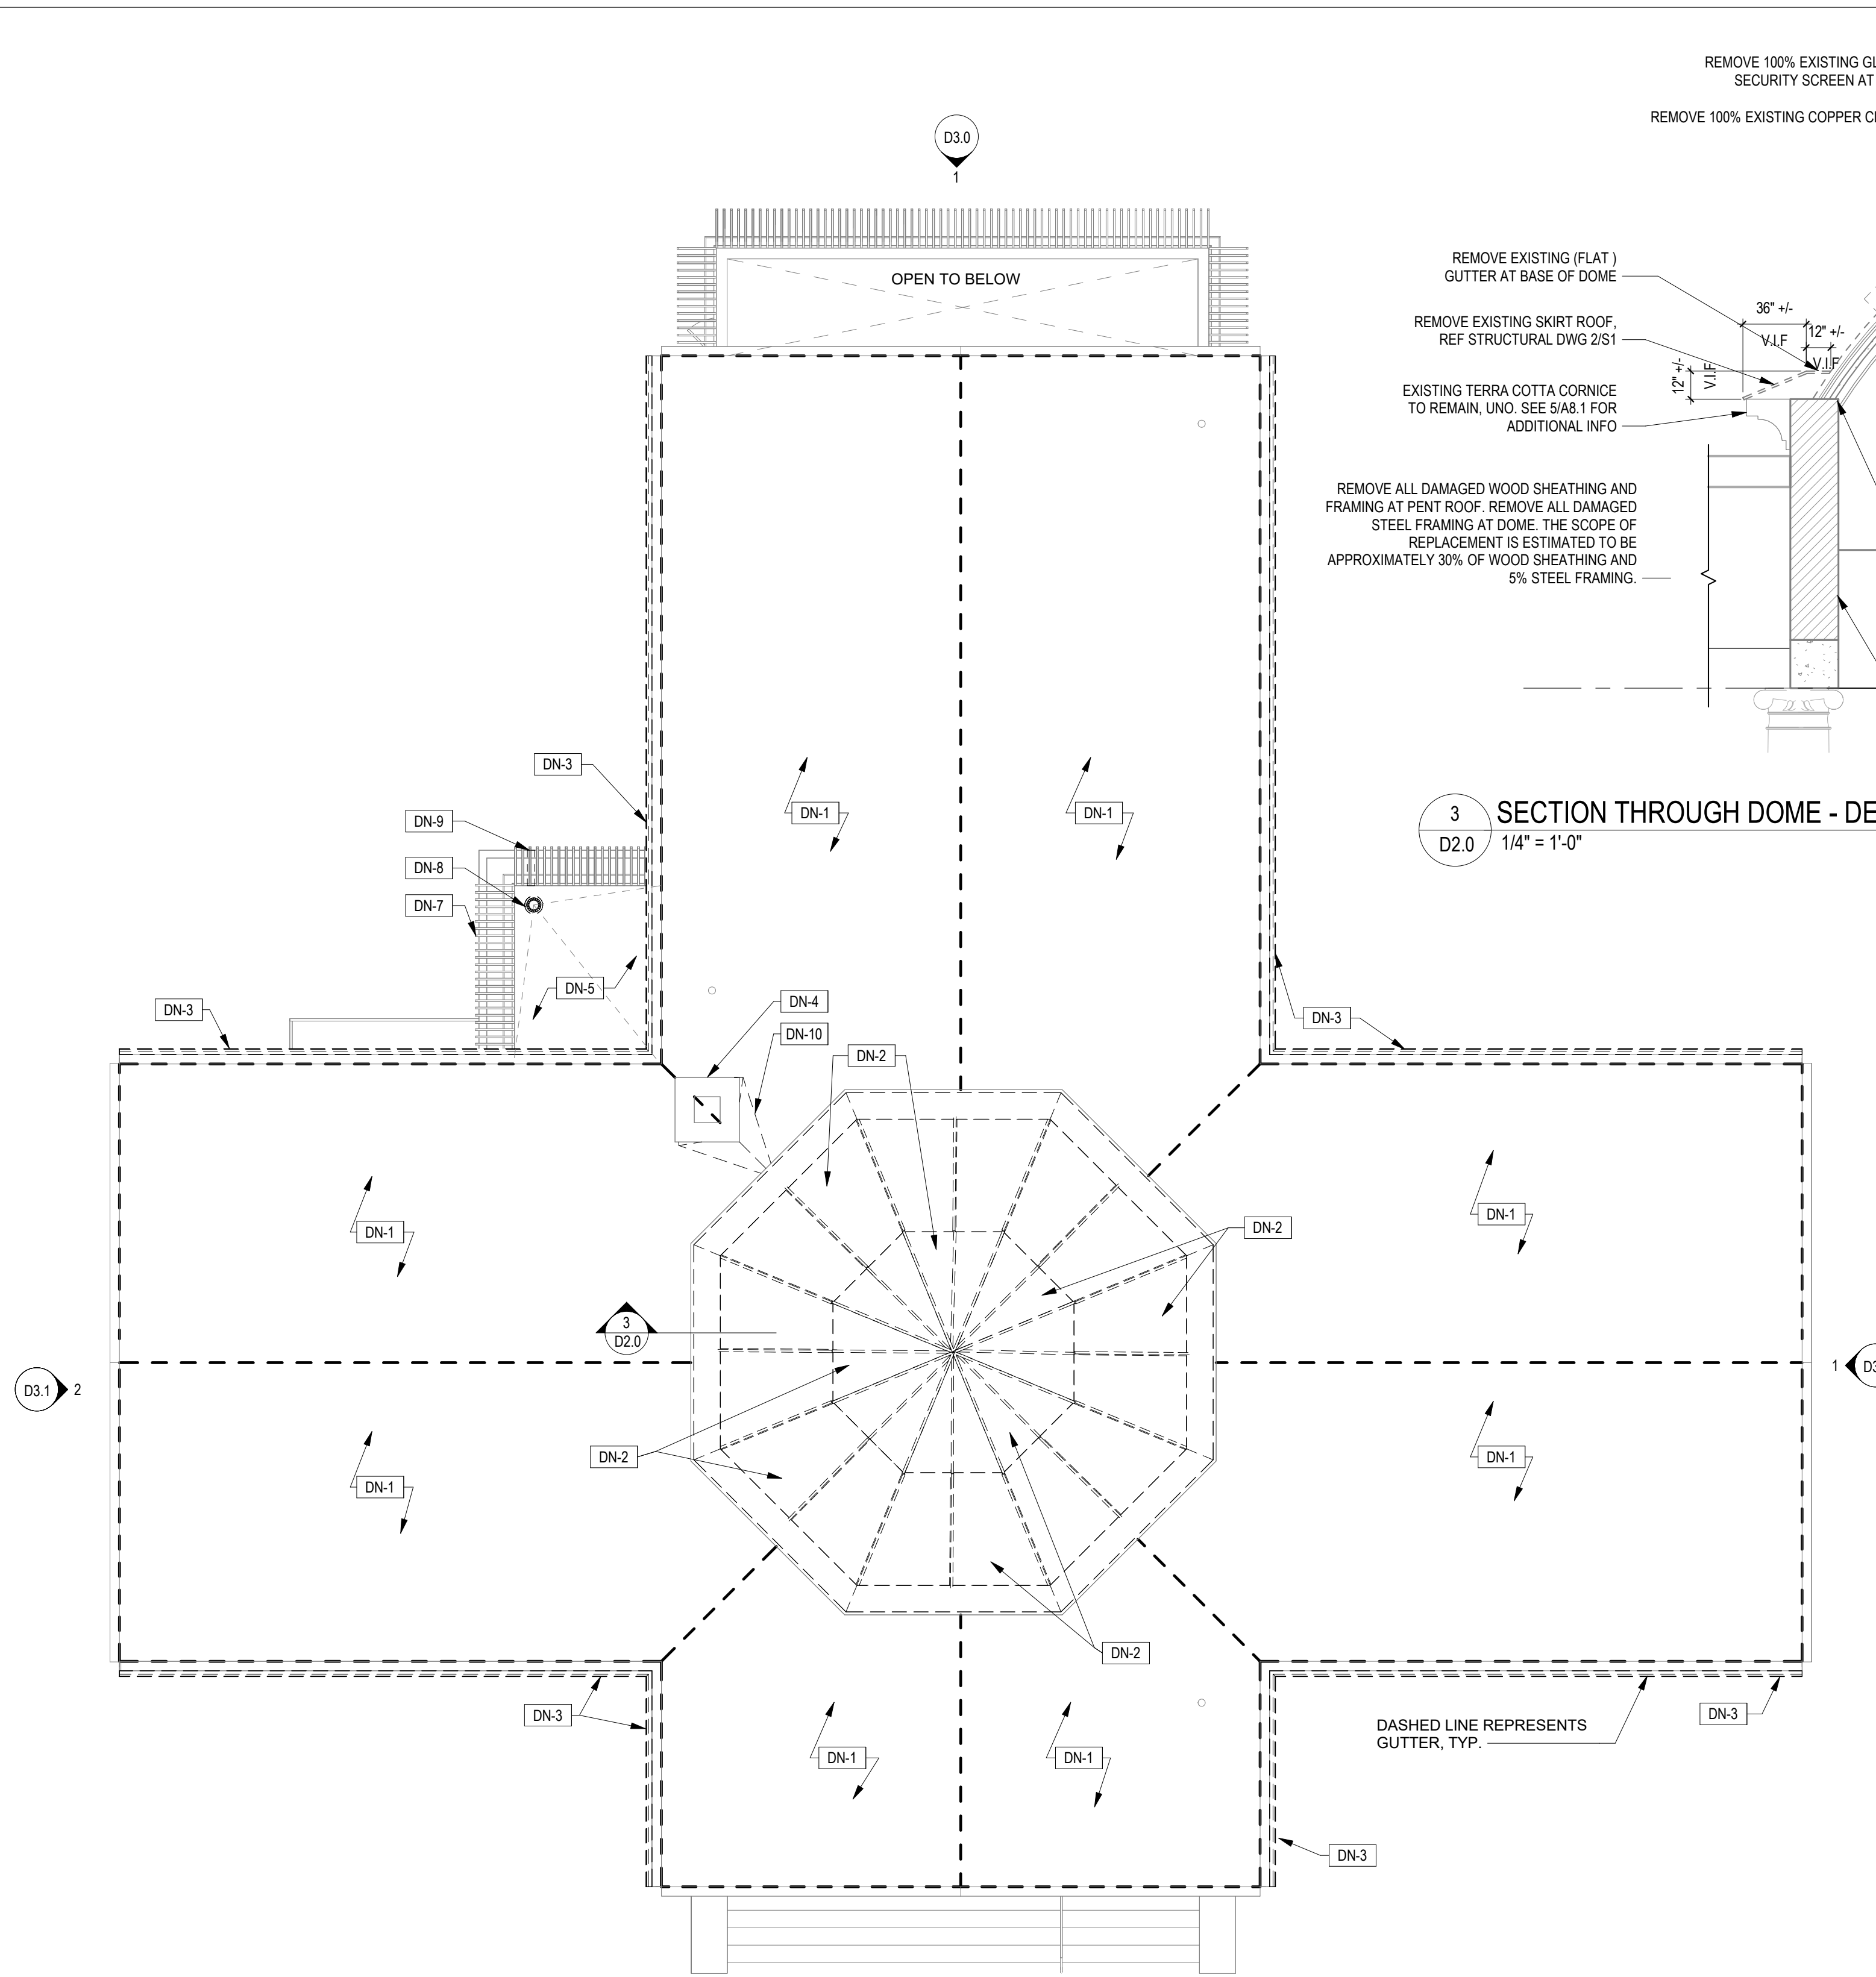

2 DEMOLITION - ROOF PLAN  
D2.0 1/8" = 1'-0"

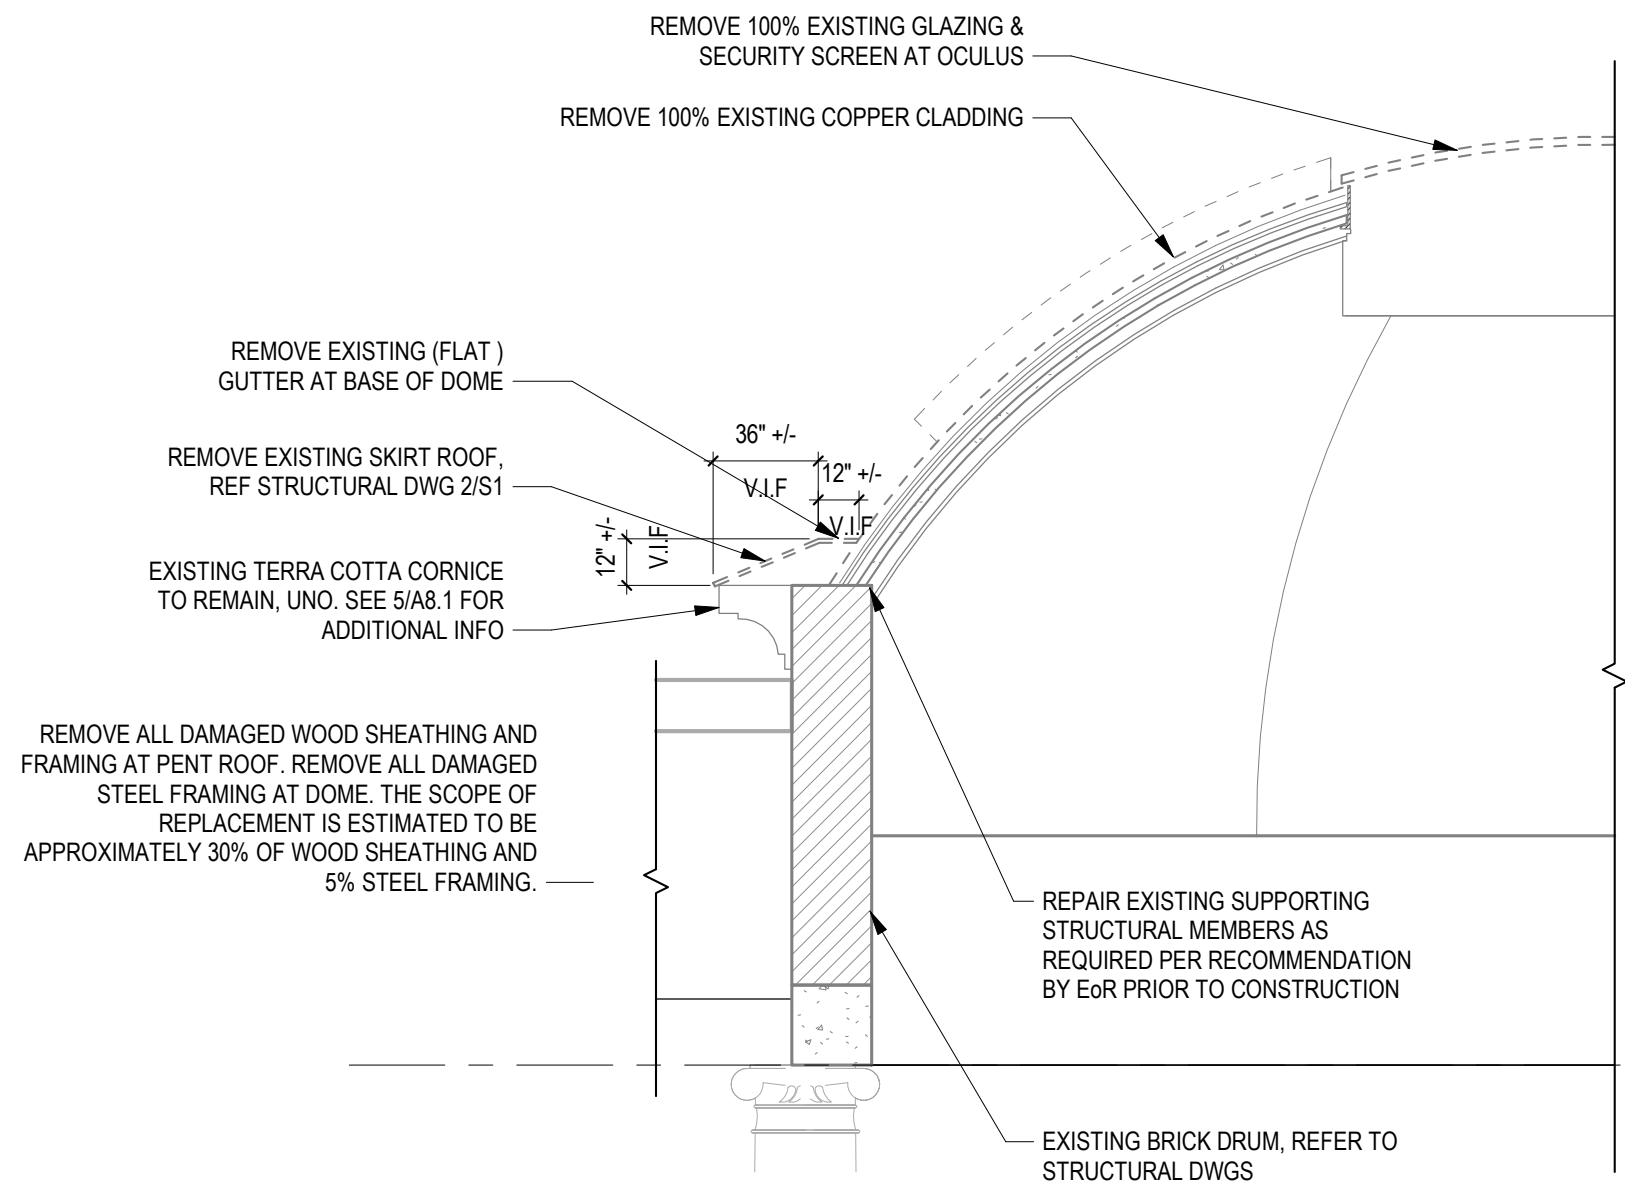

3 SECTION THROUGH DOME - DEMOLITION  
D2.0 1/4" = 1'-0"

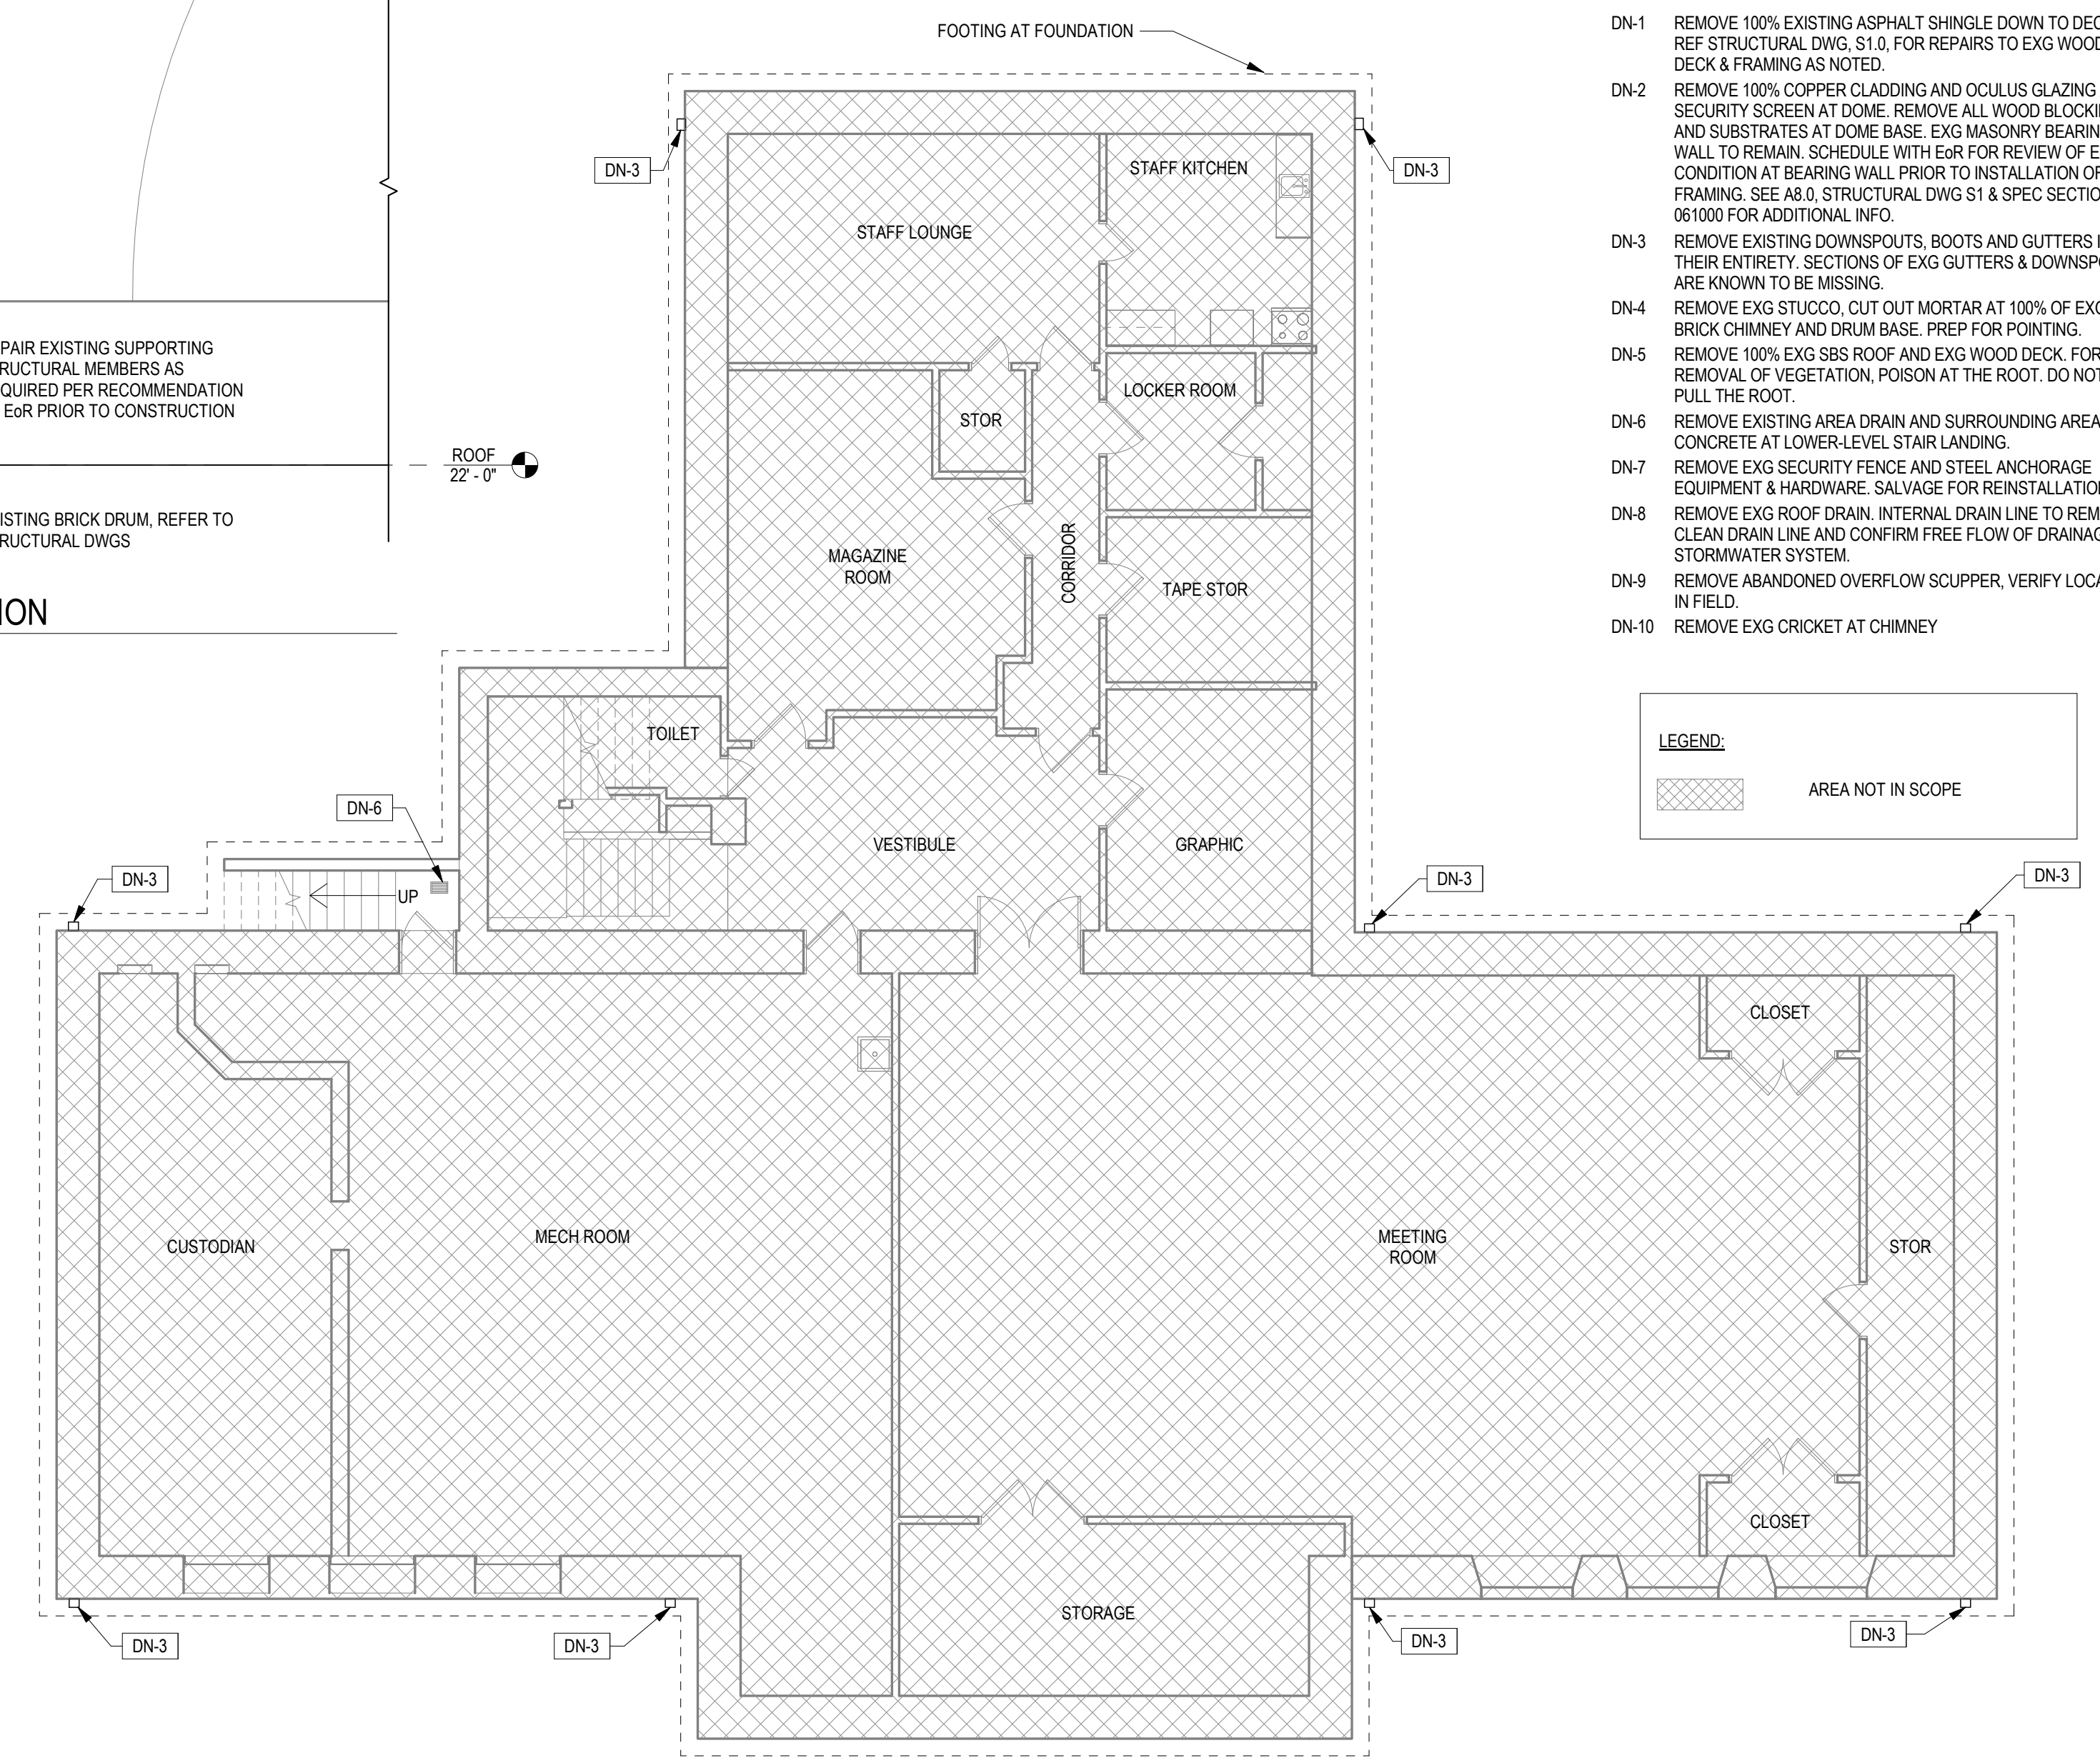

1 DEMOLITION - BASEMENT LEVEL  
D2.0 1/8" = 1'-0"

**GENERAL DEMOLITION NOTES:**

1. VERIFY ALL EXG CONDITIONS AND DIMENSIONS IN FIELD PRIOR TO CONSTRUCTION.
2. CUT A TEMPORARY ACCESS OPENING BETWEEN RAFTERS IN EACH QUADRANT OF CROSS-GABLE ROOF FOR REMOVAL OF EXG INSULATION.
3. ALL EXG PIPE PENETRATIONS AT ROOF TO REMAIN.
4. REPAIR EXG STRUCTURAL FRAME AS NOTED ON STRUCTURAL DRAWINGS S1-6.
5. CAREFULLY REMOVE, SALVAGE, AND STORE INTERIOR PENDANT LIGHT SUSPENDED FROM CENTER OF OCELLUS.

**KEYED DEMOLITION NOTES**

- DN-1 REMOVE 100% EXISTING ASPHALT SHINGLE DOWN TO DECK. REF STRUCTURAL DWG. S1.0, FOR REPAIRS TO EXG WOOD DECK & FRAMING AS NOTED.
- DN-2 REMOVE 100% COPPER CLADDING AND OCELLUS GLAZING AND SECURITY SCREEN AT DOME. REMOVE ALL WOOD BLOCKING AND SUBSTRATES AT DOME BASE. EXG MASONRY BEARING WALL TO REMAIN. SCHEDULE WITH EOR FOR REVIEW OF EXG CONDITION AT BEARING WALL PRIOR TO INSTALLATION OF NEW FRAMING. SEE A8.0, STRUCTURAL DWG S1 & SPEC SECTION 061000 FOR ADDITIONAL INFO.
- DN-3 REMOVE EXISTING DOWNSPOUTS, BOOTS AND GUTTERS IN THEIR ENTIRETY. SECTIONS OF EXG GUTTERS & DOWNSPOUTS ARE KNOWN TO BE MISSING.
- DN-4 REMOVE EXG STUCCO, CUT OUT MORTAR AT 100% OF EXG BRICK CHIMNEY AND DRUM BASE. PREP FOR POINTING.
- DN-5 REMOVE 100% EXG SBS ROOF AND EXG WOOD DECK. FOR REMOVAL OF VEGETATION, POISON AT THE ROOT. DO NOT PULL THE ROOT.
- DN-6 REMOVE EXISTING AREA DRAIN AND SURROUNDING AREA OF CONCRETE AT LOWER-LEVEL STAIR LANDING.
- DN-7 REMOVE EXG SECURITY FENCE AND STEEL ANCHORAGE EQUIPMENT & HARDWARE. SALVAGE FOR REINSTALLATION.
- DN-8 REMOVE EXG ROOF DRAIN. INTERNAL DRAIN LINE TO REMAIN. CLEAN DRAIN LINE AND CONFIRM FREE FLOW OF DRAINAGE TO STORMWATER SYSTEM.
- DN-9 REMOVE ABANDONED OVERFLOW SCUPPER. VERIFY LOCATION IN FIELD.
- DN-10 REMOVE EXG CRICKET AT CHIMNEY

**LEGEND:**

AREA NOT IN SCOPE

NOTE:  
NO SCOPE OF WORK AT FIRST LEVEL DEMOLITION FLOOR PLAN.  
HENCE OMITTED FROM SET OF DRAWINGS.



MCPHERSON SQUARE LIBRARY  
601 E INDIANA AVE,  
PHILADELPHIA, PA 19134

**ARCHITECTS:**  
SMP Architects  
1600 Walnut Street, 2nd Floor  
Philadelphia, PA 19103  
215 985 4410  
www.smparchitects.com

**CIVIL ENGINEER:**  
KS Engineers  
530 Walnut Street, Suite 460  
Philadelphia, PA 19106  
215 616 3060

**STRUCTURAL ENGINEER:**  
Ann Rothmann  
100 E Lancaster Avenue, Suite 203  
Wayne, PA 19087  
610 688 2566

**ROOFING CONSULTANT:**  
Steve McLaughlin  
210 Garden Avenue  
Somersdale, NJ 08083  
856 287 2424

Seal:

DATE	REVISION
5/10/2024	ADDENDUM 1

By: JS Checked: JGH Scale: AS NOTED  
Date: 04/15/2024

Drawing Title:  
DEMOLITION BASEMENT & ROOF PLAN



Drawing No.:  
D2.0




**GENERAL DEMOLITION NOTES:**


1. ALL EXG CONDITIONS AND DIMENSIONS TO BE VERIFIED IN FIELD PRIOR TO CONSTRUCTION.
2. CUT A TEMPORARY ACCESS OPENING, BETWEEN RAFTERS, IN EACH QUADRANT OF CROSS-GABLE ROOF FOR REMOVAL OF EXG INSULATION.
3. ALL EXG PIPE PENETRATIONS AT ROOF TO REMAIN.
4. CUT OUT 100% OF JOINTS BETWEEN TERRA COTTA UNITS IN PREPARATION FOR POINTING.

**LEGEND:**

-  DAMAGED TERRA COTTA UNITS. REF A3.0 & A3.1 FOR UNITS REQUIRING REPAIR
-  CUT OUT AND REMOVE DESTABILIZED SECTIONS OF TERRA COTTA

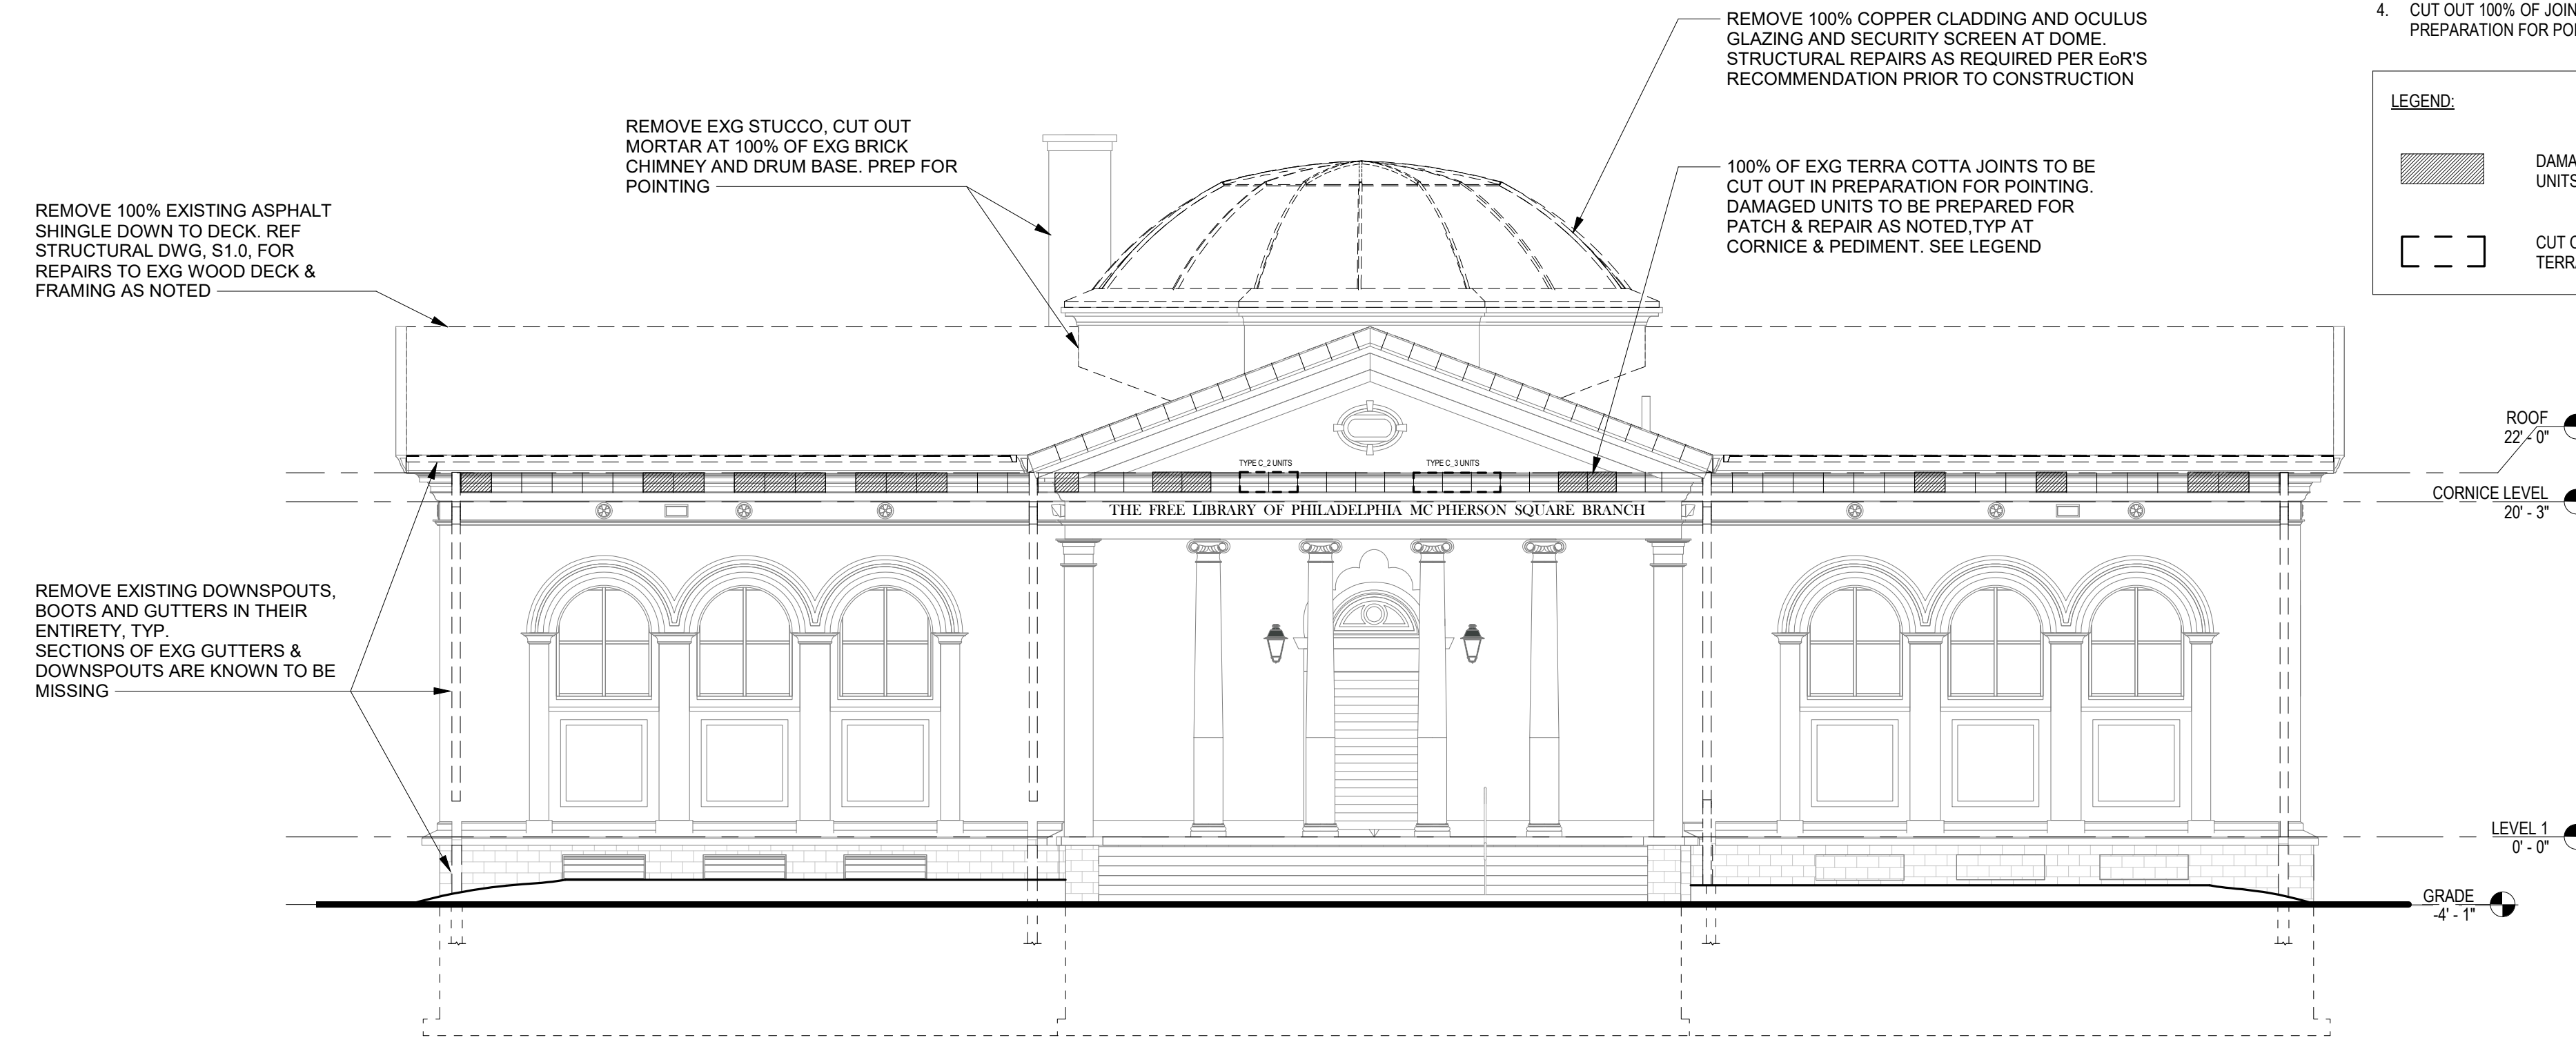

2 SOUTH (FRONT) ELEVATION  
D3.0 1/8" = 1'-0"

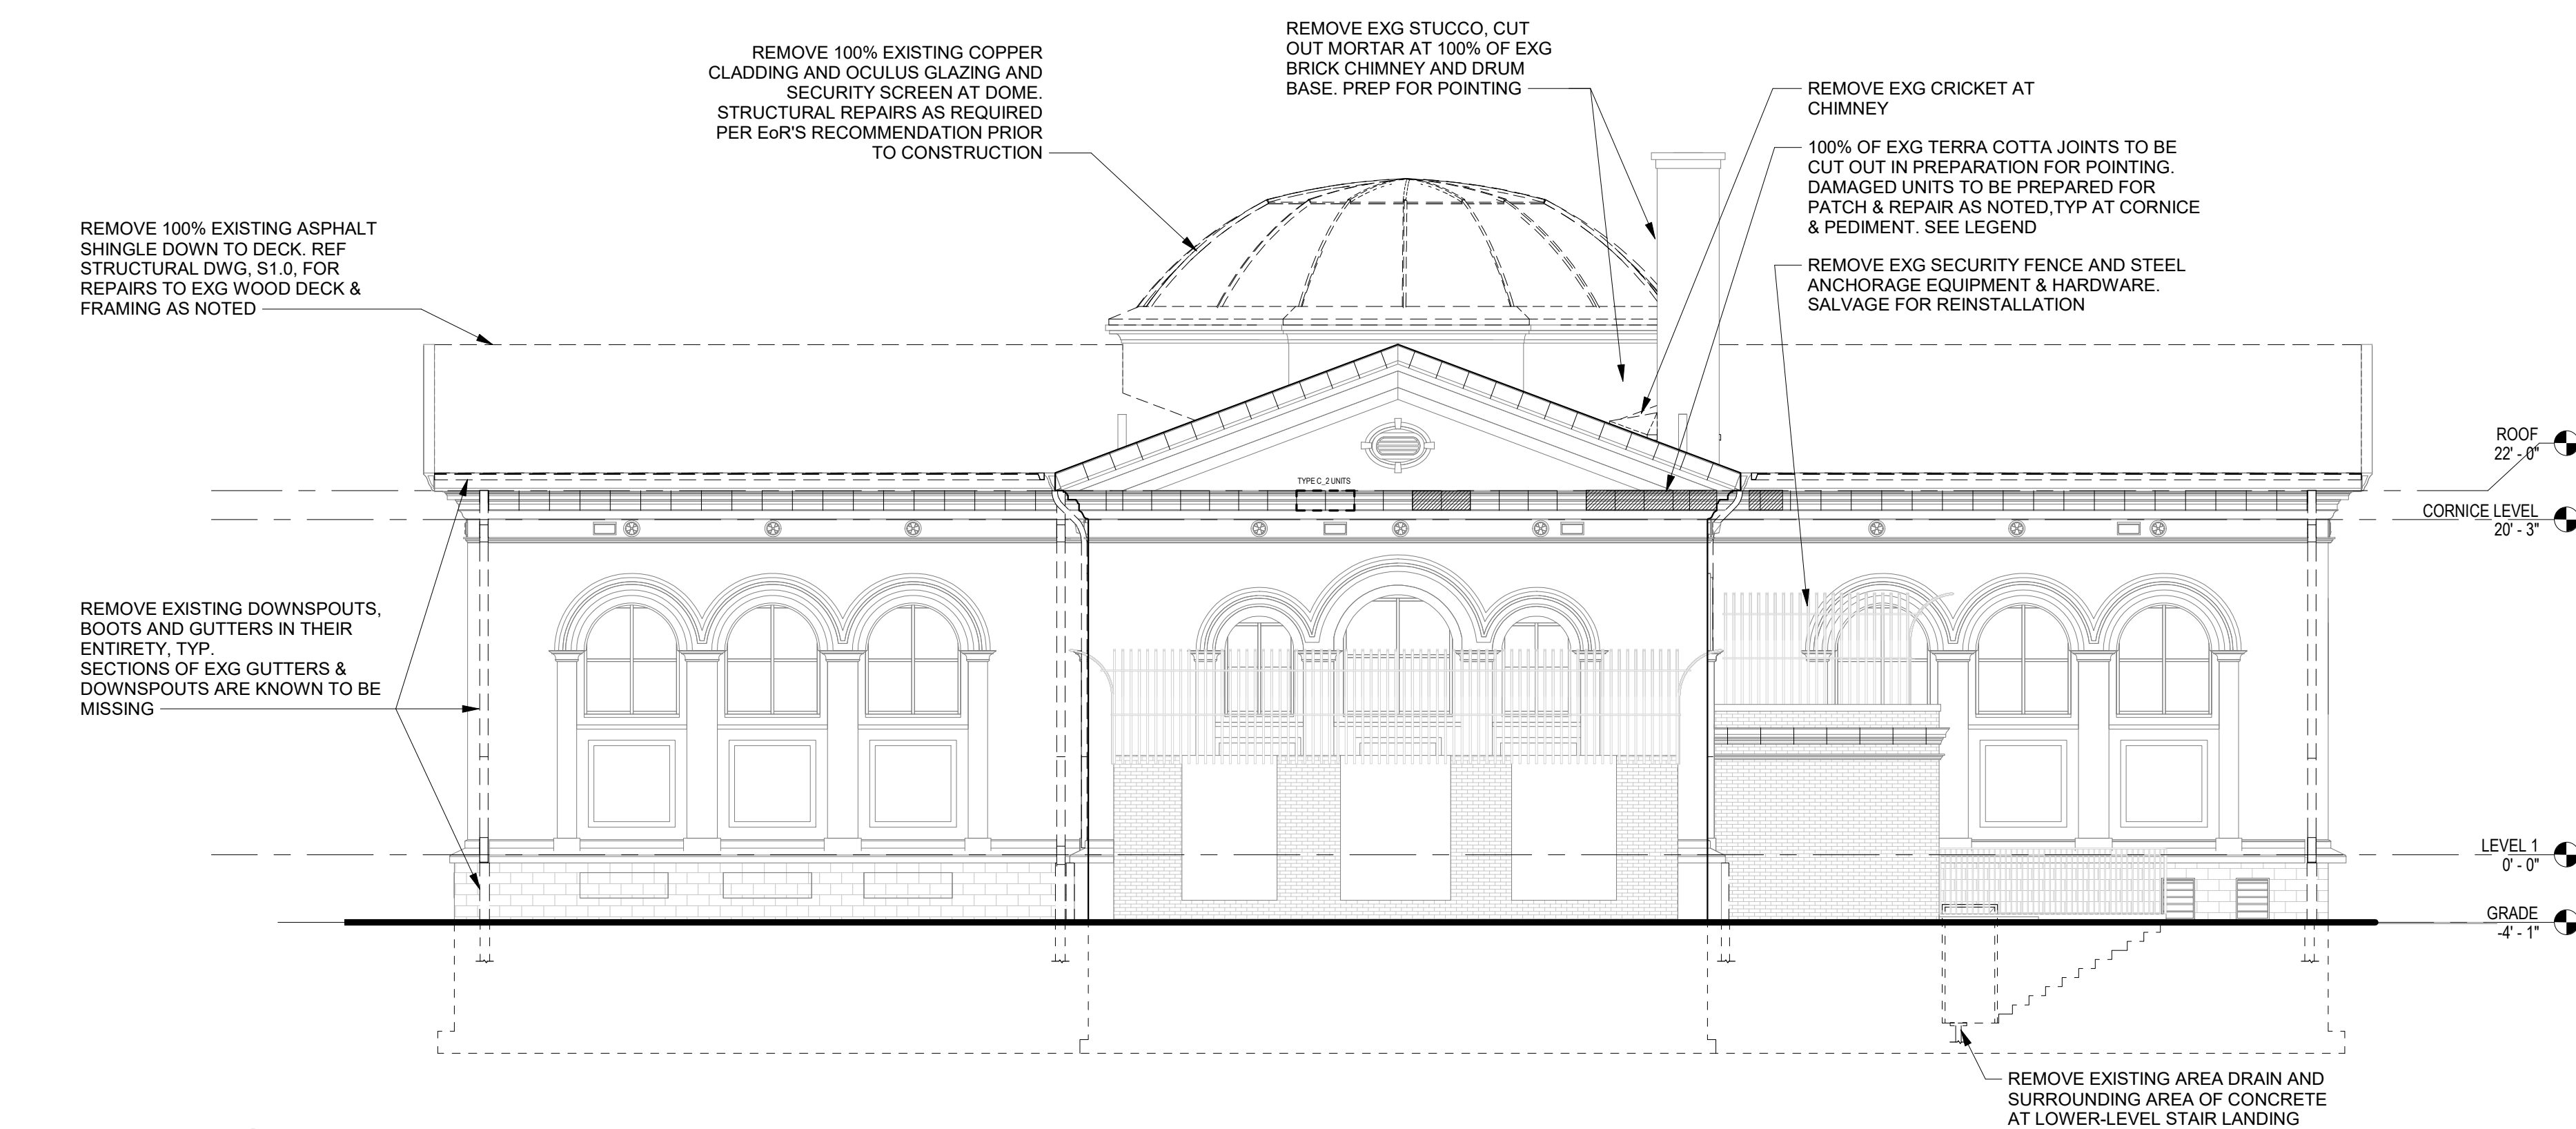

1 NORTH (REAR) ELEVATION  
D3.0 1/8" = 1'-0"

Seal:

No.	Date	Revision

By: JH    Checked: JGH    Scale: AS NOTED  
Date: 04/15/2024

Drawing Title:  
DEMOLITION EXTERIOR  
ELEVATIONS

Drawing No.:  
D3.0



Seal:

No.	Date	Revision

By: JH    Checked: JPH    Scale: AS NOTED  
Date: 04/15/2024



Drawing Title:  
DEMOLITION EXTERIOR  
ELEVATIONS


Drawing No.:  
D3.1

**GENERAL DEMOLITION NOTES:**


1. ALL EXG CONDITIONS AND DIMENSIONS TO BE VERIFIED IN FIELD PRIOR TO CONSTRUCTION.
2. CUT A TEMPORARY ACCESS OPENING, BETWEEN RAFTERS, IN EACH QUADRANT OF CROSS-GABLE ROOF FOR REMOVAL OF EXG INSULATION.
3. ALL EXG PIPE PENETRATIONS AT ROOF TO REMAIN.
4. CUT OUT 100% OF JOINTS BETWEEN TERRA COTTA UNITS IN PREPARATION FOR POINTING.

**LEGEND:**

-  DAMAGED TERRA COTTA UNITS, REF A3.0 & A3.1 FOR UNITS REQUIRING REPAIR
-  CUT OUT AND REMOVE DESTABILIZED SECTIONS OF TERRA COTTA

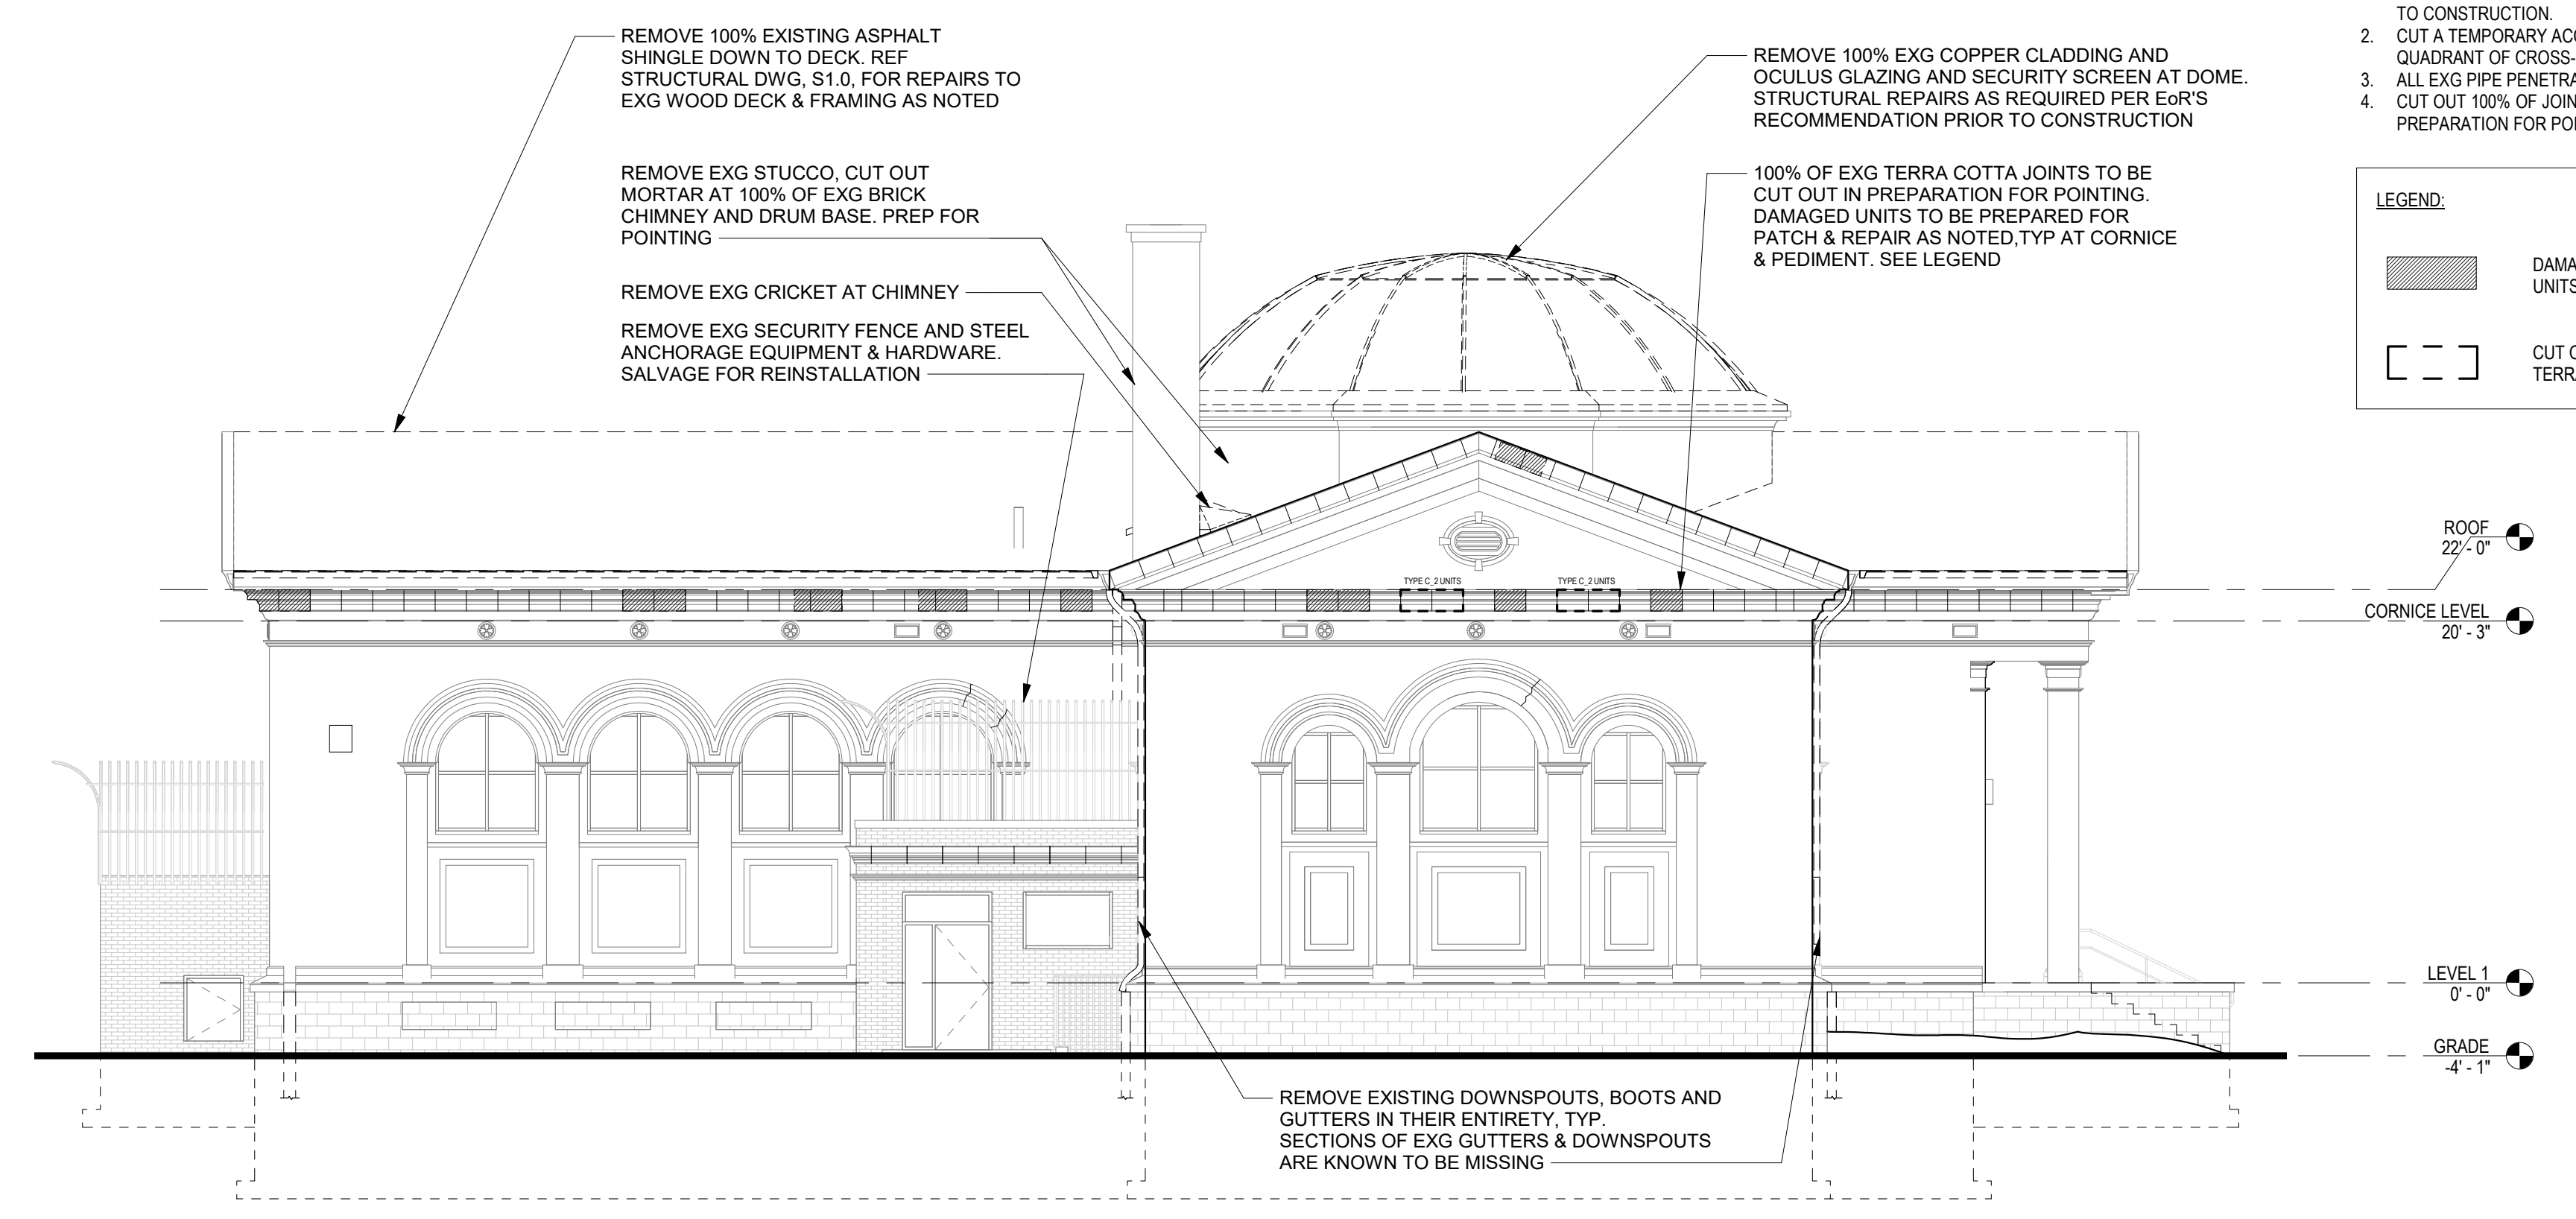


**2 WEST ELEVATION**  
D3.1 1/8" = 1'-0"

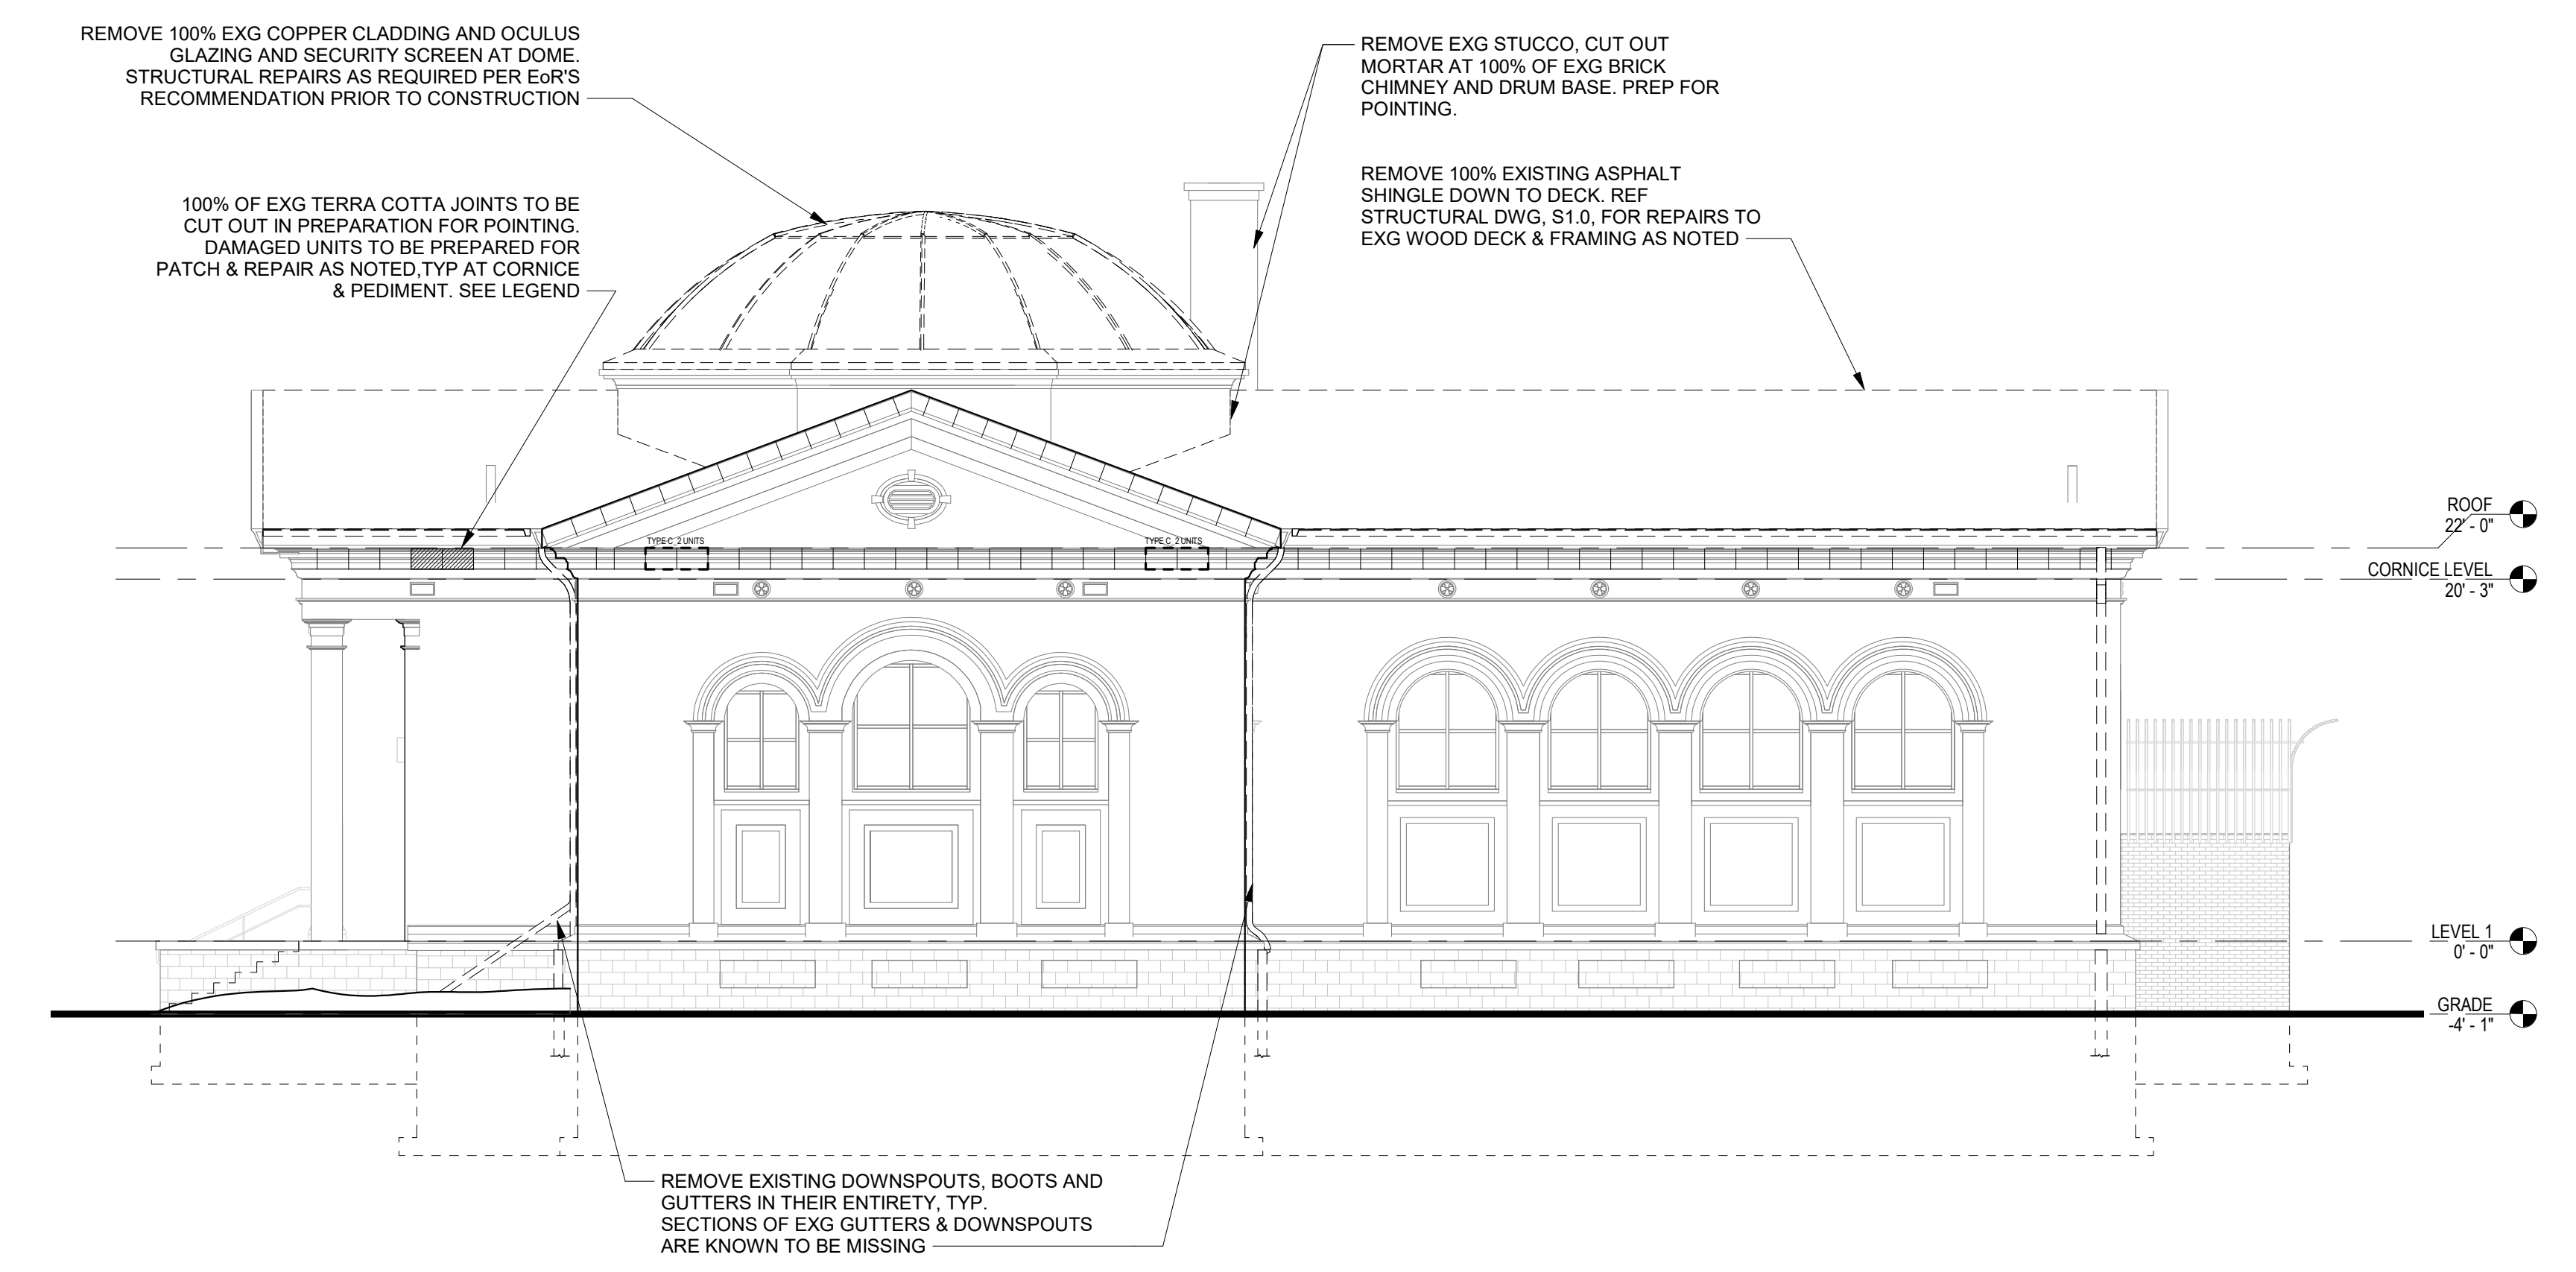


**1 EAST ELEVATION**  
D3.1 1/8" = 1'-0"



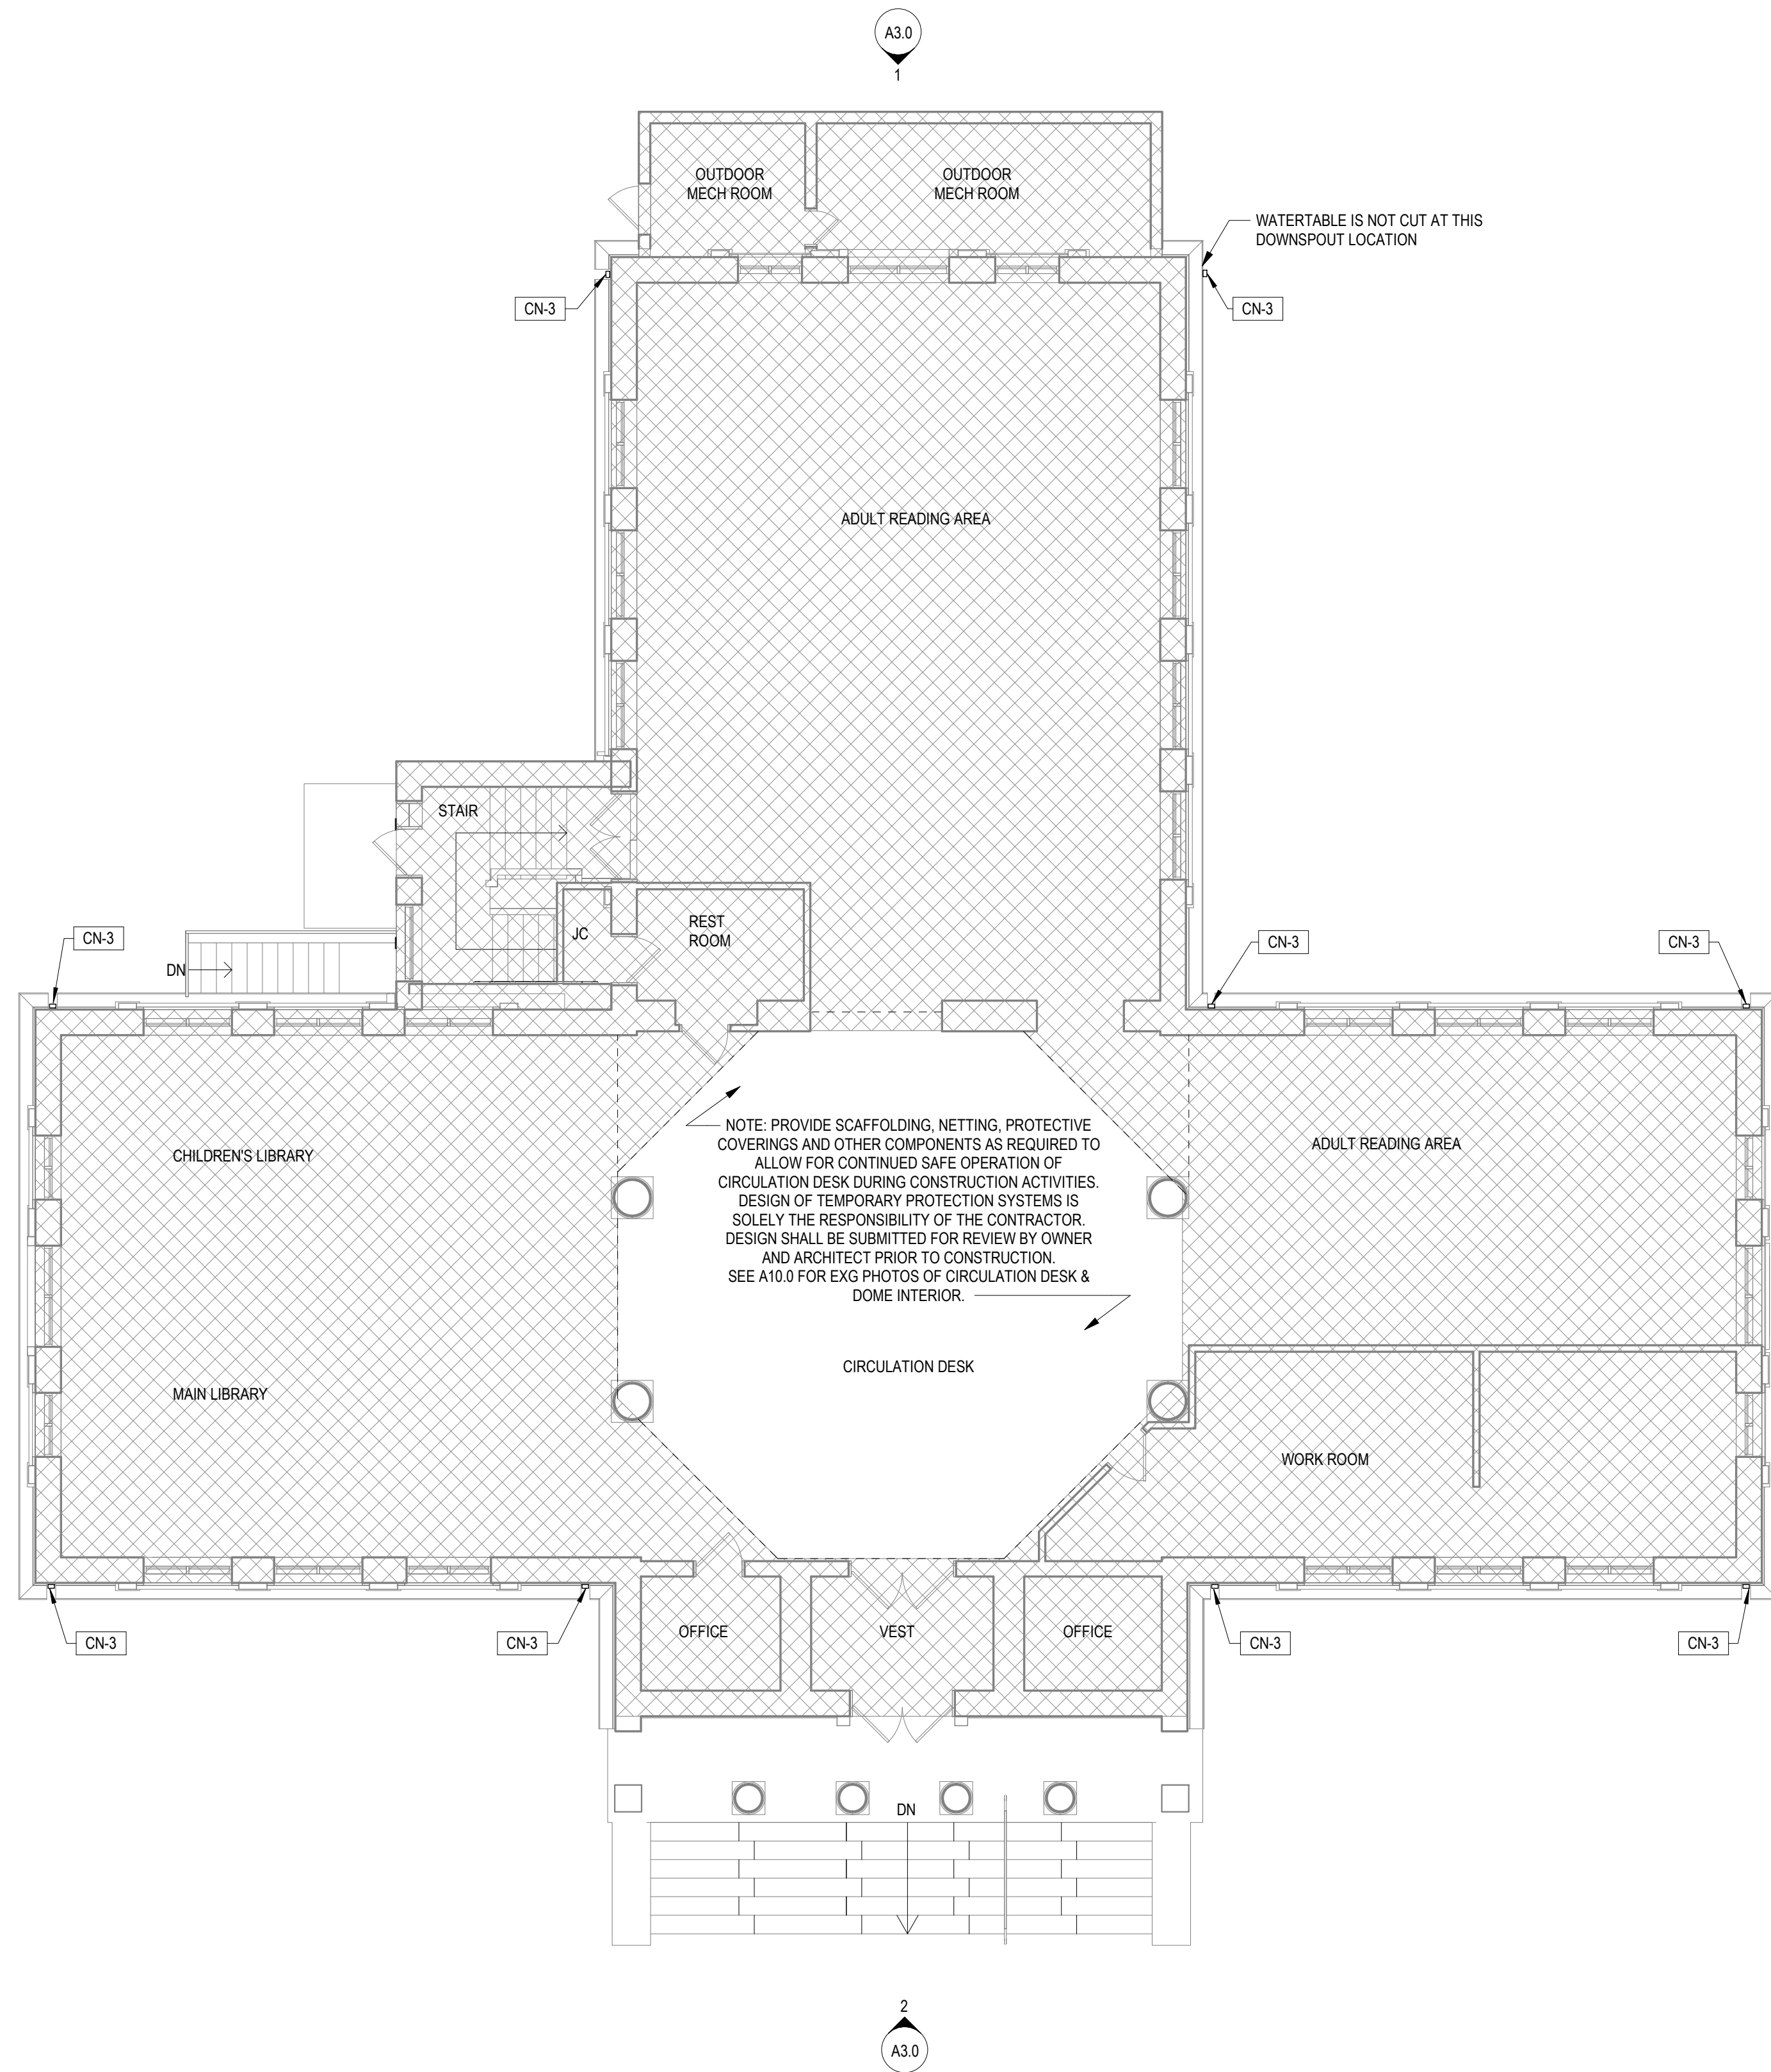

2 FIRST FLOOR PLAN  
A2.0 1/8" = 1'-0"

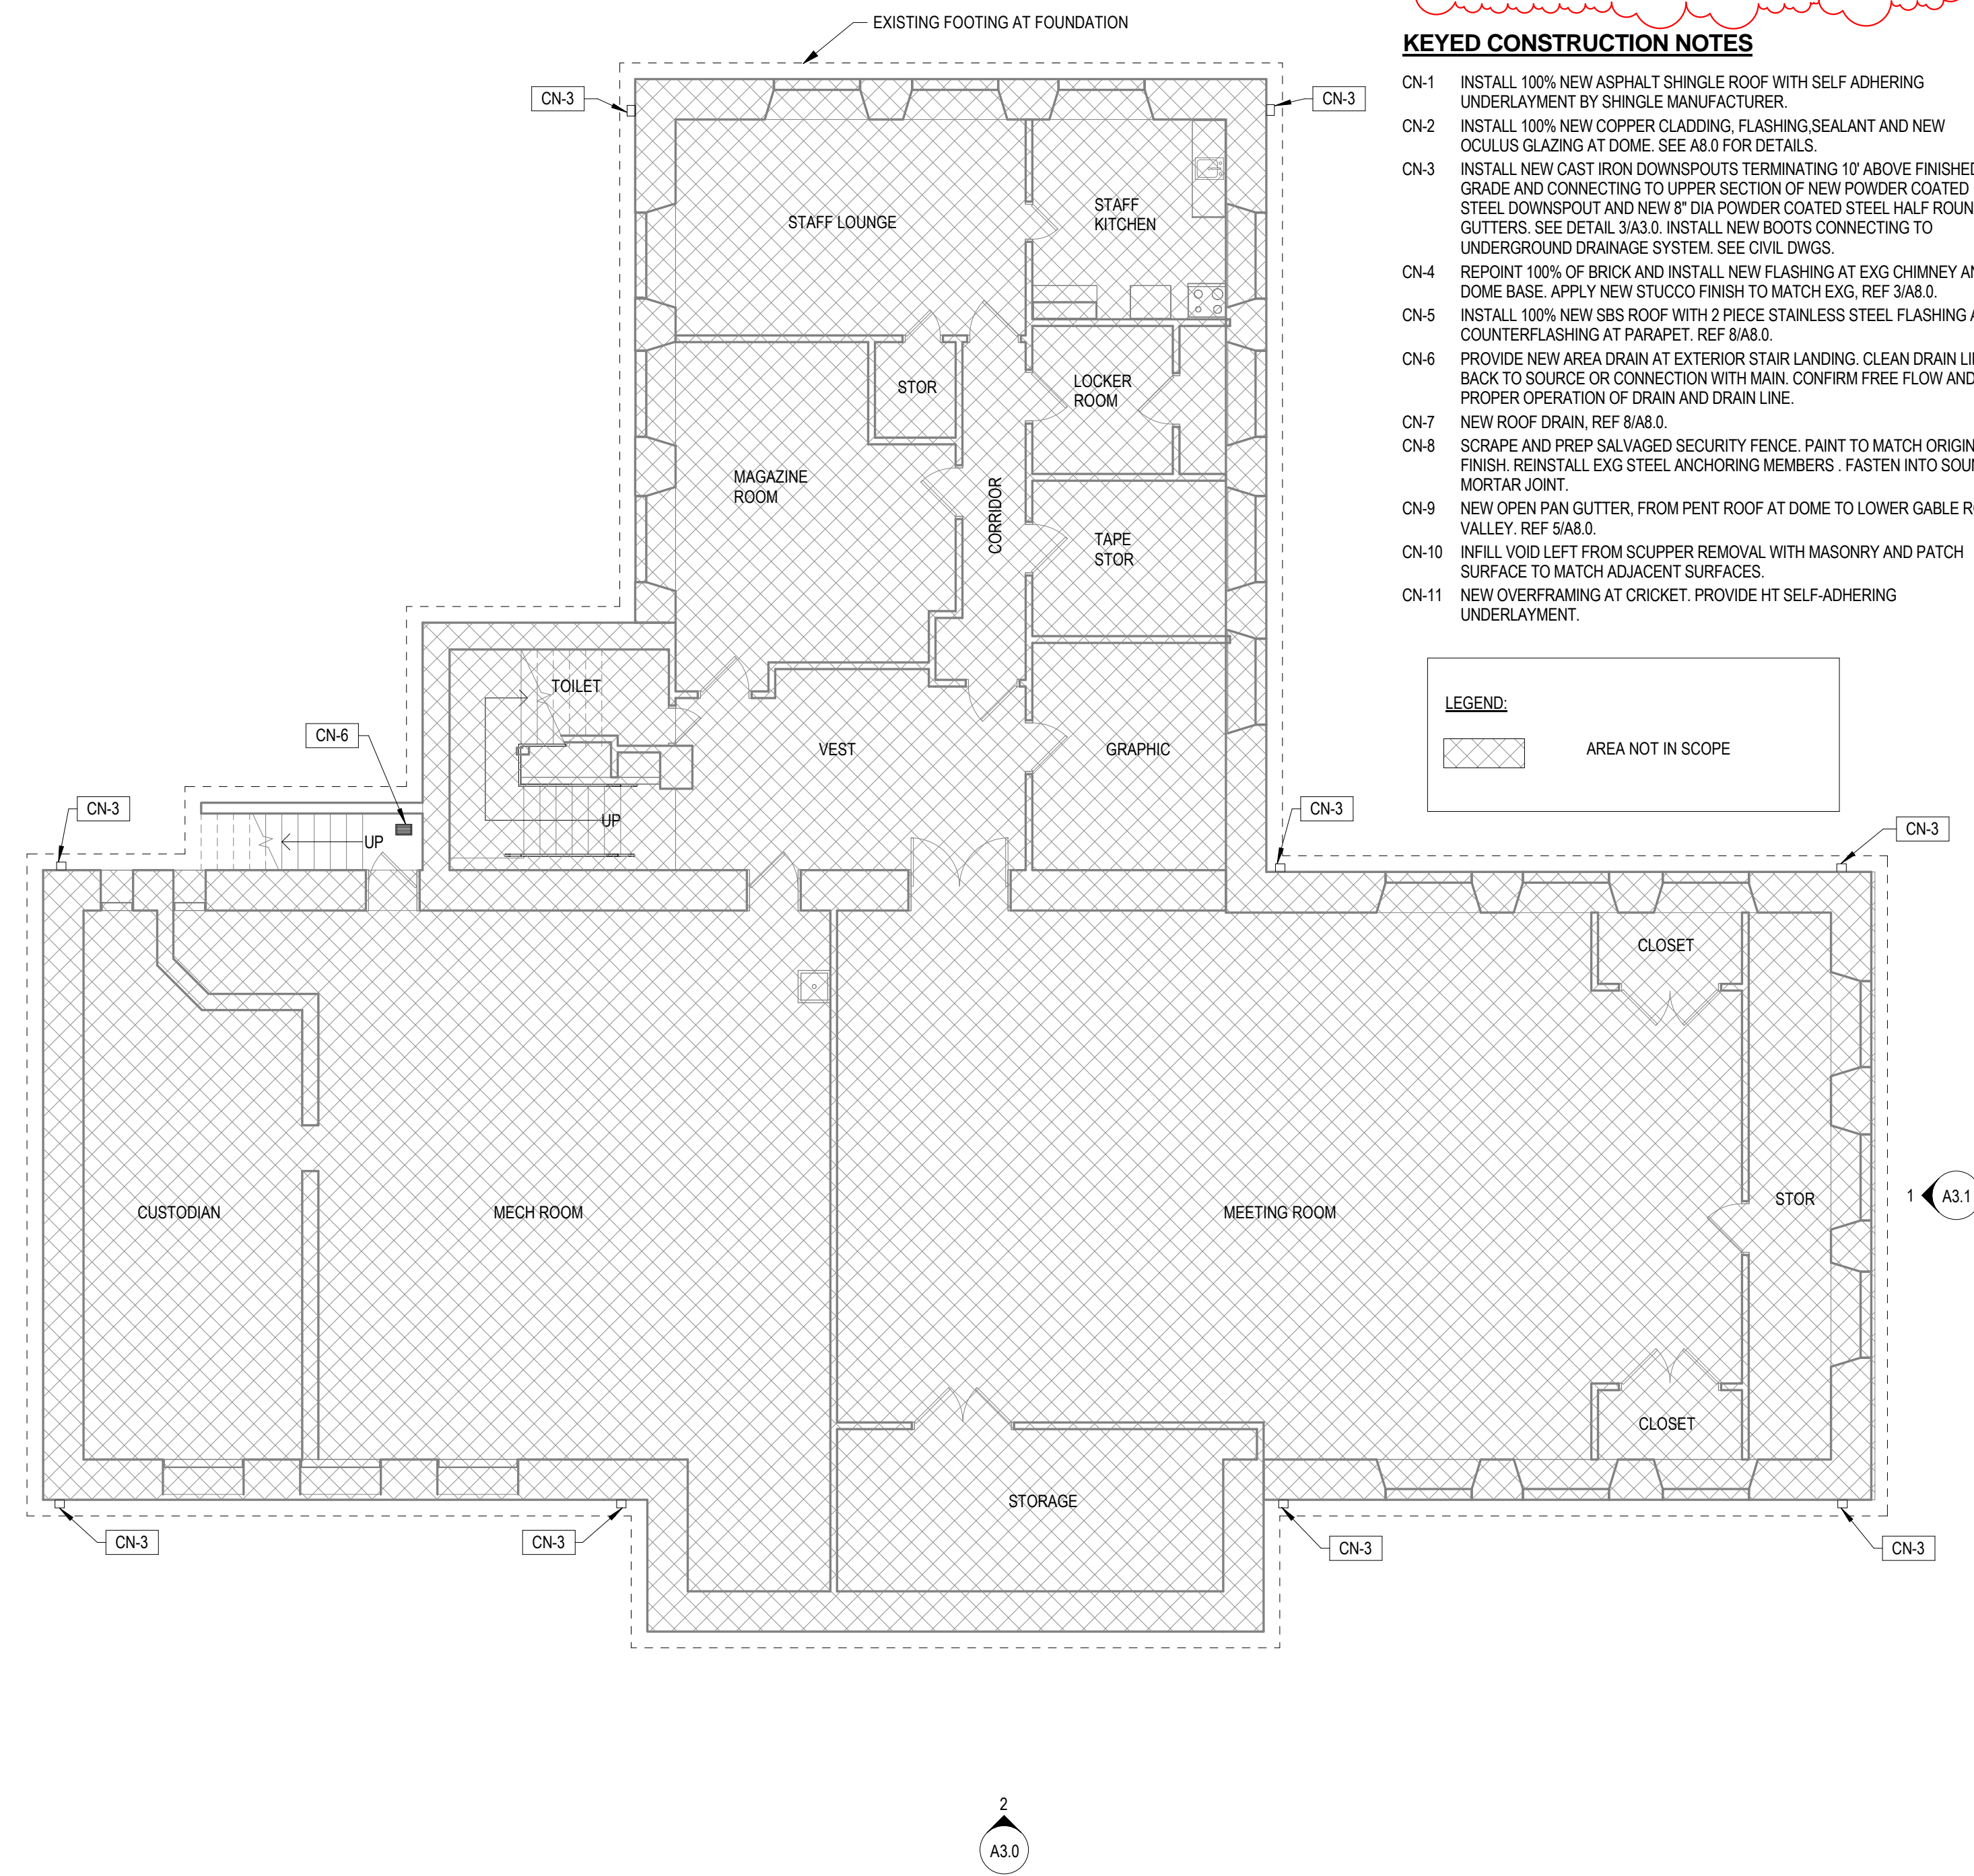

1 BASEMENT LEVEL PLAN  
A2.0 1/8" = 1'-0"

**GENERAL CONSTRUCTION NOTES:**

1. ALL EXG CONDITIONS AND DIMENSIONS TO BE VERIFIED IN FIELD PRIOR TO CONSTRUCTION.
2. SEE SHEET A0.1 FOR LIST OF ALTERNATES.
3. PATCH TEMPORARY ACCESS OPENINGS BETWEEN RAFTERS IN ROOF WITH ASPHALT SHINGLE ROOF ASSEMBLY TO WATERTIGHT CONDITION ONCE INSTALLATION OF NEW ATTIC INSULATION IS COMPLETE.
4. COMPLETE STRUCTURAL REPAIRS AND REVIEW EXISTING CONDITIONS OF EXPOSED STRUCTURAL MEMBERS WITH EXR PRIOR TO NEW CONSTRUCTION.
5. REINSTALL INTERIOR PENDANT LIGHT, TO MATCH ORIGINAL SUSPENSION FROM THE CENTER OF THE OCVLUS.

**KEYED CONSTRUCTION NOTES**

- CN-1 INSTALL 100% NEW ASPHALT SHINGLE ROOF WITH SELF ADHERING UNDERLAYMENT BY SHINGLE MANUFACTURER.
- CN-2 INSTALL 100% NEW COPPER CLADDING, FLASHING, SEALANT AND NEW OCVLUS GLAZING AT DOME. SEE A8.0 FOR DETAILS.
- CN-3 INSTALL NEW CAST IRON DOWNSPOUTS TERMINATING 10" ABOVE FINISHED GRADE AND CONNECTING TO UPPER SECTION OF NEW POWDER COATED STEEL DOWNSPOUT AND NEW 8" DIA POWDER COATED STEEL HALF ROUND GUTTERS. SEE DETAIL 3/A3.0. INSTALL NEW BOOTS CONNECTING TO UNDERGROUND DRAINAGE SYSTEM. SEE CIVIL DWGS.
- CN-4 REPOINT 100% OF BRICK AND INSTALL NEW FLASHING AT EXG CHIMNEY AND DOME BASE. APPLY NEW STUCCO FINISH TO MATCH EXG. REF 3/A8.0.
- CN-5 INSTALL 100% NEW SBS ROOF WITH 2 PIECE STAINLESS STEEL FLASHING AND COUNTERFLASHING AT PARAPET. REF 8/A8.0.
- CN-6 PROVIDE NEW AREA DRAIN AT EXTERIOR STAIR LANDING. CLEAN DRAIN LINE BACK TO SOURCE OR CONNECTION WITH MAIN. CONFIRM FREE FLOW AND PROPER OPERATION OF DRAIN AND DRAIN LINE.
- CN-7 NEW ROOF DRAIN, REF 8/A8.0.
- CN-8 SCRAPE AND PREP SALVAGED SECURITY FENCE. PAINT TO MATCH ORIGINAL FINISH. REINSTALL EXG STEEL ANCHORING MEMBERS. FASTEN INTO SOUND MORTAR JOINT.
- CN-9 NEW OPEN PAN GUTTER, FROM PENT ROOF AT DOME TO LOWER GABLE ROOF VALLEY. REF 5/A8.0.
- CN-10 INFILL VOID LEFT FROM SCUPPER REMOVAL WITH MASONRY AND PATCH SURFACE TO MATCH ADJACENT SURFACES.
- CN-11 NEW OVERFRAMING AT CRICKET. PROVIDE HT SELF-ADHERING UNDERLAYMENT.



MCPHERSON SQUARE LIBRARY  
601 E INDIANA AVE,  
PHILADELPHIA, PA 19134

**ARCHITECTS:**  
SMP Architects  
1600 Walnut Street, 2nd Floor  
Philadelphia, PA 19103  
215 985 4410  
www.smparchitects.com

**CIVIL ENGINEER:**  
KS Engineers  
530 Walnut Street, Suite 460  
Philadelphia, PA 19106  
215 616 3060

**STRUCTURAL ENGINEER:**  
Ann Rothmann  
100 E Lancaster Avenue, Suite 203  
Wayne, PA 19087  
610 688 2566

**ROOFING CONSULTANT:**  
Steve McLaughlin  
210 Garden Avenue  
Somersdale, NJ 08083  
856 287 2424

Seal:

DATE	REVISION
5/10/2024	ADDENDUM 1

By: JS Checked: JPH Scale: AS NOTED  
Date: 04/15/2024

Drawing Title:  
FLOOR PLANS

Drawing No.:  
A2.0




- GENERAL CONSTRUCTION NOTES:**
1. ALL EXG CONDITIONS AND DIMENSIONS TO BE VERIFIED IN FIELD PRIOR TO CONSTRUCTION.
  2. SEE SHEET A0.1 FOR LIST OF ALTERNATES.
  3. PATCH TEMPORARY ACCESS OPENINGS BETWEEN RAFTERS IN ROOF WITH ASPHALT SHINGLE ROOF ASSEMBLY TO WATERTIGHT CONDITION ONCE INSTALLATION OF NEW ATTIC INSULATION IS COMPLETE.
  4. COMPLETE STRUCTURAL REPAIRS AND REVIEW EXISTING CONDITIONS OF EXPOSED STRUCTURAL MEMBERS WITH EOR PRIOR TO NEW CONSTRUCTION.
  5. REINSTALL INTERIOR PENDANT LIGHT, TO MATCH ORIGINAL SUSPENSION FROM THE CENTER OF THE OCULUS.

- GENERAL ROOF NOTES:**
1. REFER TO STRUCTURAL DRAWINGS FOR INFORMATION ABOUT WOOD FRAMING REPLACEMENTS.
  2. ALL METAL FLASHINGS TO BE ZT COPPER.
  3. INSTALL R-30 MINERAL WOOL UNFACED BATT INSULATION BETWEEN RAFTERS. UTILIZE OPENING CUT IN EACH QUADRANT OF CROSS-GABLE ROOF FOR ACCESS TO ATTIC SPACE. SEE GENERAL CONSTRUCTION NOTE 3.

- KEYED CONSTRUCTION NOTES**
- CN-1 INSTALL 100% NEW ASPHALT SHINGLE ROOF WITH SELF ADHERING UNDERLAYMENT BY SHINGLE MANUFACTURER.
  - CN-2 INSTALL 100% NEW COPPER CLADDING, FLASHING SEALANT AND NEW OCULUS GLAZING AT DOME. SEE A8.0 FOR DETAILS.
  - CN-3 INSTALL NEW CAST IRON DOWNSPOUTS TERMINATING 10' ABOVE FINISHED GRADE AND CONNECTING TO UPPER SECTION OF NEW POWDER COATED STEEL DOWNSPOUT AND NEW 8" DIA POWDER COATED STEEL HALF ROUND GUTTERS. SEE DETAIL 3/A3.0. INSTALL NEW BOOTS CONNECTING TO UNDERGROUND DRAINAGE SYSTEM. SEE CIVIL DWGS.
  - CN-4 REPOINT 100% OF BRICK AND INSTALL NEW FLASHING AT EXG CHIMNEY AND DOME BASE. APPLY NEW STUCCO FINISH TO MATCH EXG. REF 3/A8.0.
  - CN-5 INSTALL 100% NEW SBS ROOF WITH 2 PIECE STAINLESS STEEL FLASHING AND COUNTERFLASHING AT PARAPET. REF 8/A8.0.
  - CN-6 PROVIDE NEW AREA DRAIN AT EXTERIOR STAIR LANDING. CLEAN DRAIN LINE BACK TO SOURCE OR CONNECTION WITH MAIN. CONFIRM FREE FLOW AND PROPER OPERATION OF DRAIN AND DRAIN LINE.
  - CN-7 NEW ROOF DRAIN, REF 8/A8.0.
  - CN-8 SCRAPE AND PREP SALVAGED SECURITY FENCE. PAINT TO MATCH ORIGINAL FINISH. REINSTALL EXG STEEL ANCHORING MEMBERS. FASTEN INTO SOUND MORTAR JOINT.
  - CN-9 NEW OPEN PAN GUTTER, FROM PENT ROOF AT DOME TO LOWER GABLE ROOF VALLEY. REF 5/A8.0.
  - CN-10 INFILL VOID LEFT FROM SCUPPER REMOVAL WITH MASONRY AND PATCH SURFACE TO MATCH ADJACENT SURFACES.
  - CN-11 NEW OVERFRAMING AT CRICKET. PROVIDE HT SELF-ADHERING UNDERLAYMENT.

**LEGEND:**


	AREA NOT IN SCOPE
	BRICK
	ICE & WATER SHIELD (INSTALL PER MFR INSTRUCTIONS)
	UNDERLAYMENT HT (BY SHINGLE MFR)

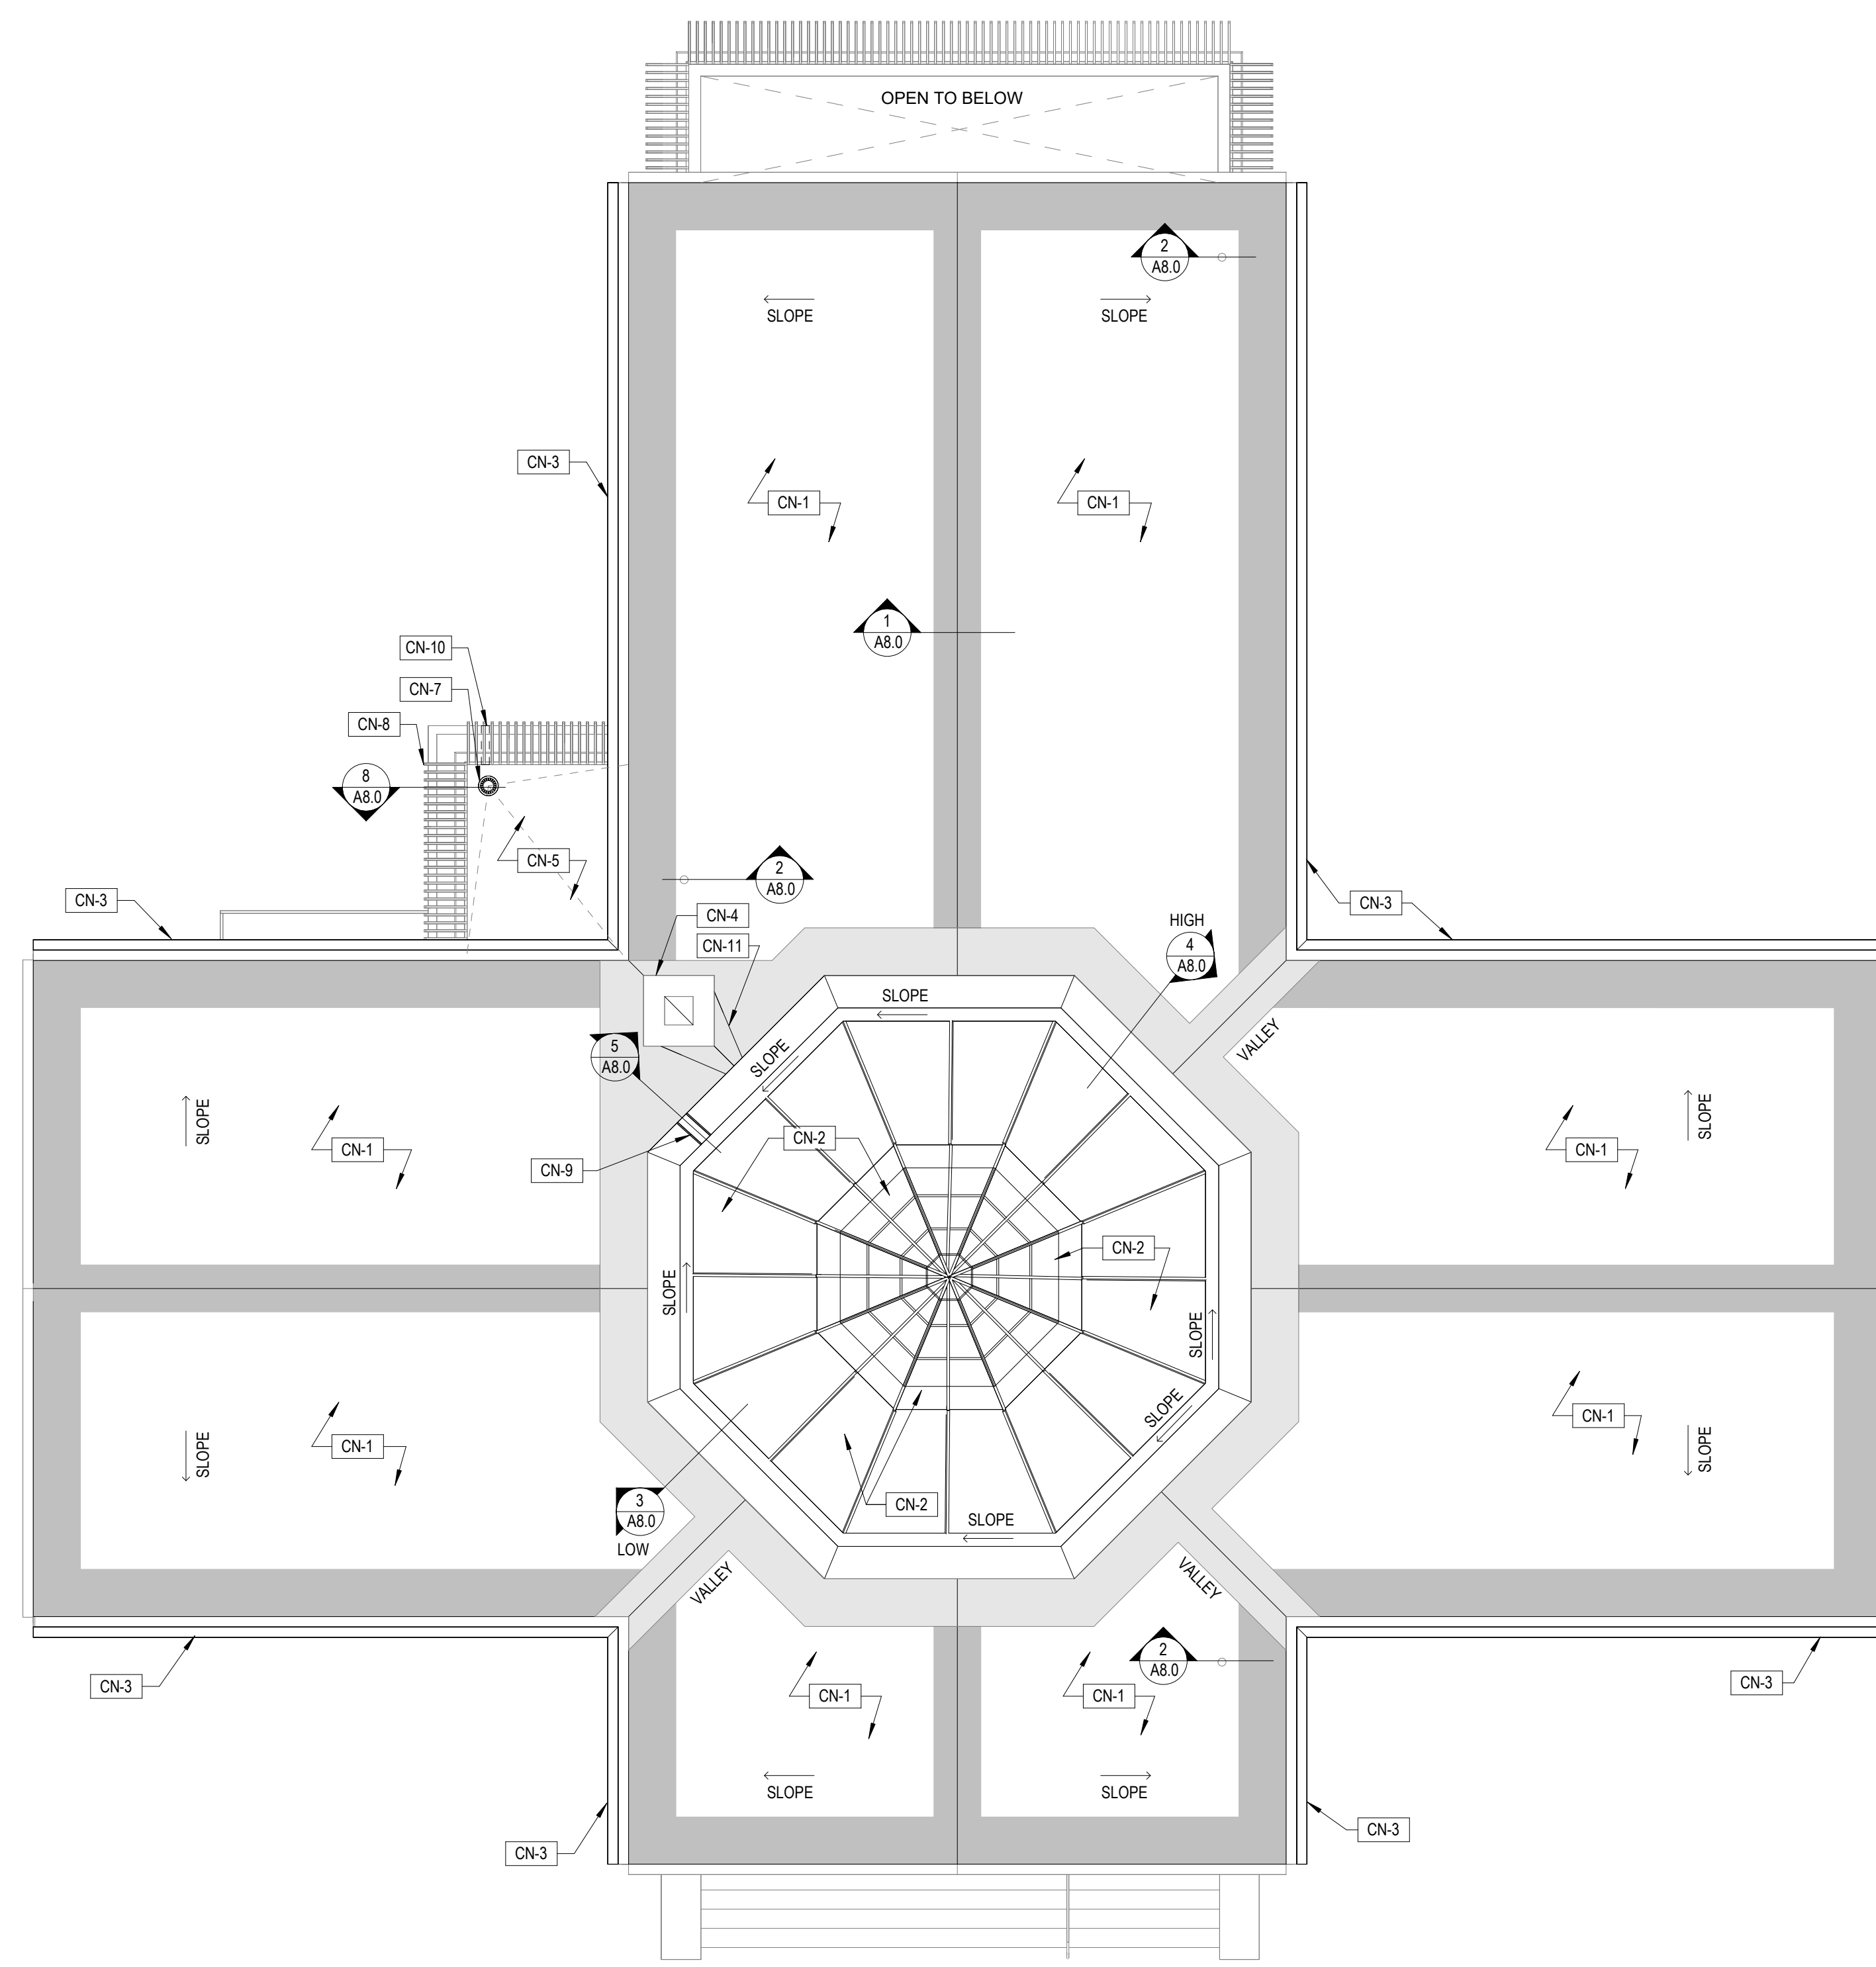


1 ROOF PLAN  
A2.1 1/8" = 1'-0"

ROOF TYPES				
TYPE	DESCRIPTION	CODE-REQ'D INSUL MIN R-VALUE	DETAIL	SPECIFICATION
R1	SLOPED ASPHALT SHINGLE ROOF ASSEMBLY	MIN R-30 ci R-30 ci		EXG 2x10 PLANK DECK, R-30 MINERAL WOOL UNFACED BATT INSULATION BETWEEN RAFTERS, EXG 1/2" PLYWOOD SHEATHING, SELF ADHERING UNDERLAYMENT, NEW ICE & WATER SHIELD (ONLY AT EAVES, RIDGES & VALLEYS), ASPHALT FIBERGLASS SHINGLE ROOF SYSTEM
R2	LOW-SLOPE SBS MEMBRANE ROOF ON WOOD DECKING	MIN R-30 ci R-30 ci		NEW T&G WOOD DECK, HT SELF ADHERING VAPOR RETARDER, (2) LAYERS 2 5/8" THICK POLYISO INSULATION, 1/2" GYPSUM COVERBOARD, MULTI-PLY SBS MODIFIED BITUMEN ROOFING SYSTEM

- GENERAL ROOF NOTES:**
1. SEE STRUC DWGS FOR ROOF DECK & STRUCTURE.
  2. SEE ROOF PLAN DWG AND A-8 SERIES DWGS FOR ADDITIONAL DETAILS.

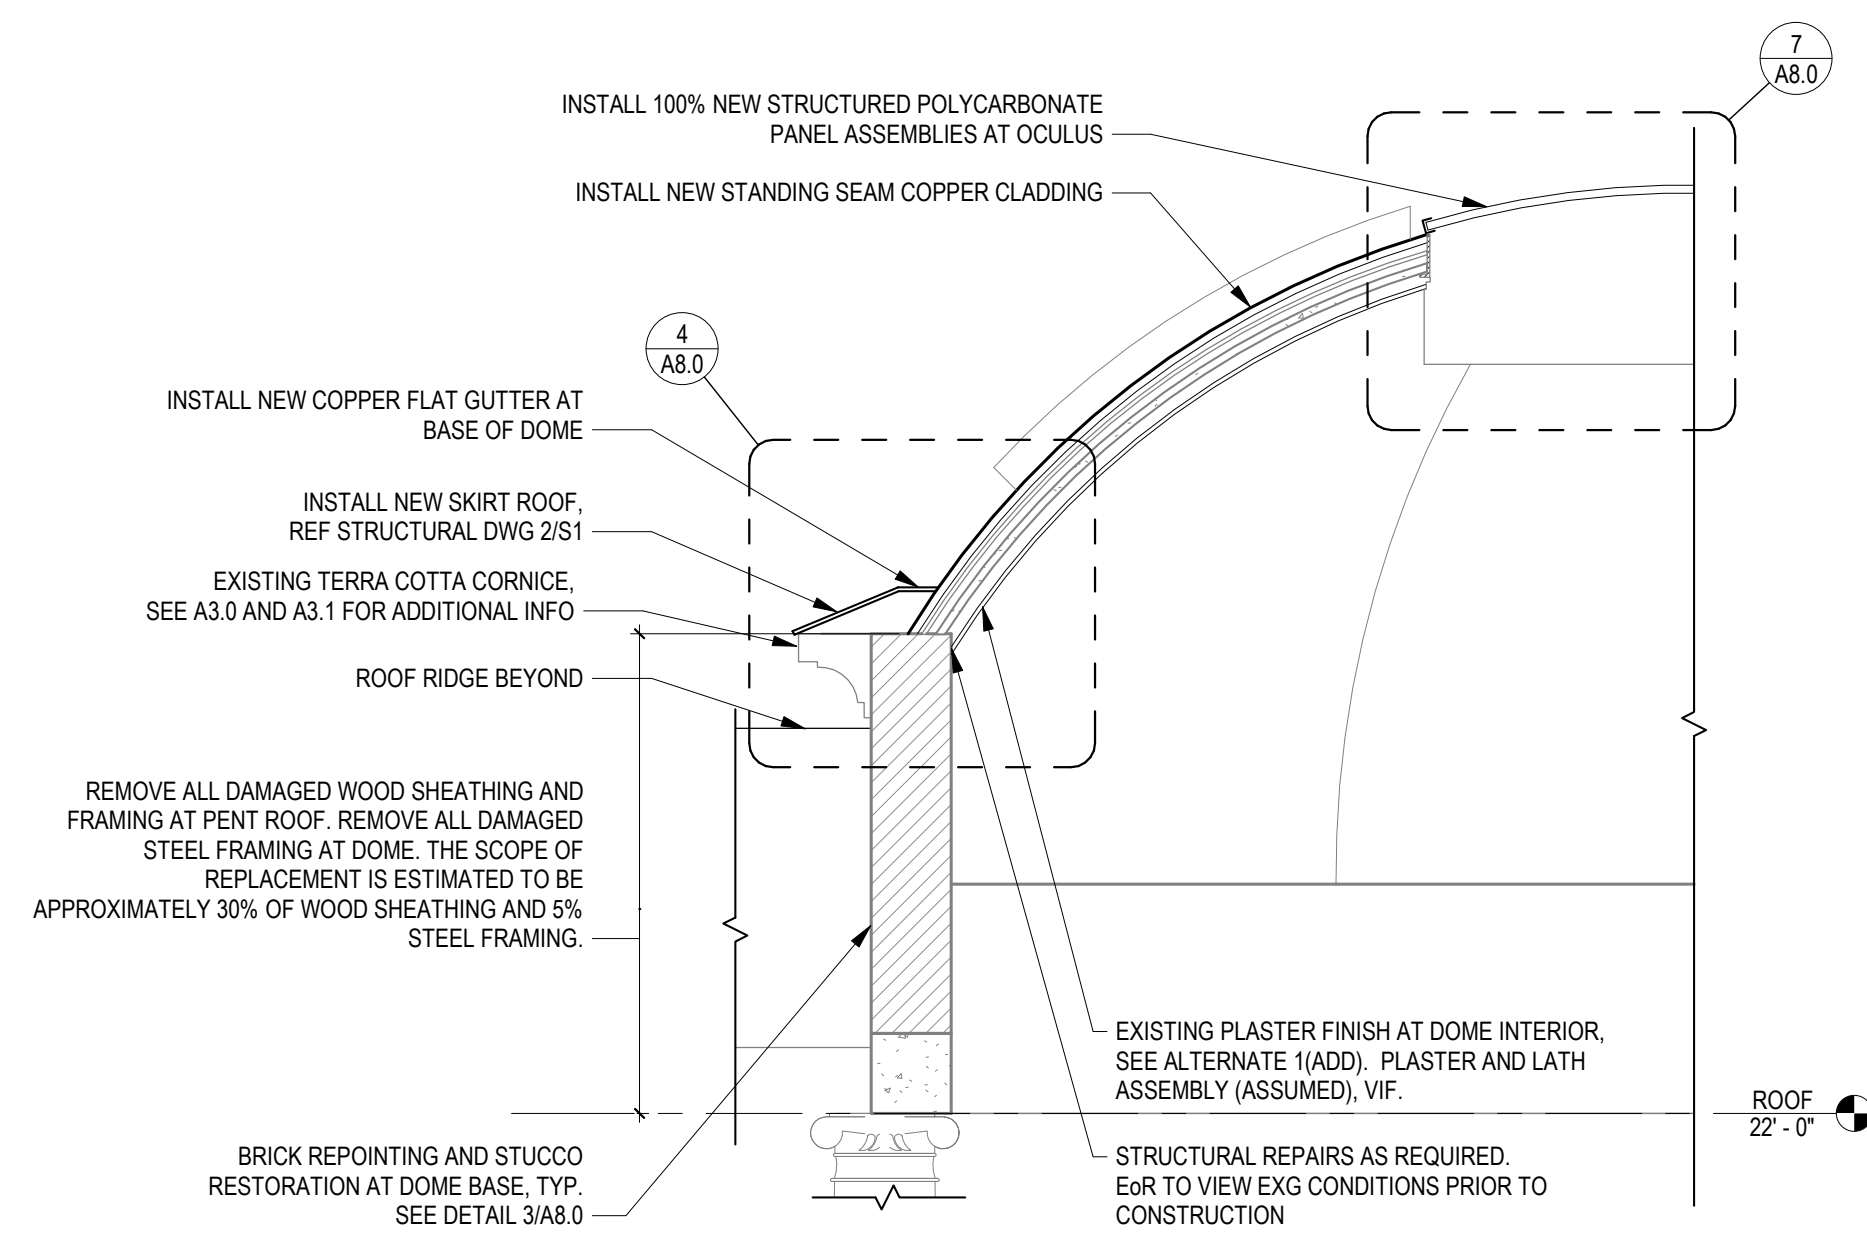

3 SECTION DIAGRAM THROUGH DOME  
A2.1 1/4" = 1'-0"

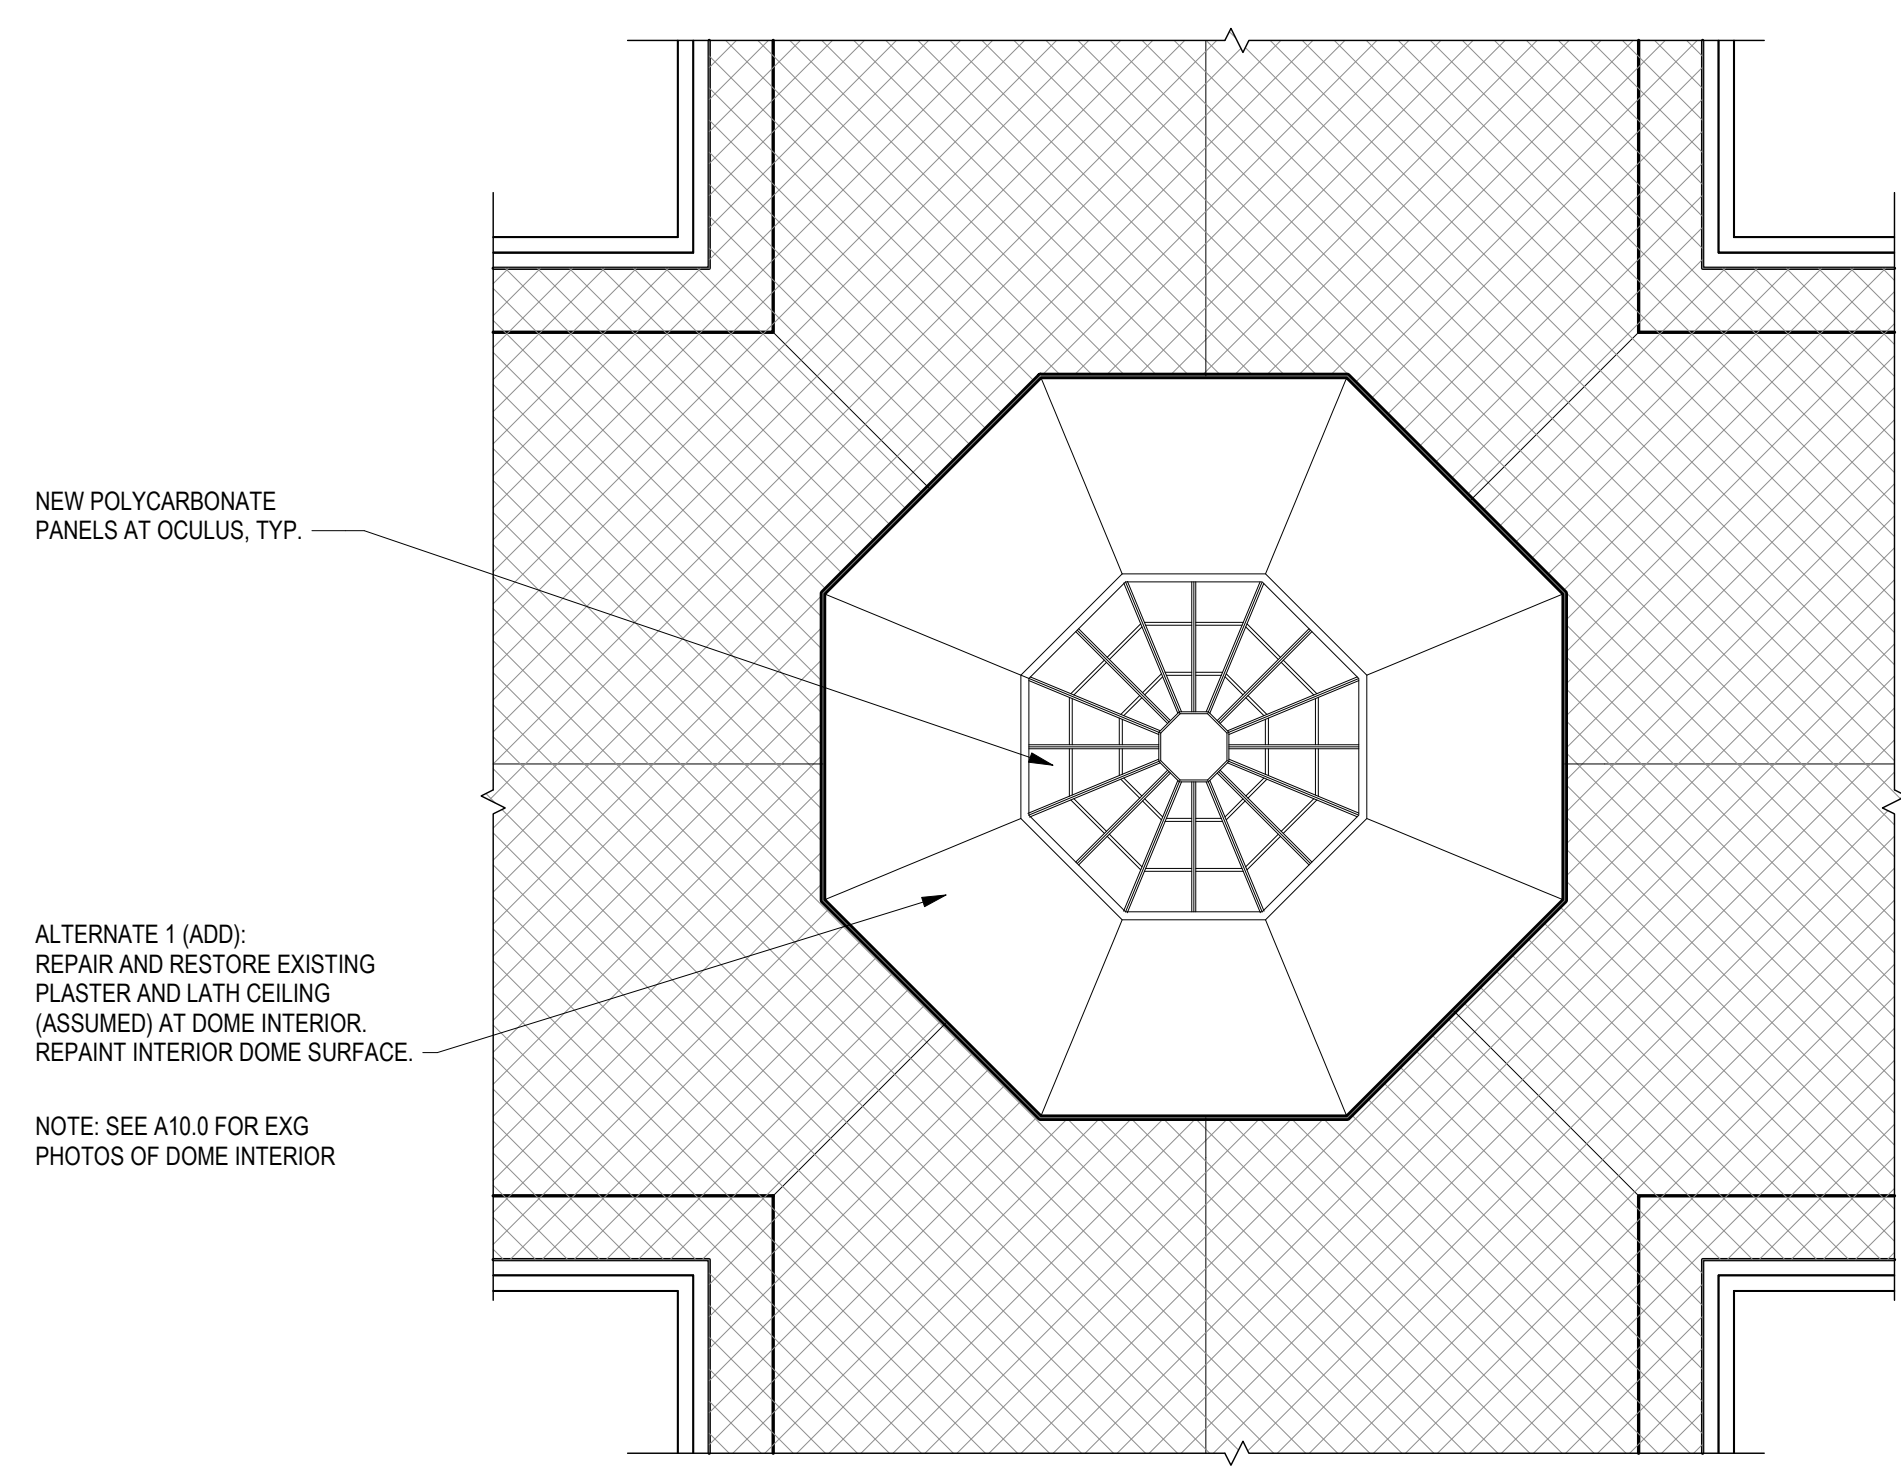





2 ALTERNATE 1(ADD) - REFLECTED CEILING PLAN AT DOME INTERIOR  
A2.1 1/8" = 1'-0"




**GENERAL NOTES:**


1. ALL EXG CONDITIONS AND DIMENSIONS TO BE VERIFIED IN FIELD PRIOR TO CONSTRUCTION.
2. SEE SHEET A0.1 FOR LIST OF ALTERNATES.
3. SEE CIVIL DRAWINGS FOR CONNECTIONS TO NEW DOWNSPOUT BOOT.
4. REPOINT 100% OF JOINTS BETWEEN TERRA COTTA UNITS.
5. COMPLETE STRUCTURAL REPAIRS AND REVIEW EXISTING CONDITIONS OF EXPOSED STRUCTURAL MEMBERS WITH ENGINEER OF RECORD PRIOR TO NEW CONSTRUCTION.

**LEGEND:**


-  PATCH AND REPAIR CRACKED AND SPALLING TERRA COTTA AT JOINTS AND SURFACES, TYP. SEE REPAIR DETAILS 1, 2 & 3 ON A8.1.
-  EXG TERRA COTTA UNITS TO BE REPLACED WITH NEW
-  BRICK
-  CMU

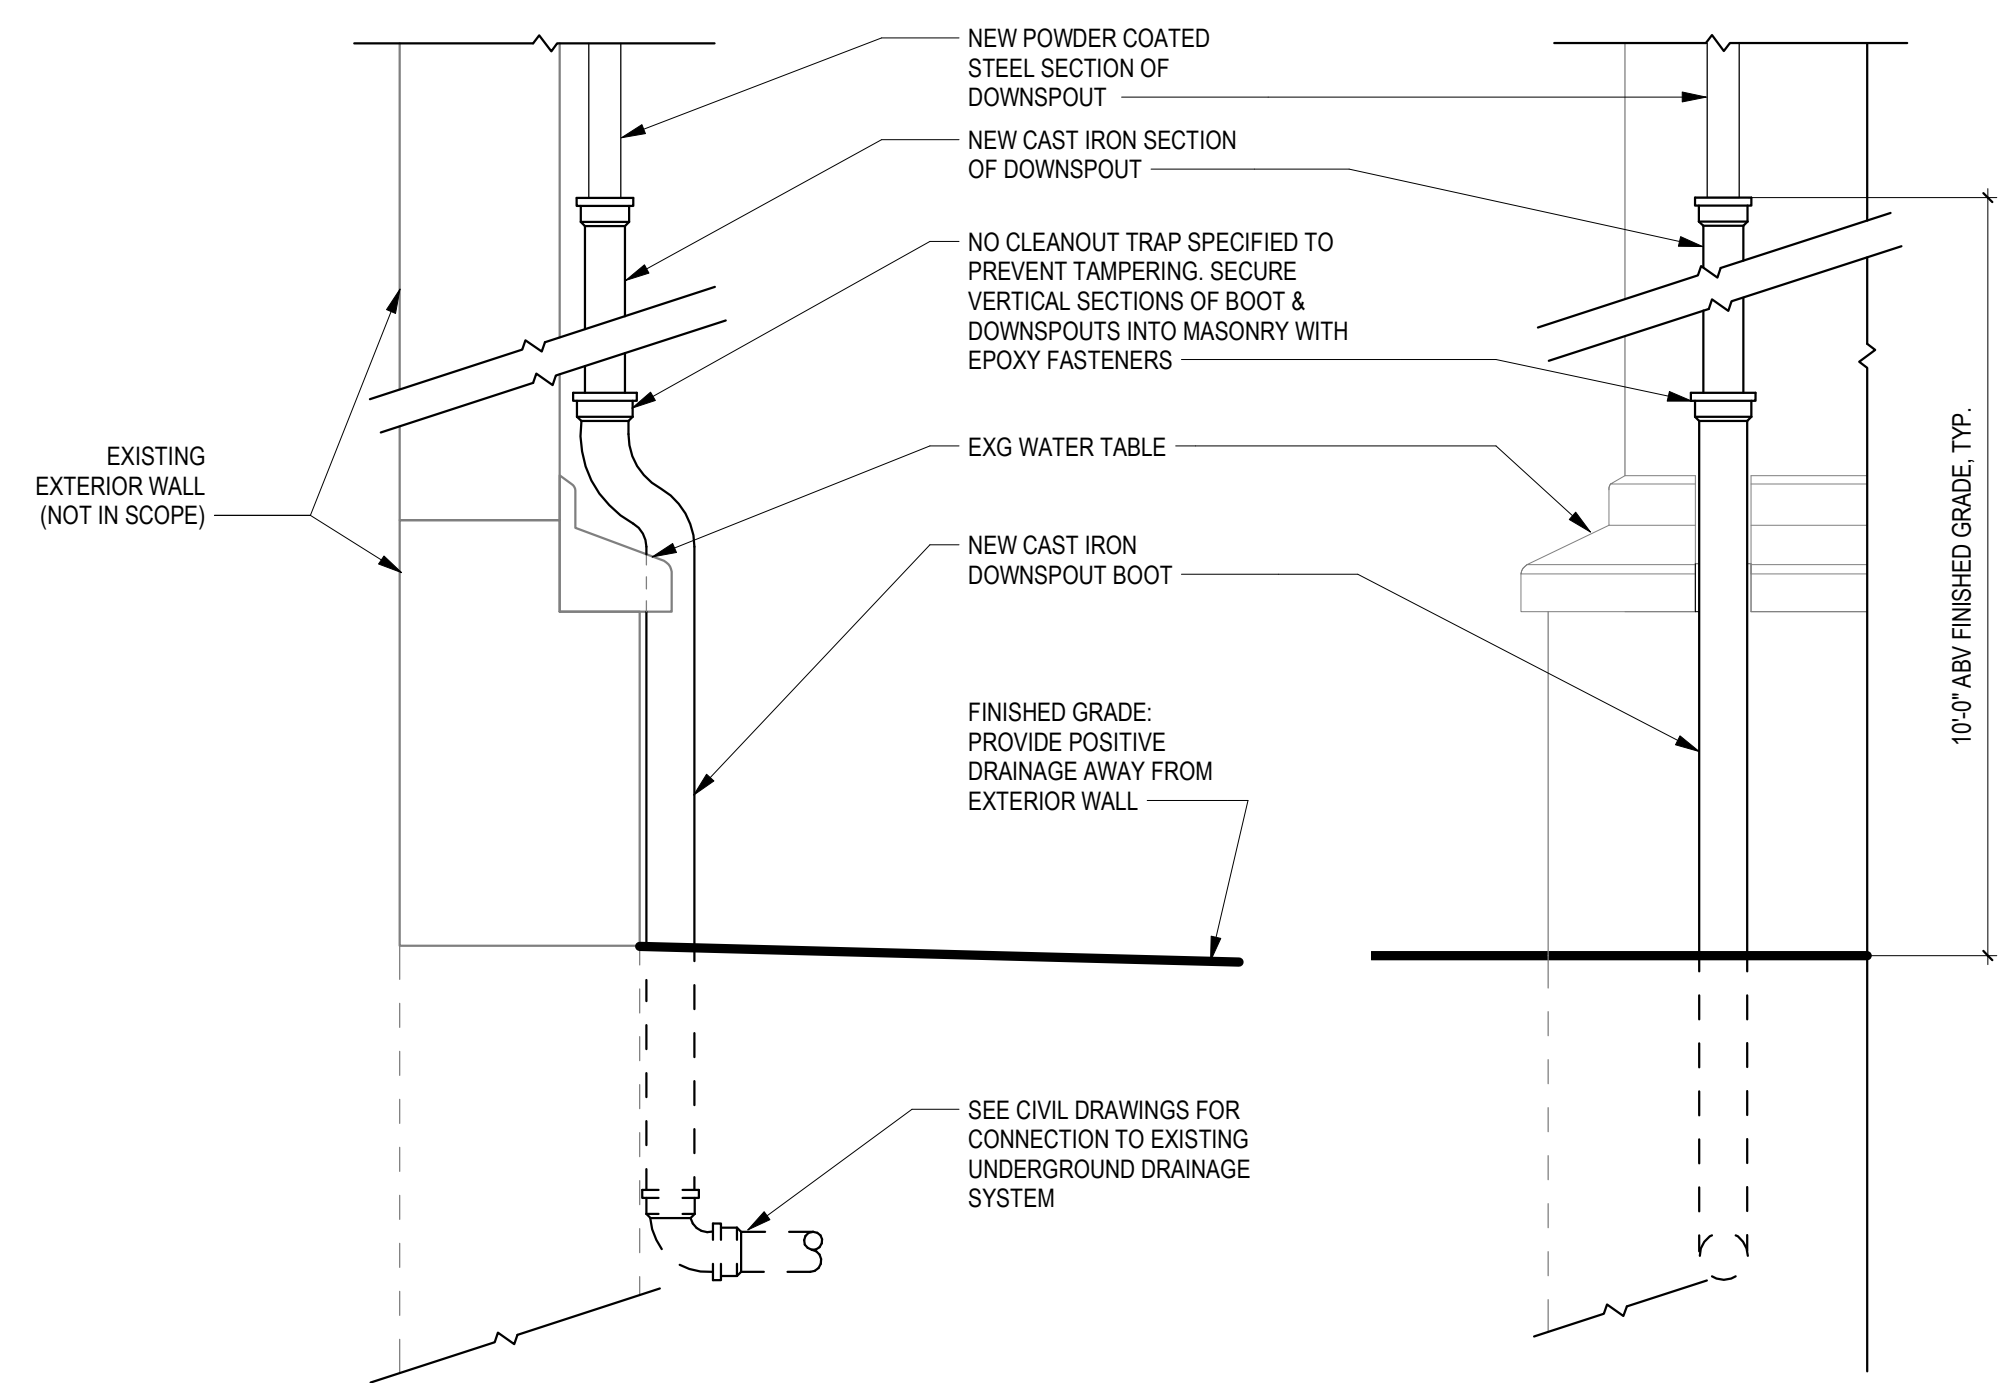

4 ENLARGED ELEVATION AT DOWNSPOUT: SIDE VIEW  
A3.0 1/2" = 1'-0"

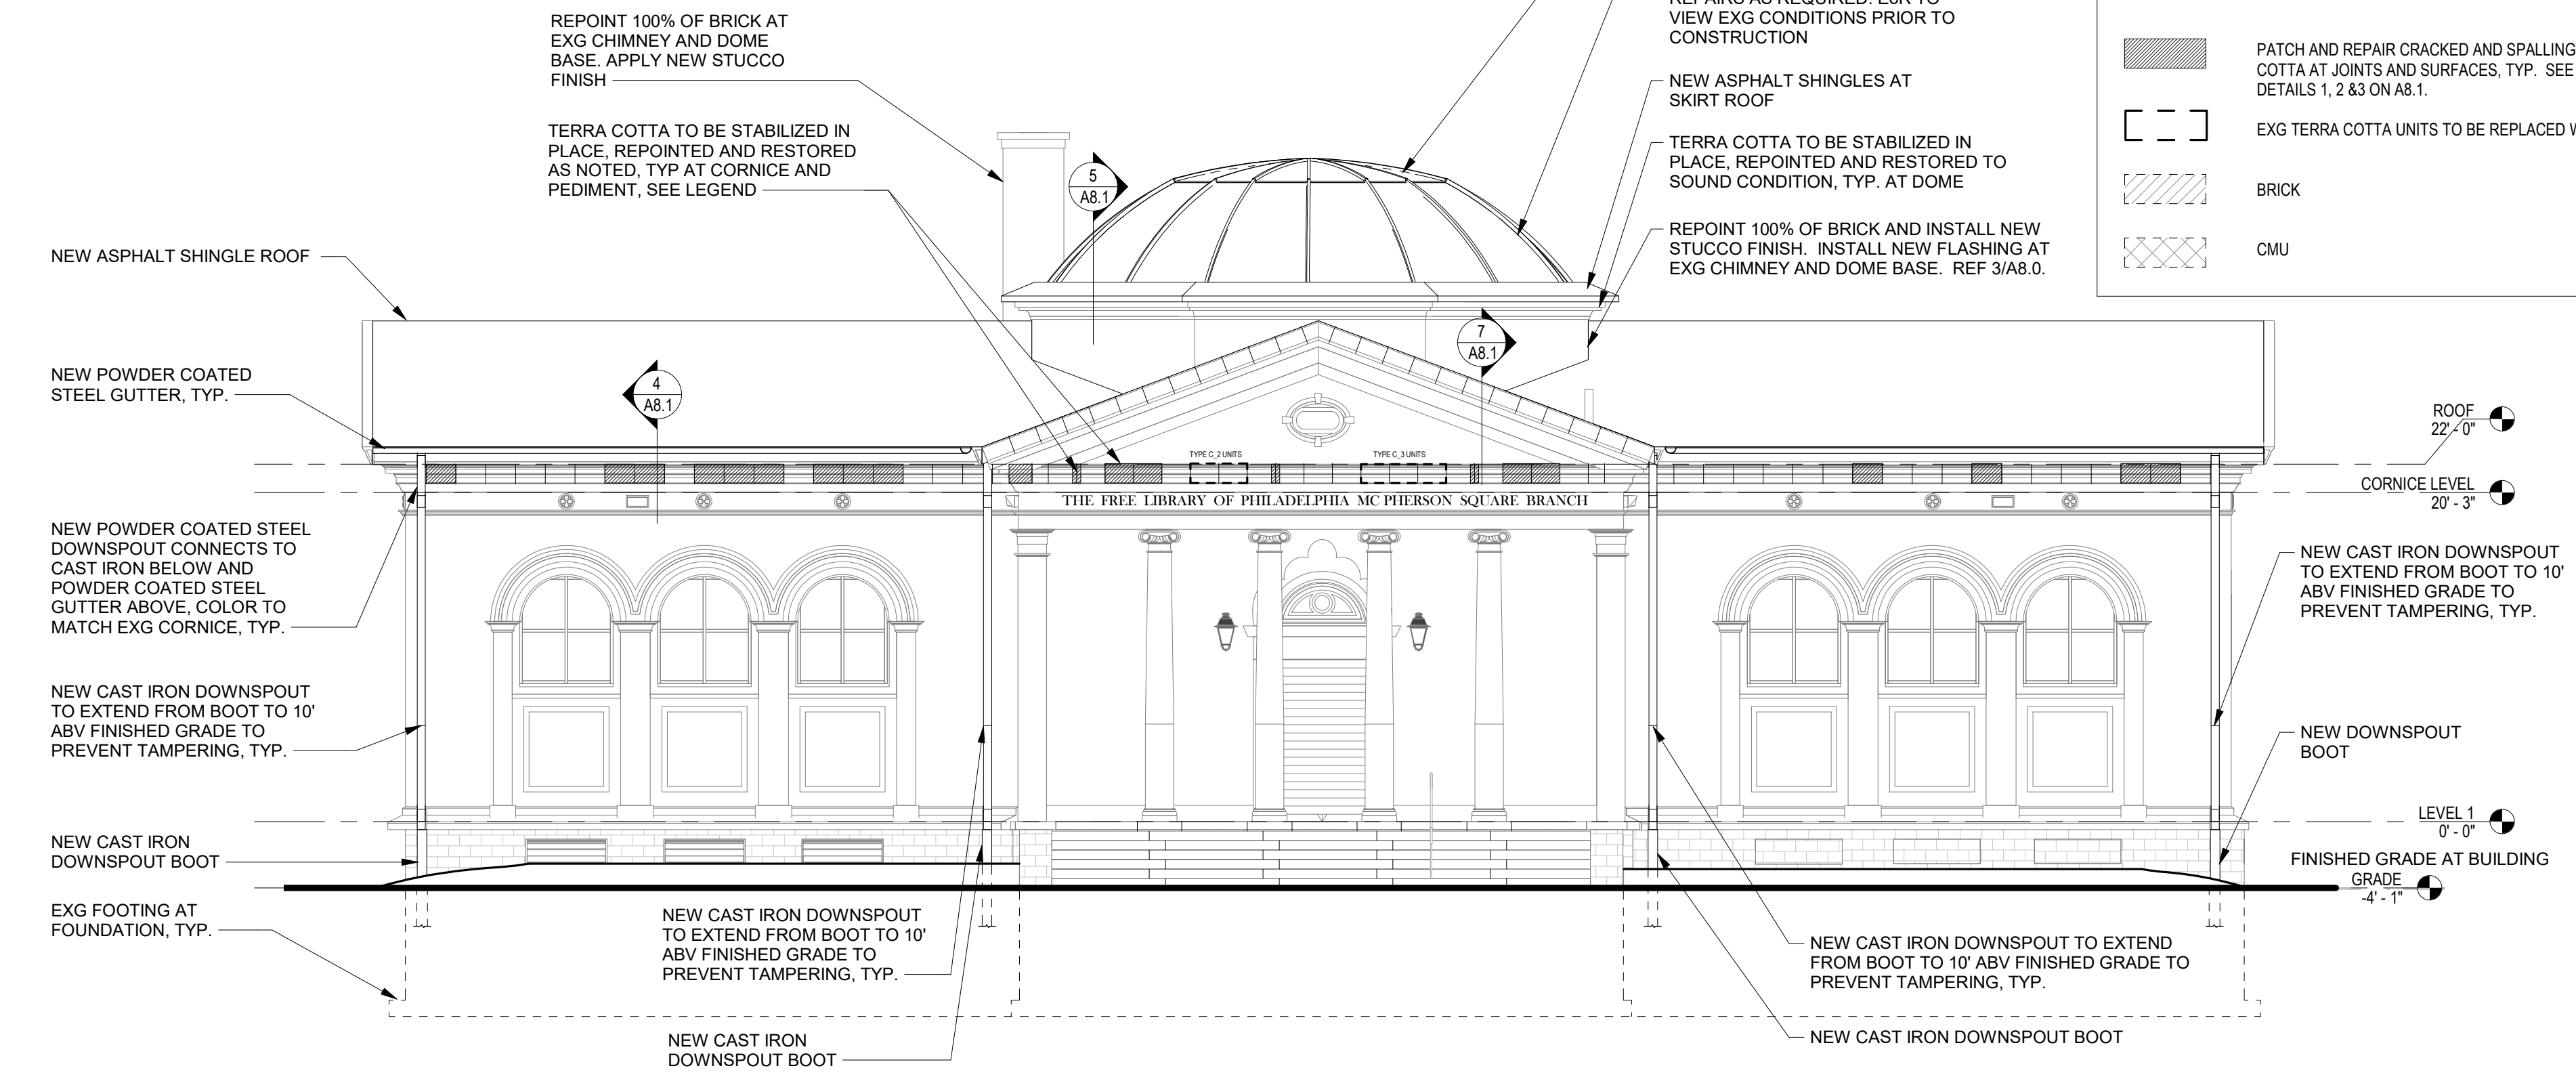

2 SOUTH (FRONT) ELEVATION  
A3.0 1/8" = 1'-0"

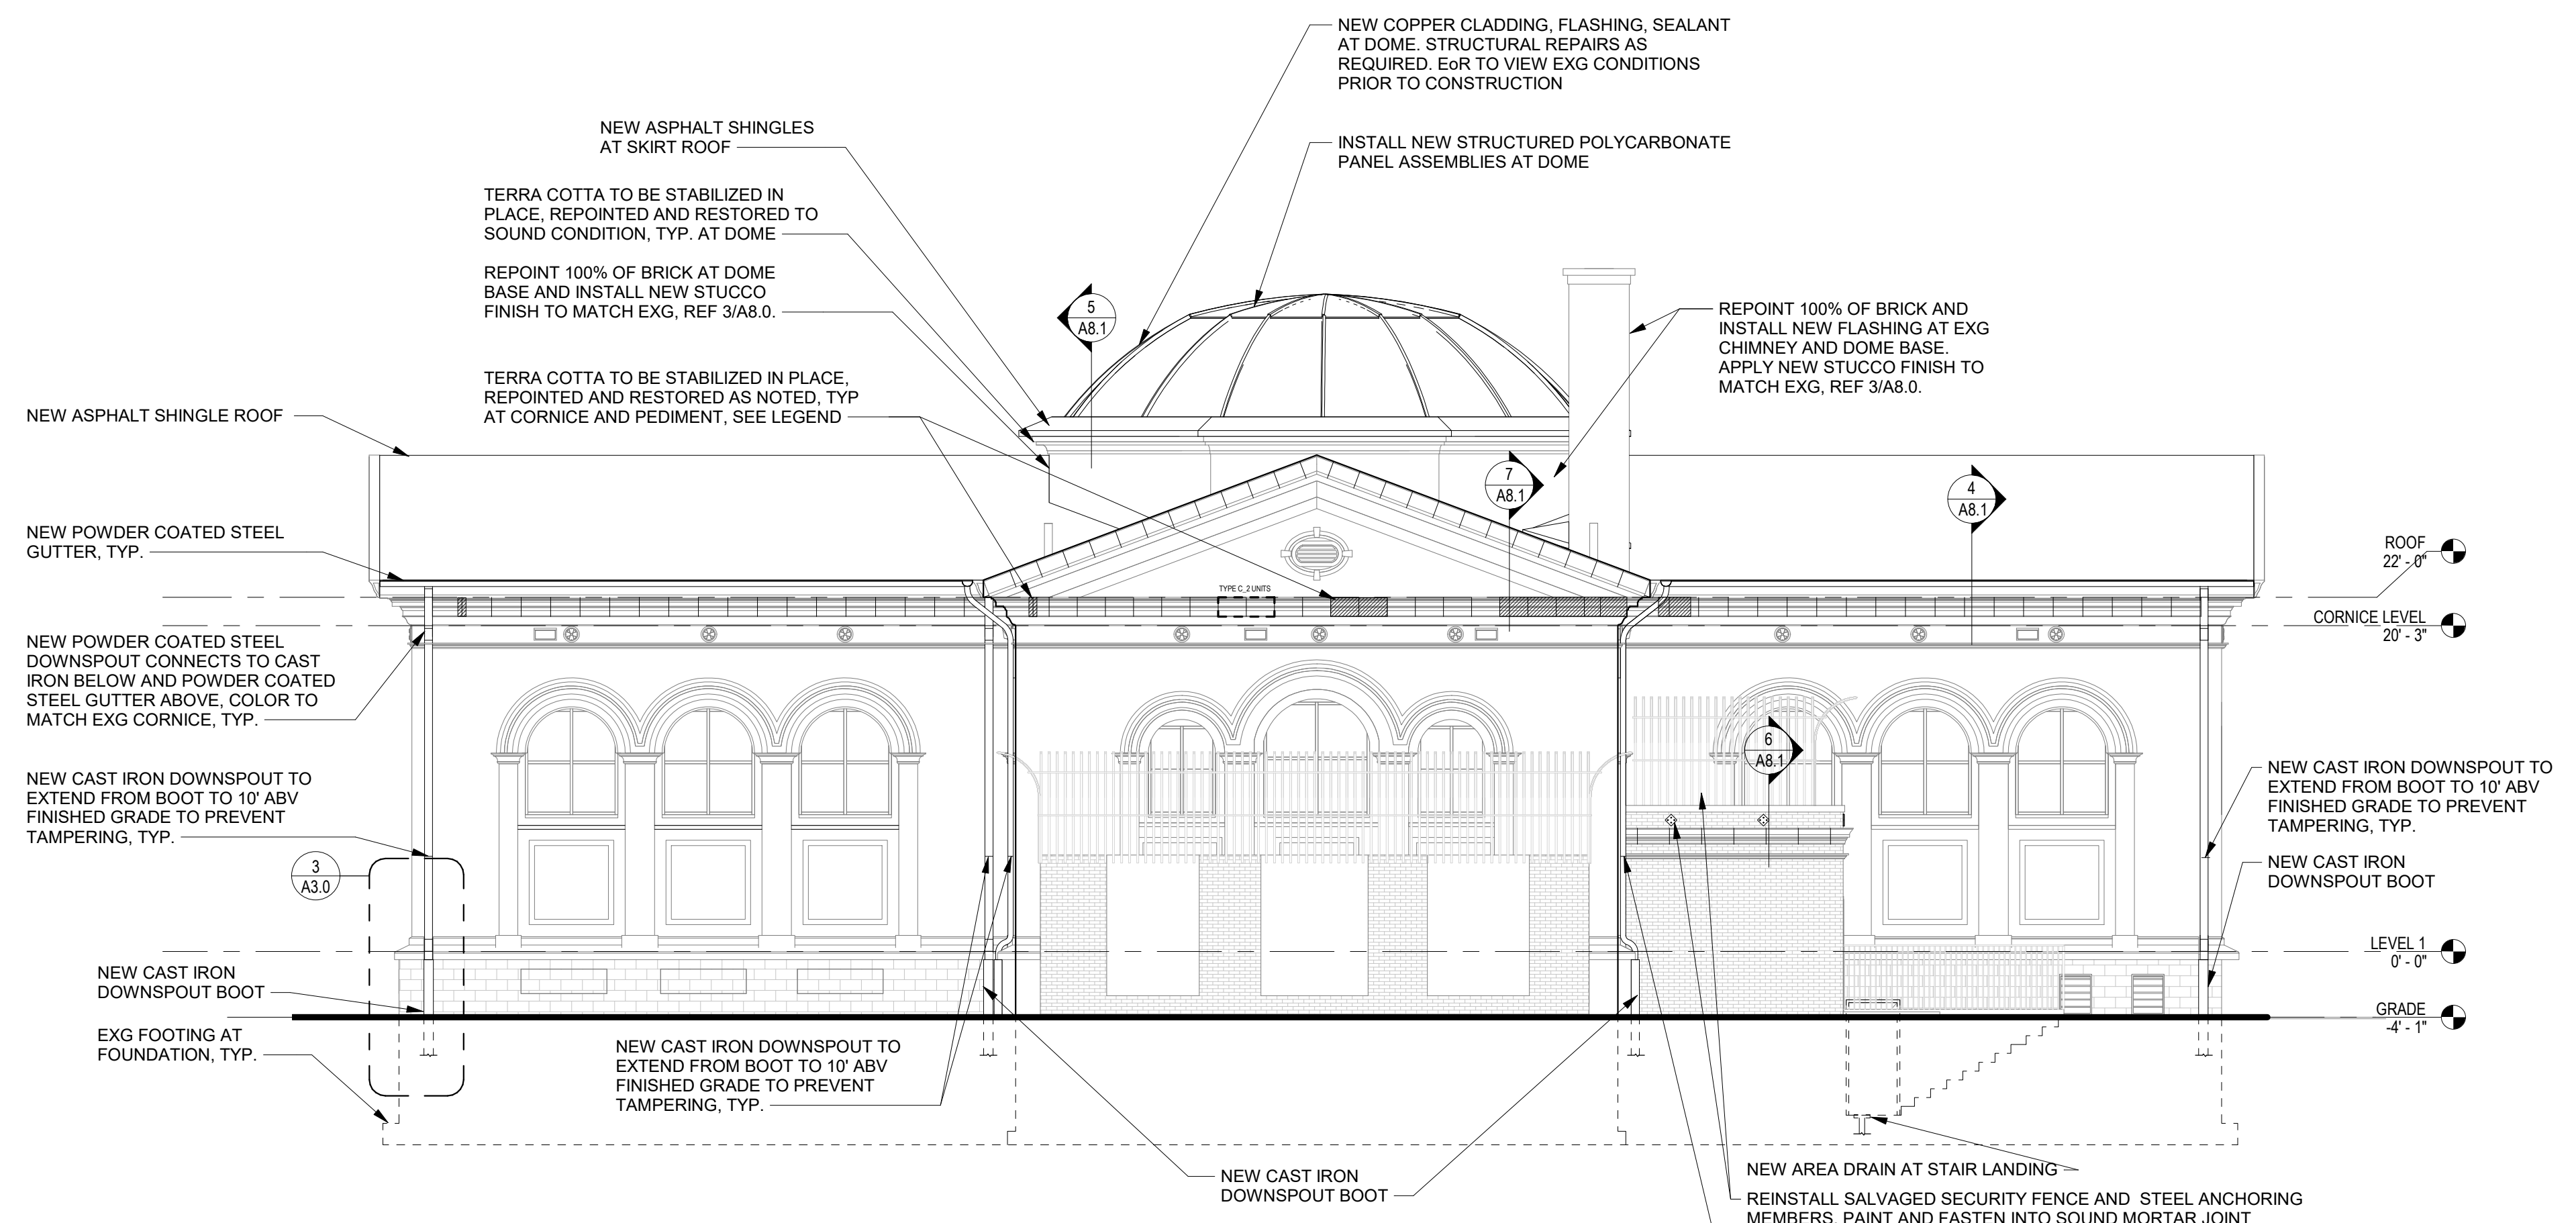

1 NORTH (REAR) ELEVATION  
A3.0 1/8" = 1'-0"

3 ENLARGED ELEVATION AT DOWNSPOUT: FRONT VIEW  
A3.0 1/2" = 1'-0"




**GENERAL NOTES:**


1. ALL EXG CONDITIONS AND DIMENSIONS TO BE VERIFIED IN FIELD PRIOR TO CONSTRUCTION.
2. SEE SHEET A0.1 FOR LIST OF ALTERNATES.
3. SEE CIVIL DRAWINGS FOR CONNECTIONS TO NEW DOWNSPOUT BOOT.
4. REPOINT 100% OF JOINTS BETWEEN TERRA COTTA UNITS.
5. COMPLETE STRUCTURAL REPAIRS AND REVIEW EXISTING CONDITIONS OF EXPOSED STRUCTURAL MEMBERS WITH ENGINEER OF RECORD PRIOR TO NEW CONSTRUCTION.

**LEGEND:**

	PATCH AND REPAIR CRACKED AND SPALLING TERRA COTTA AT JOINTS AND SURFACES. TYP. SEE REPAIR DETAILS 1, 2 & 3 ON A8.1.
	EXG TERRA COTTA UNITS TO BE REPLACED WITH NEW
	BRICK
	CMU

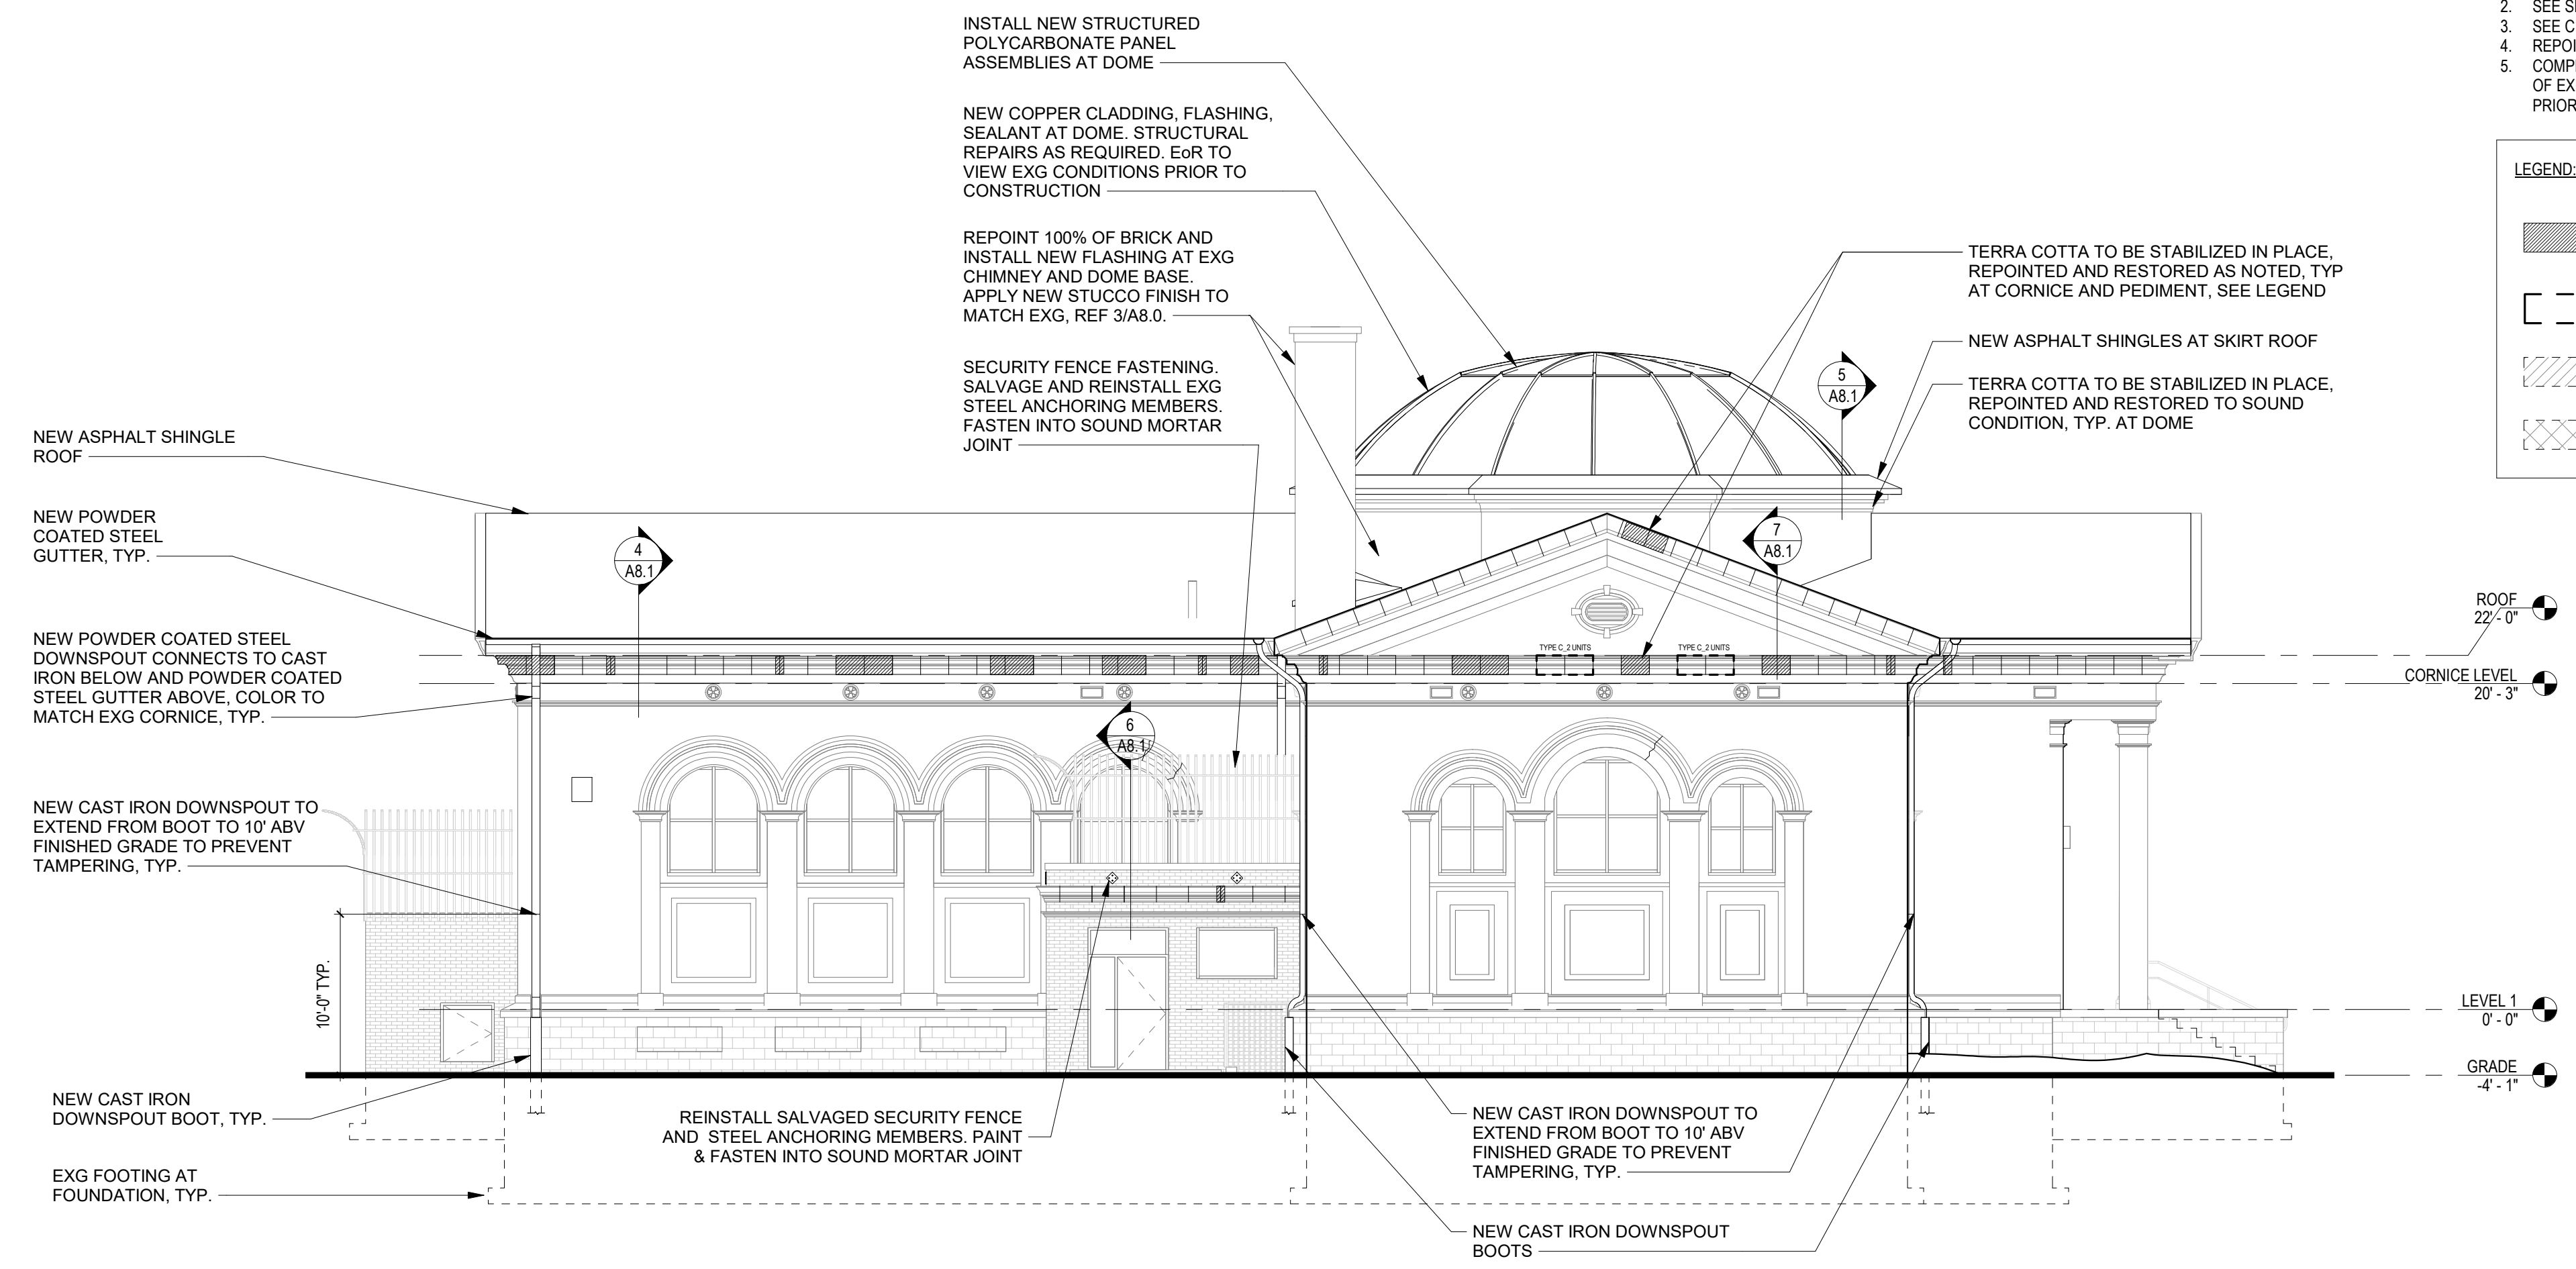


2 WEST ELEVATION  
A3.1 1/8" = 1'-0"

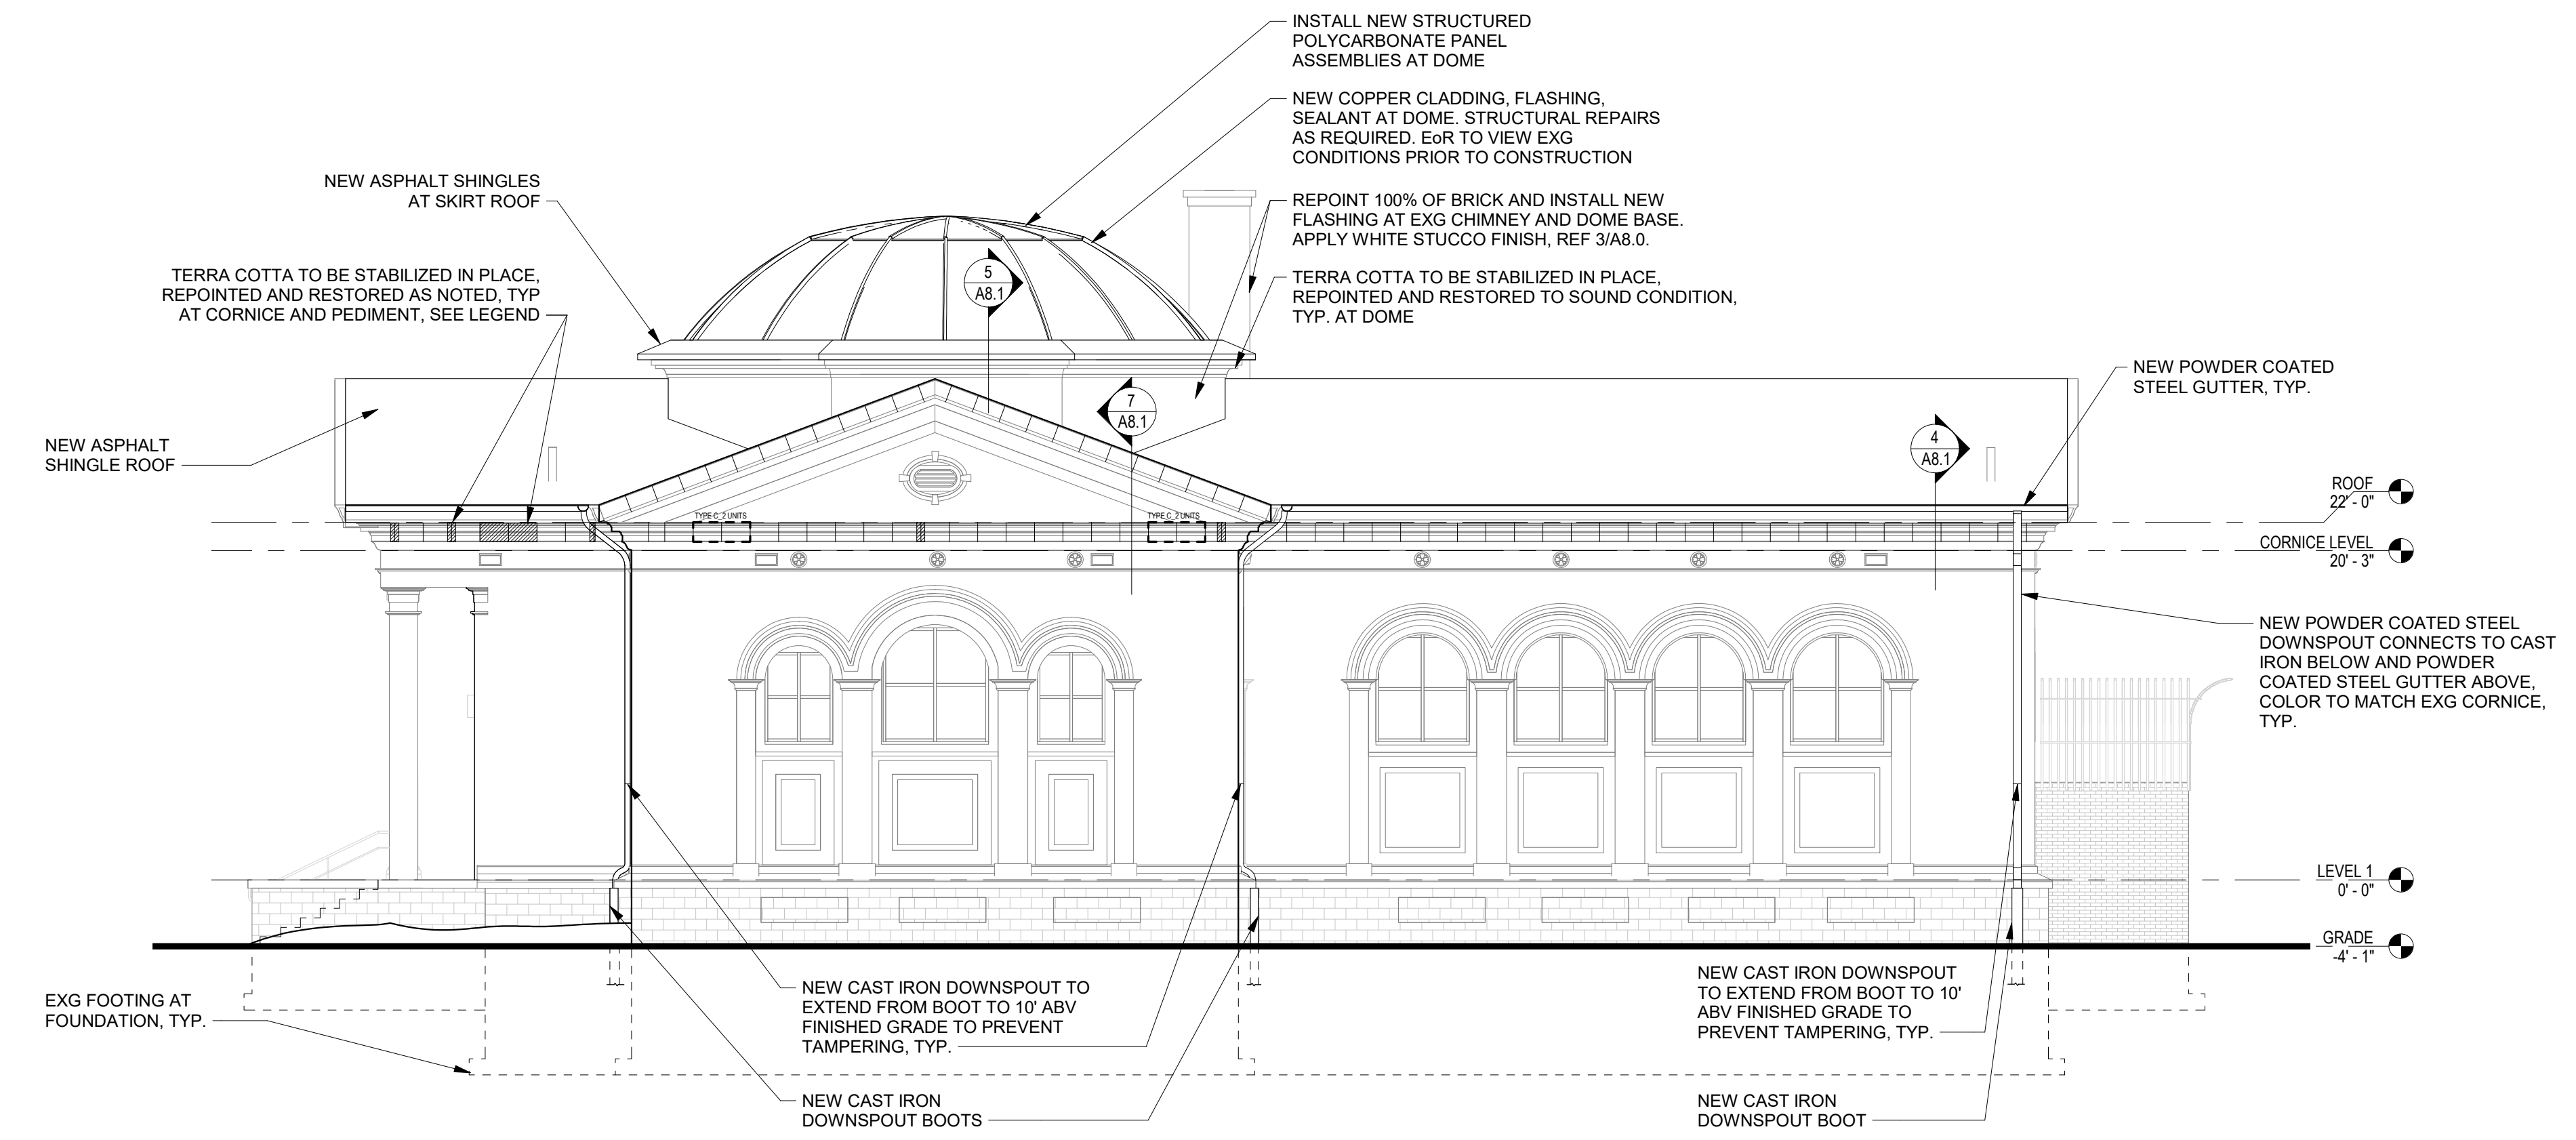


1 EAST ELEVATION  
A3.1 1/8" = 1'-0"





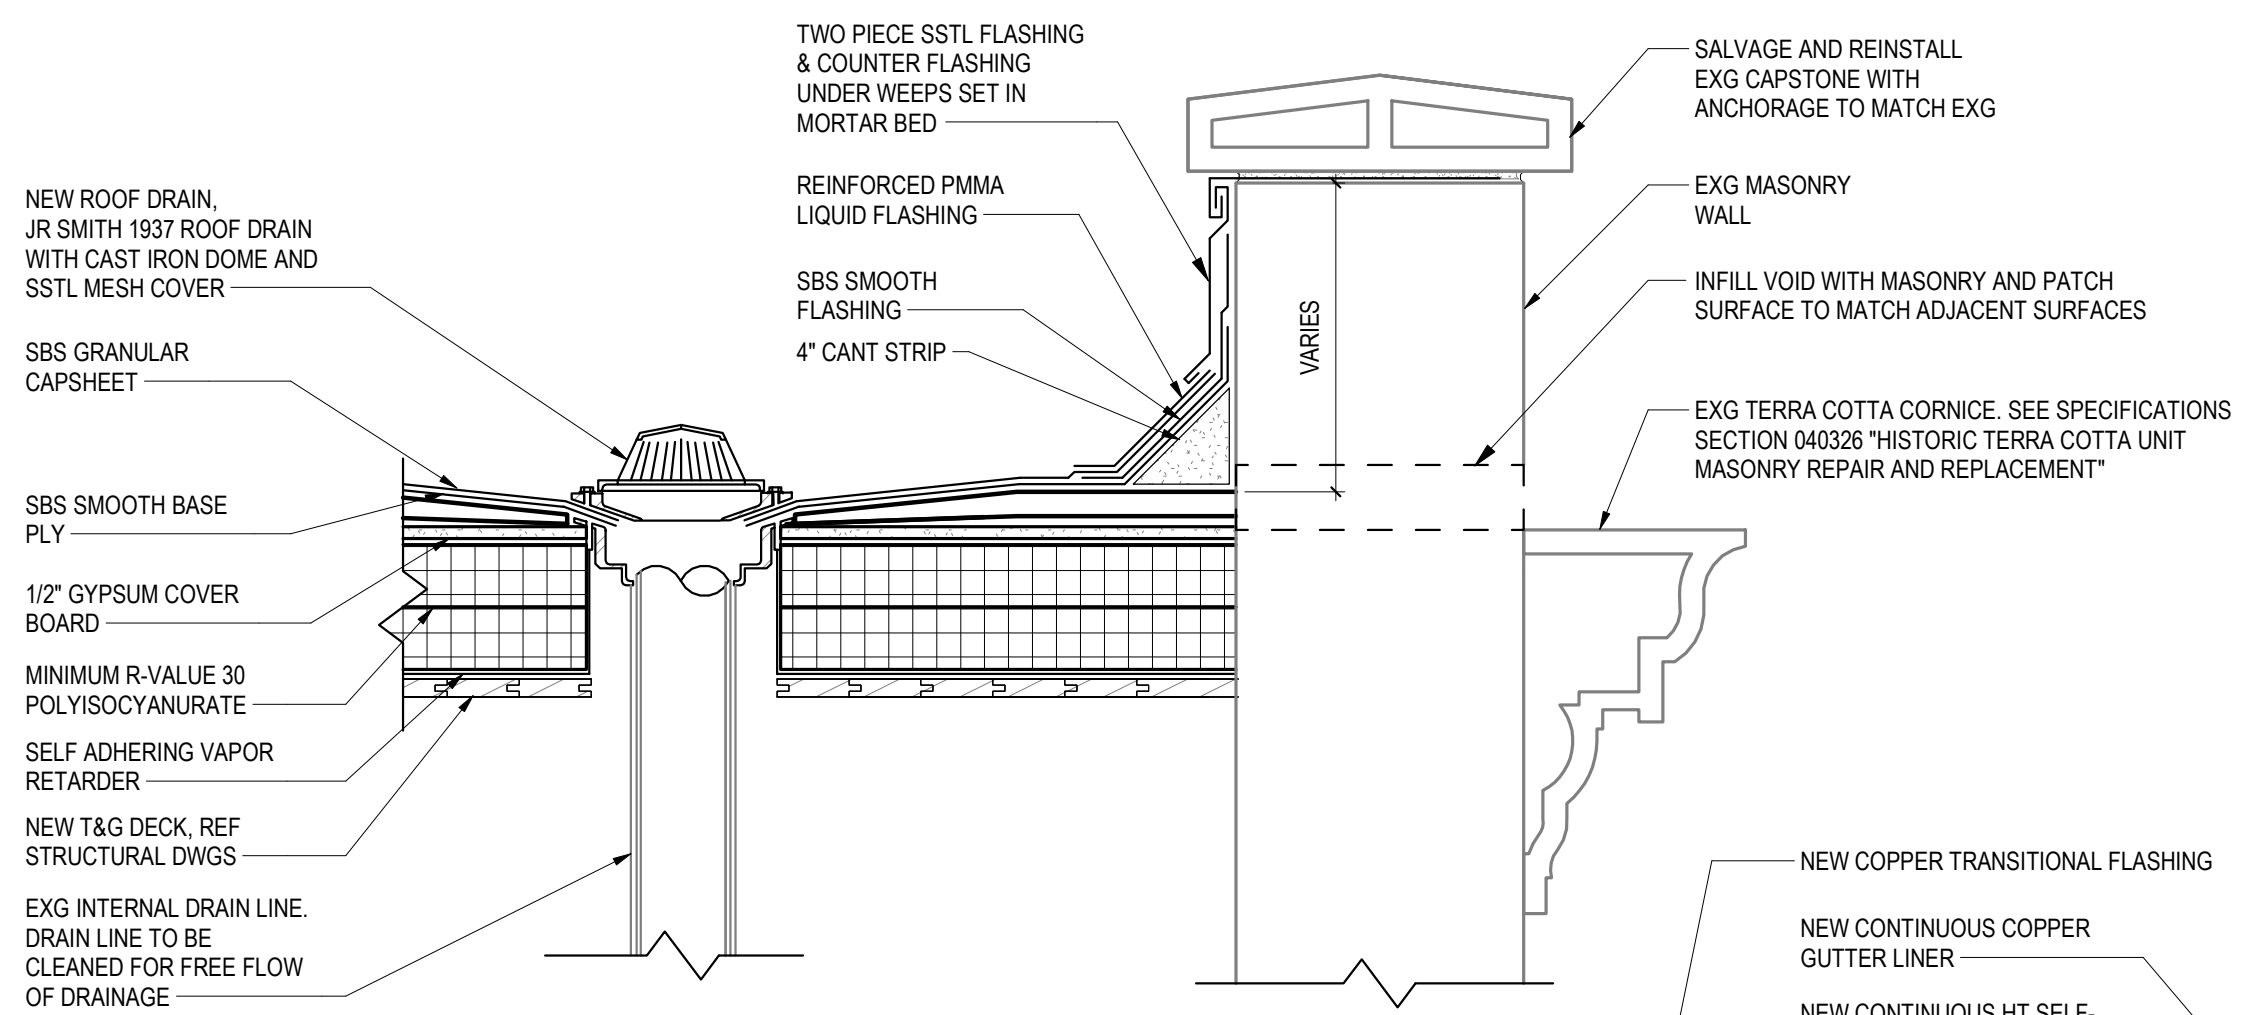


**8 ROOF DRAIN AT SBS ROOF**  
A8.0 1 1/2" = 1'-0"

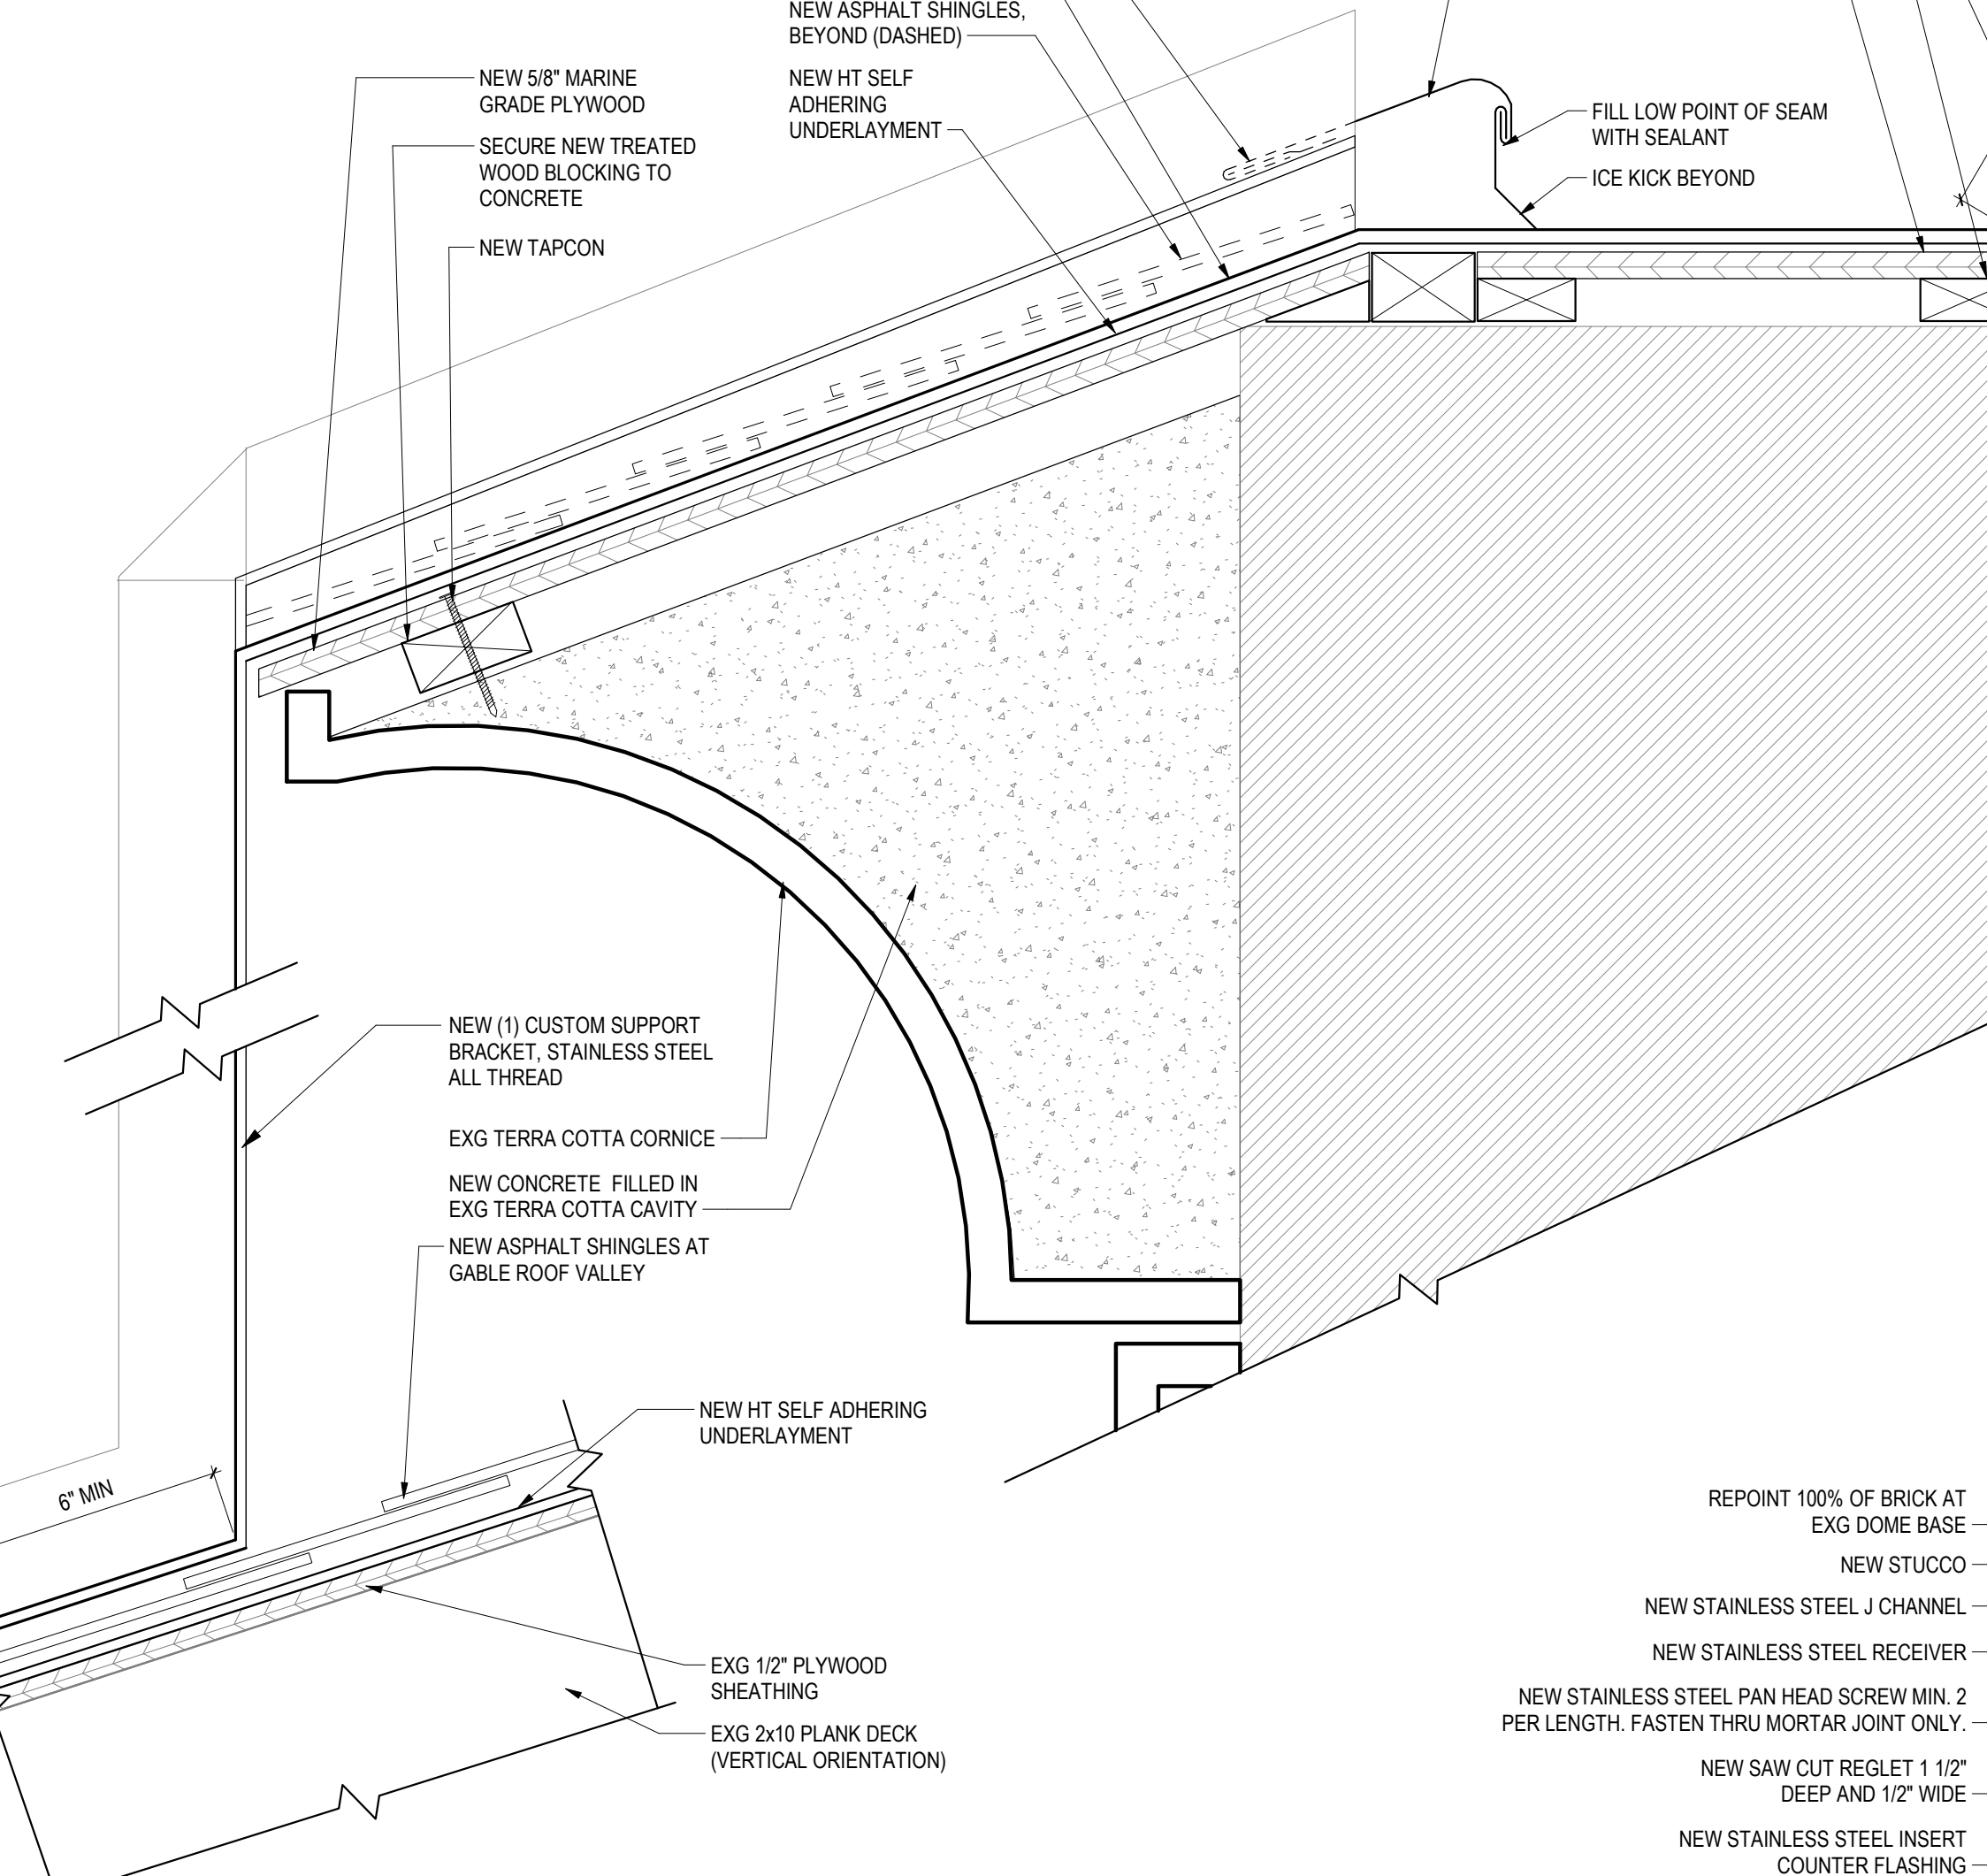


**5 ROOF DETAIL - OPEN PAN GUTTER FROM DOME SKIRT TO GABLE VALLEY**  
A8.0 3" = 1'-0"

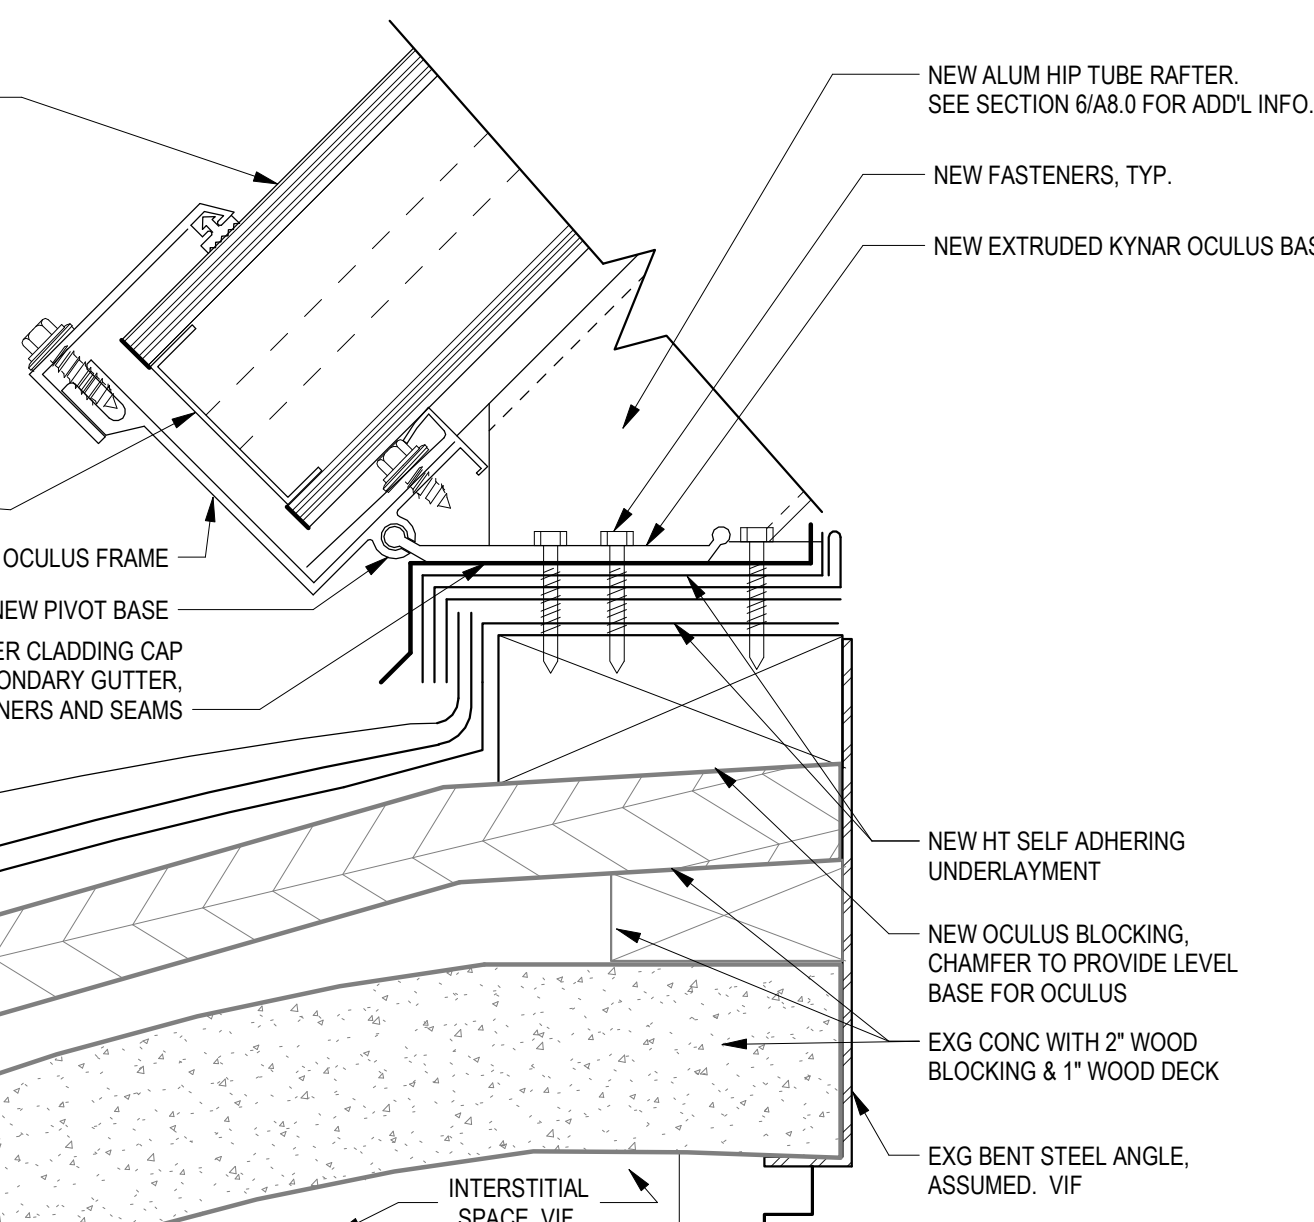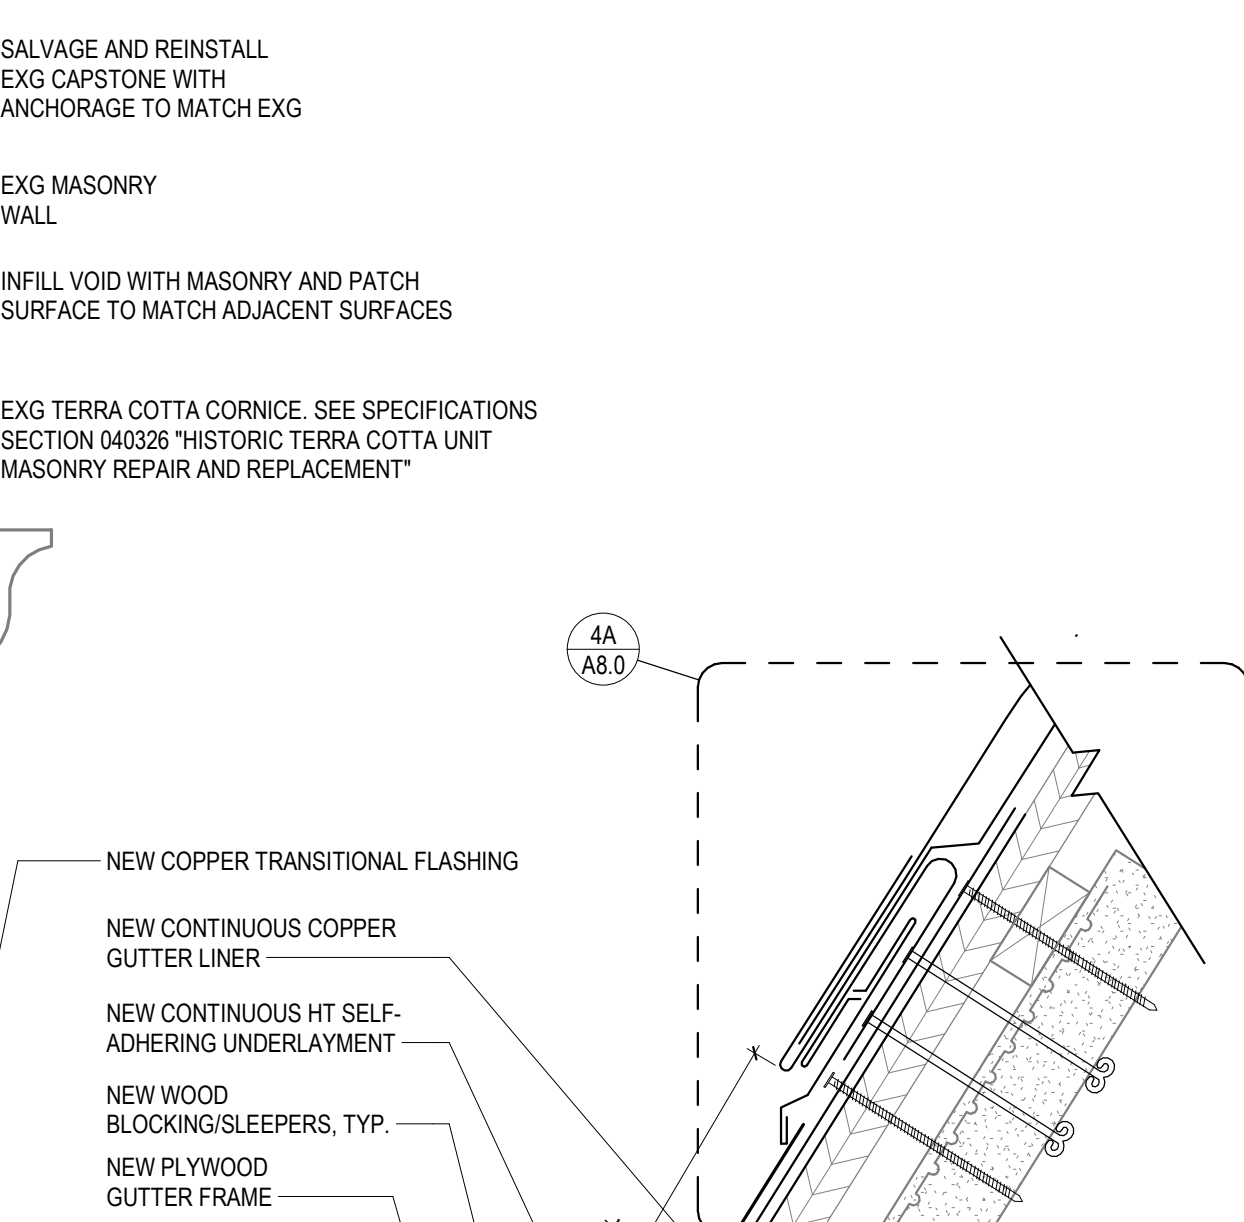


**7 DOME CLADDING TO OCULUS CURB**  
A8.0 6" = 1'-0"

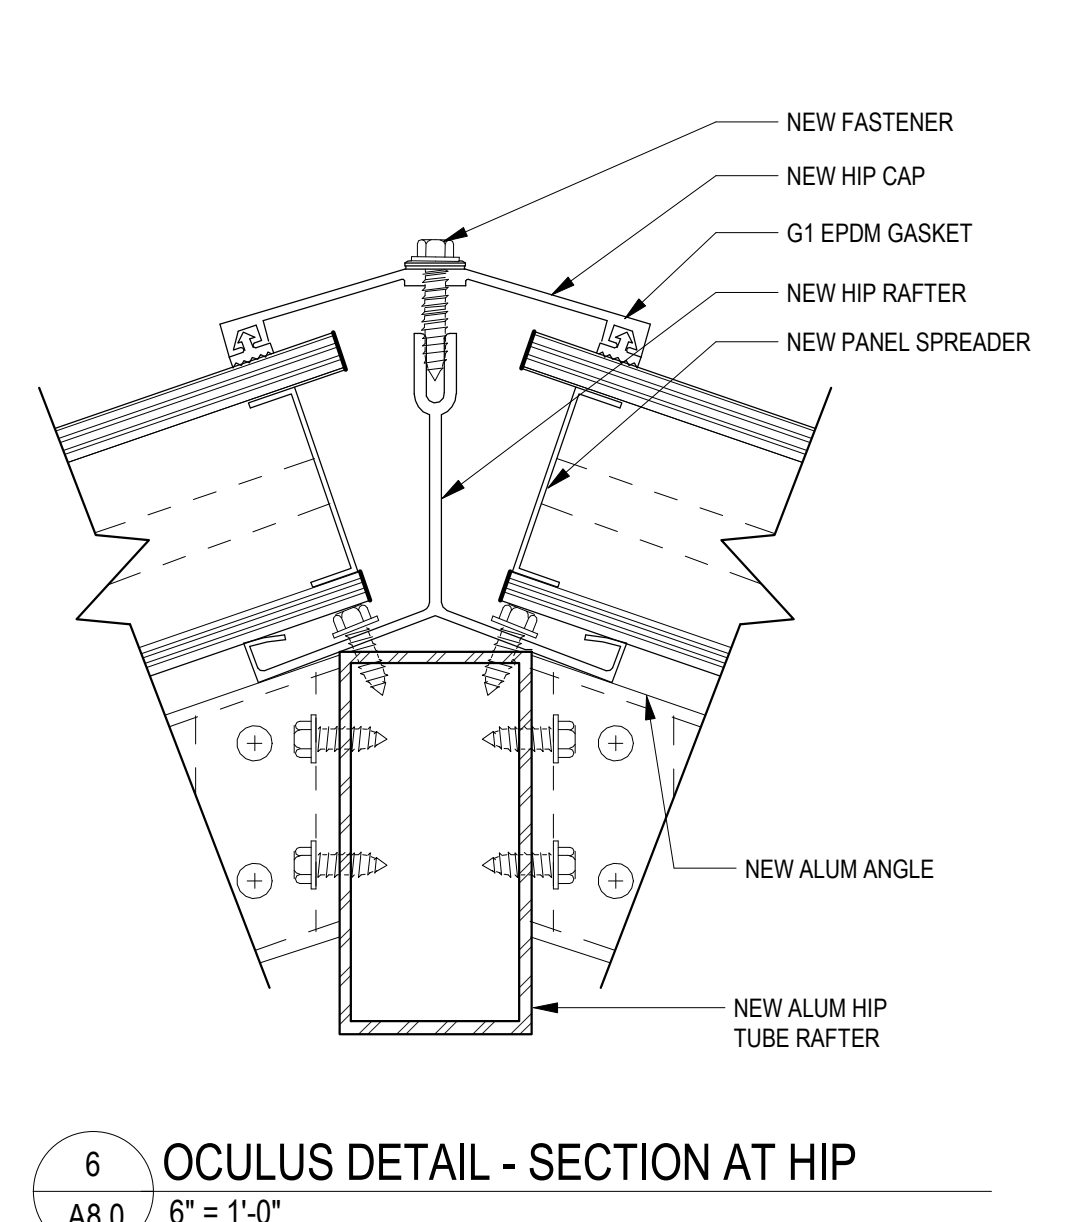


**6 OCULUS DETAIL - SECTION AT HIP**  
A8.0 6" = 1'-0"

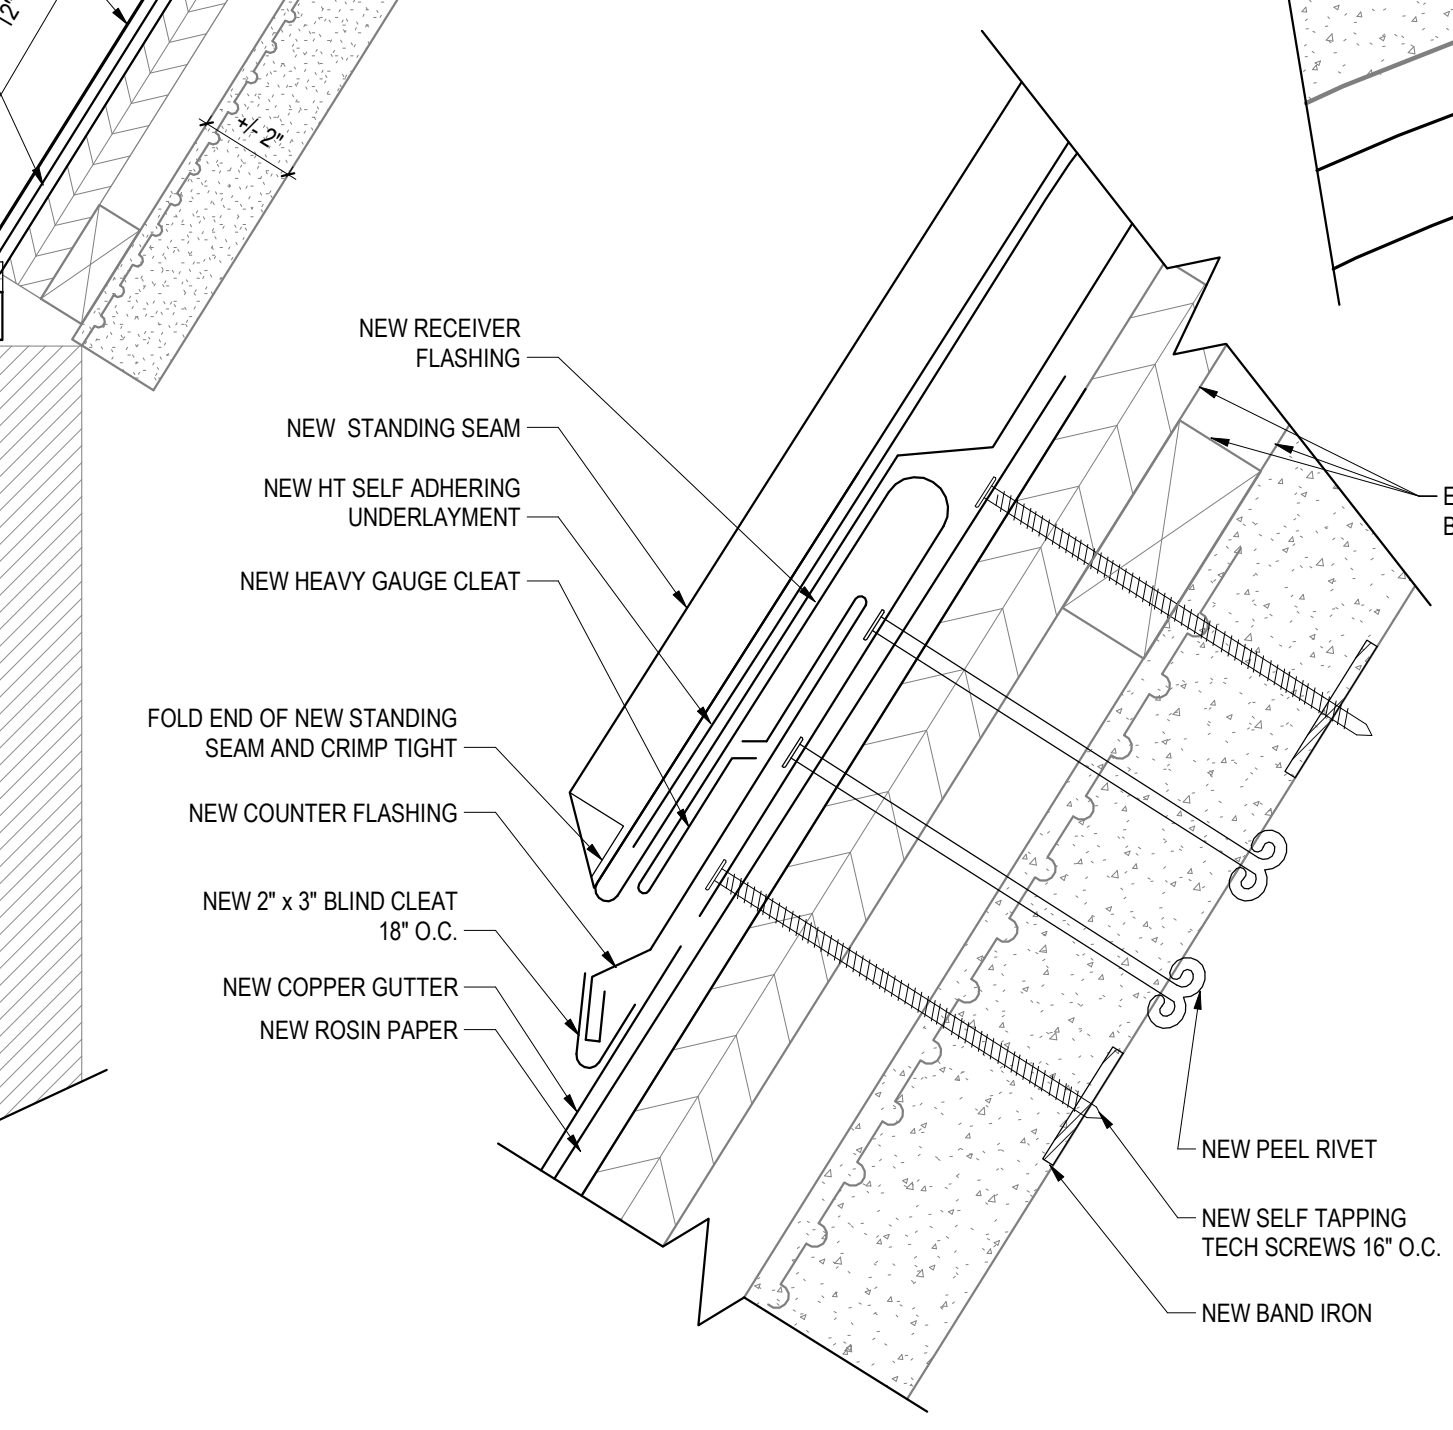


**4A ENLARGED GUTTER TO DOME TRANSITION**  
A8.0 6" = 1'-0"

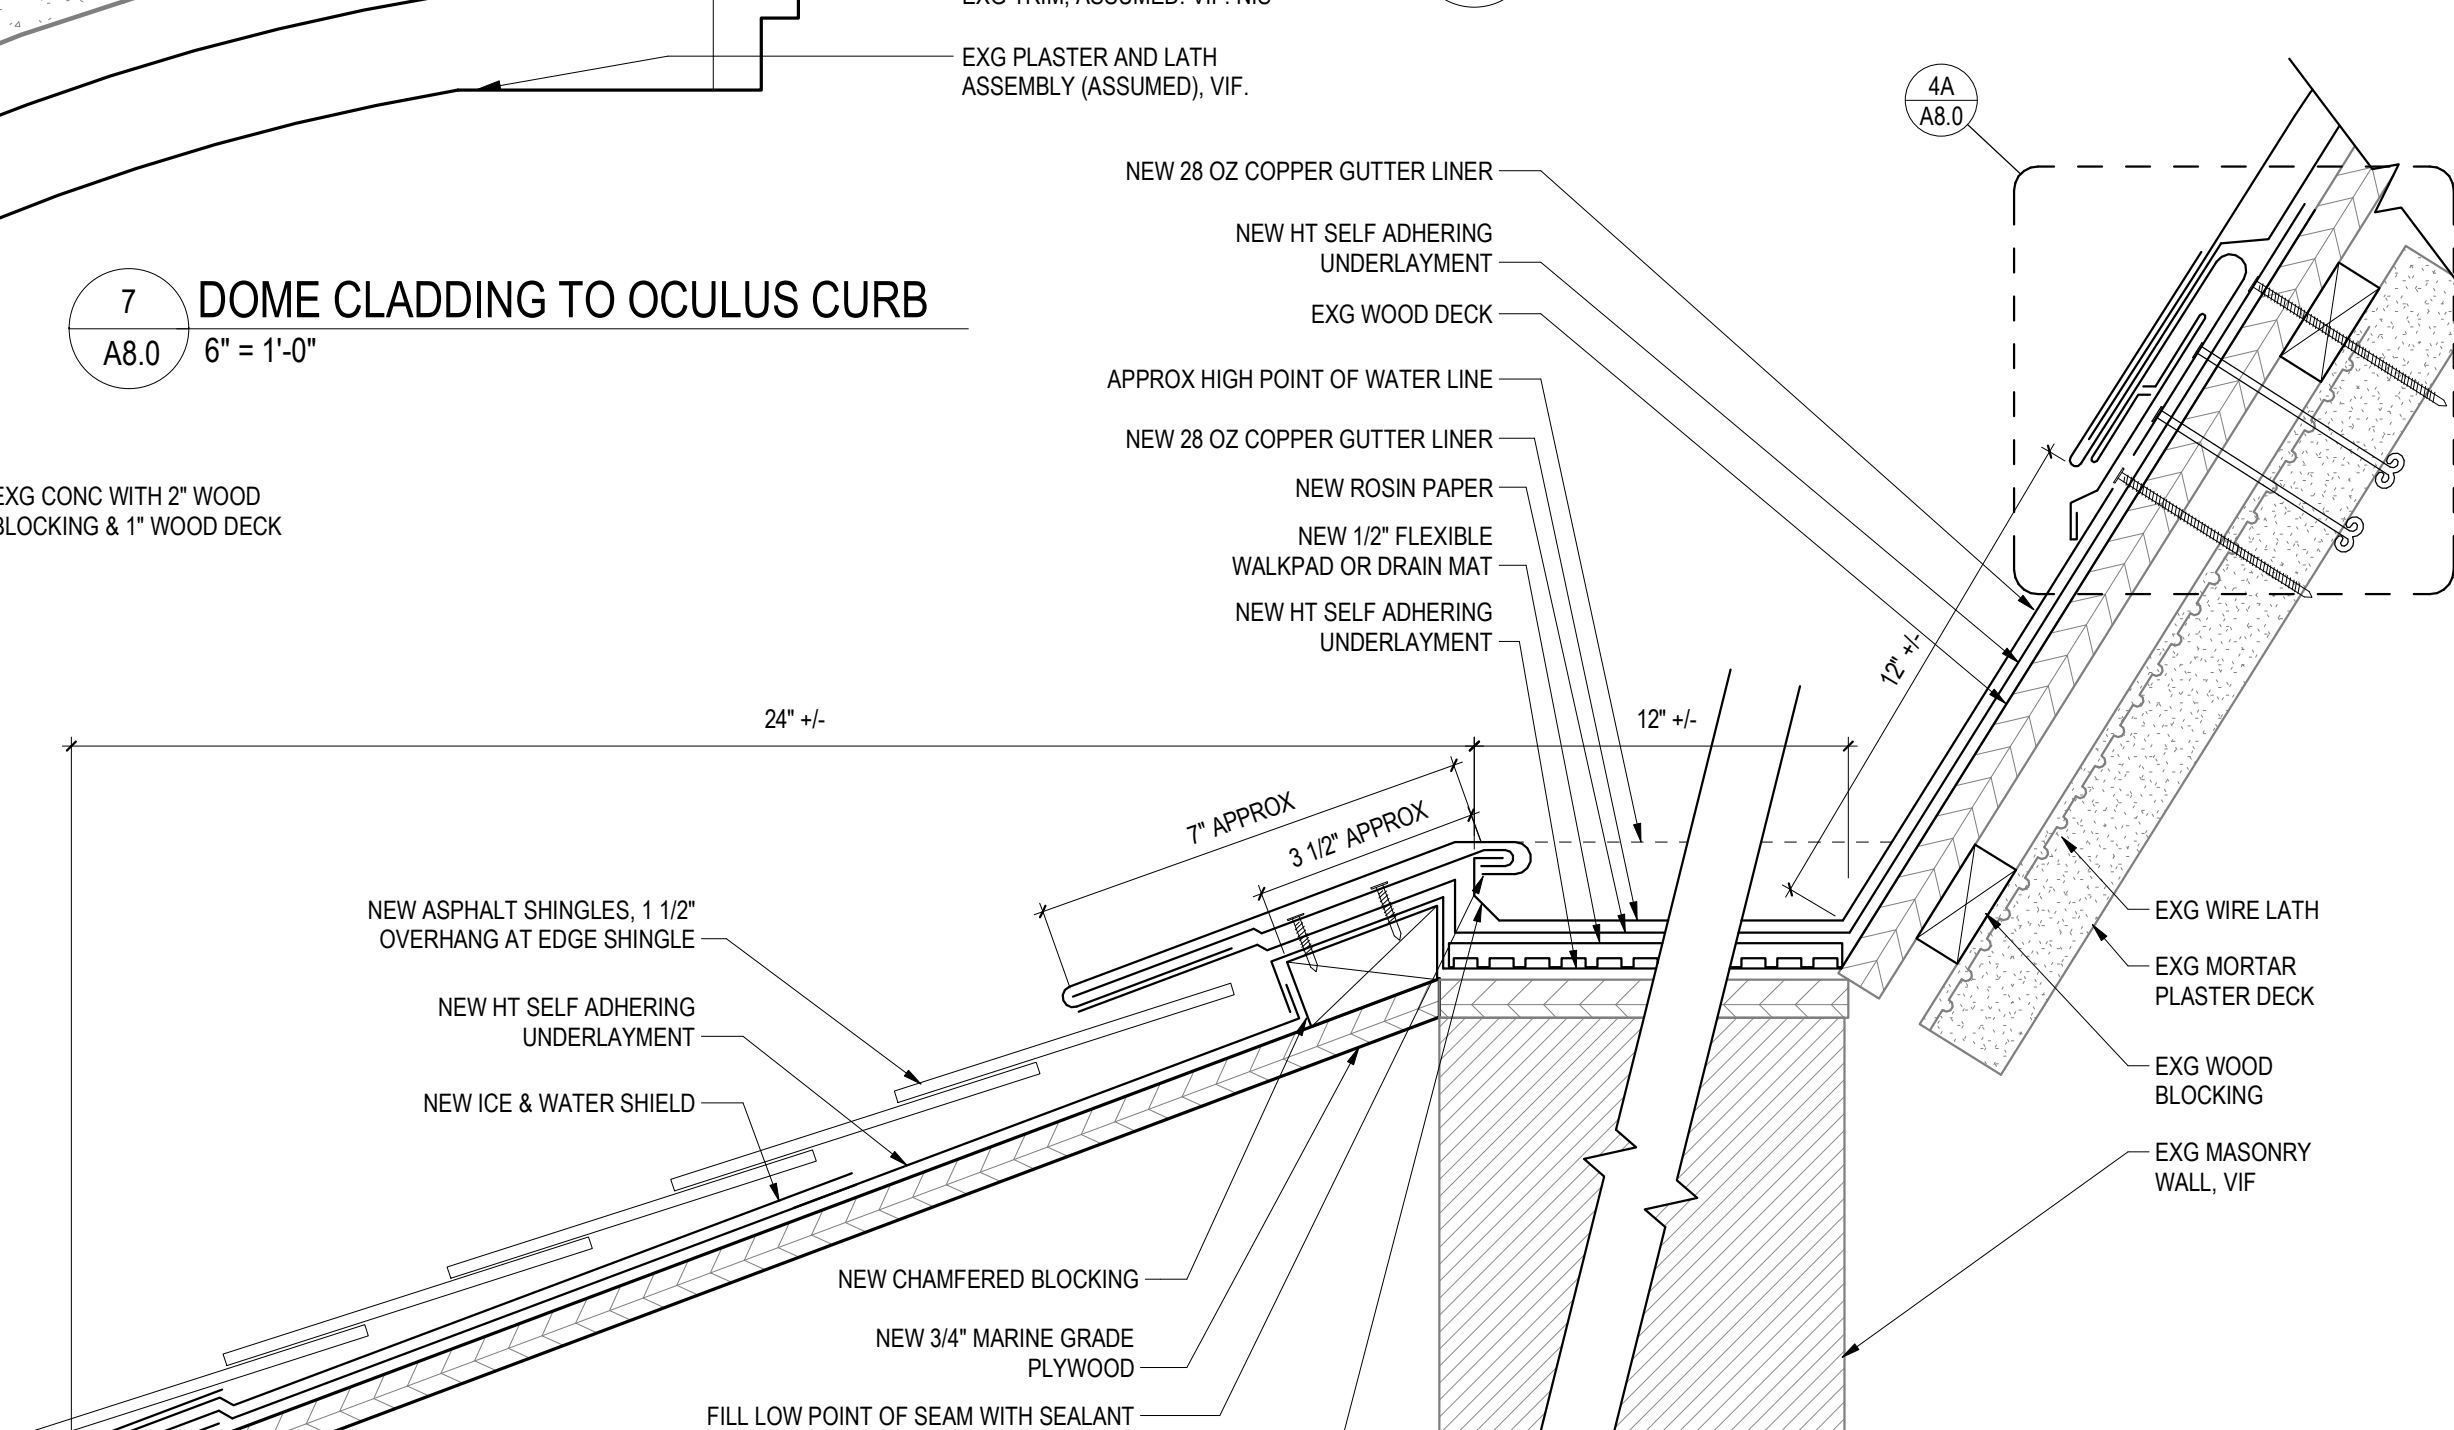


**4 ROOF DETAIL - DOME GUTTER AND SKIRT**  
A8.0 3" = 1'-0"

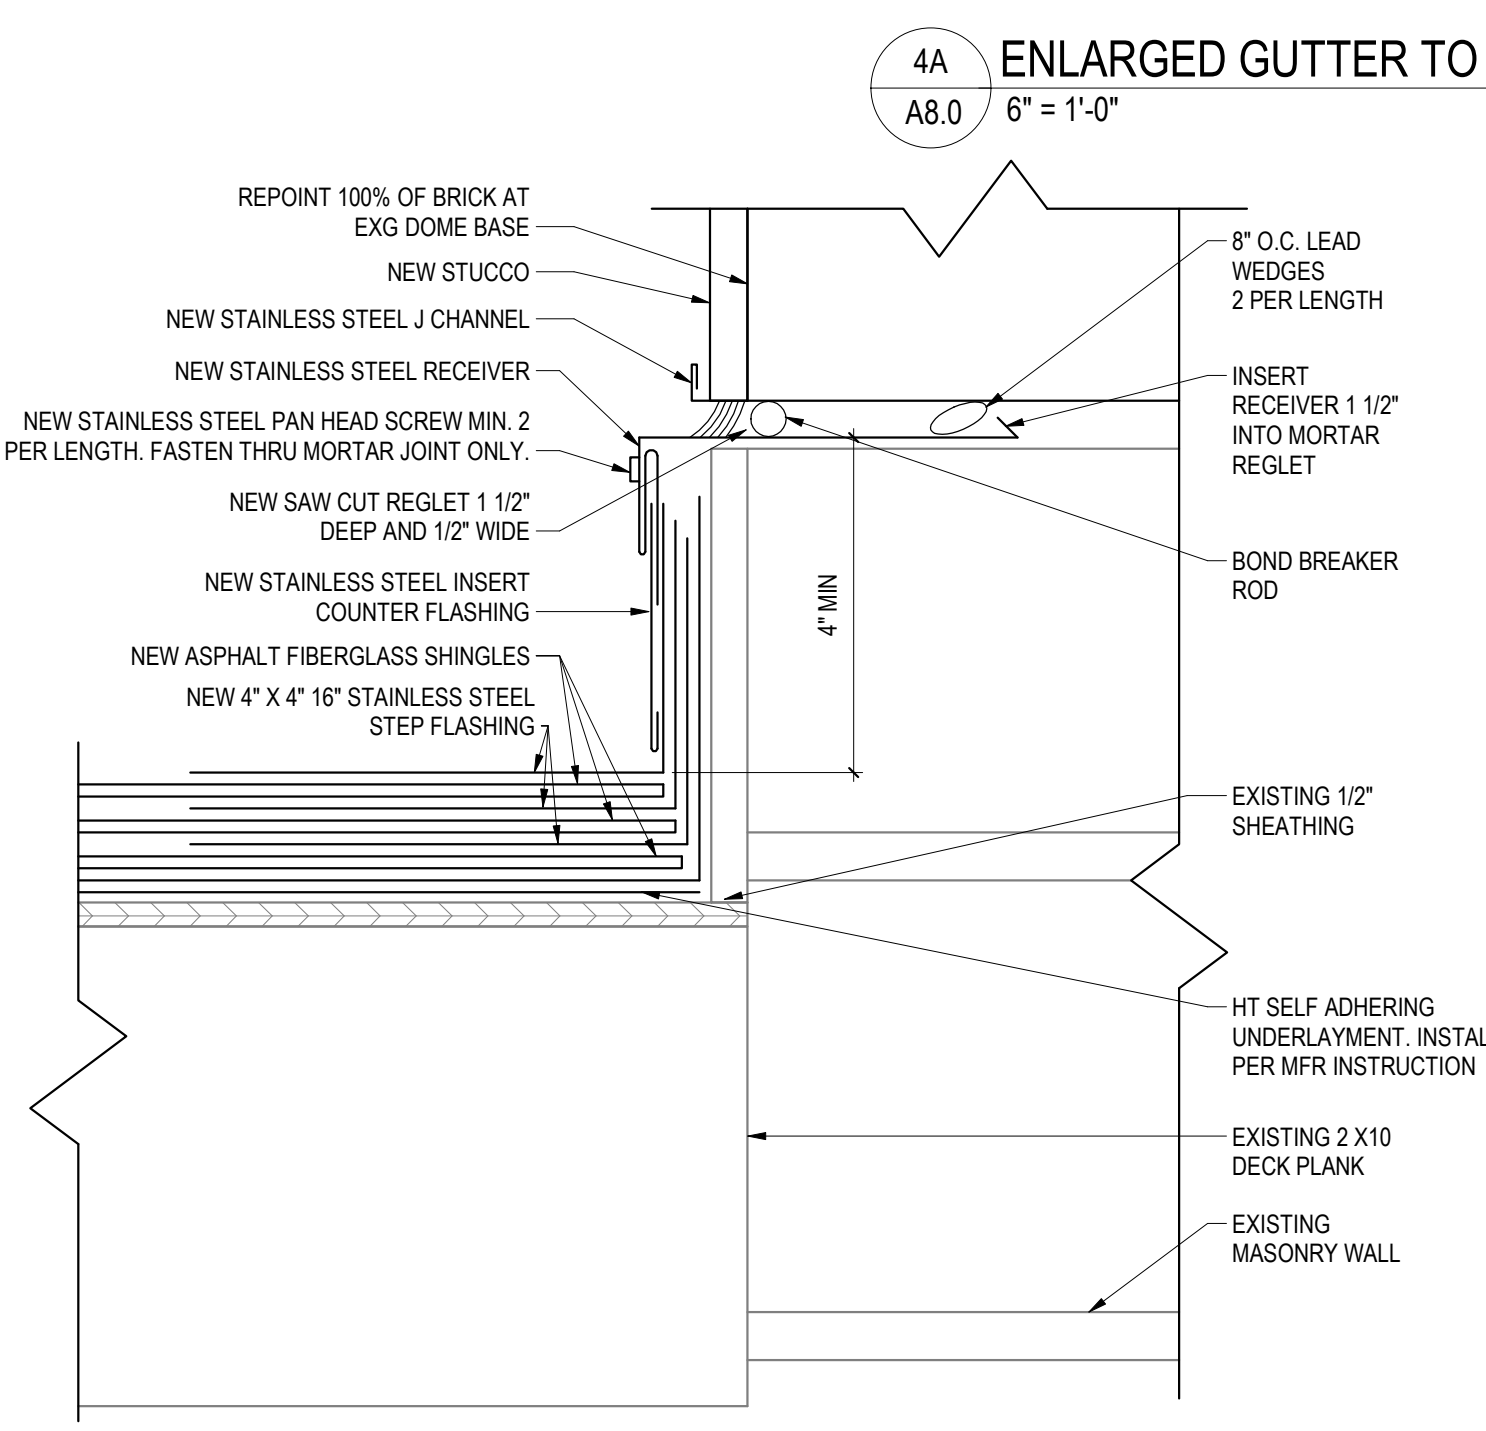

**3 ROOF DETAIL - DOME STEP AND COUNTER**  
A8.0 3" = 1'-0"

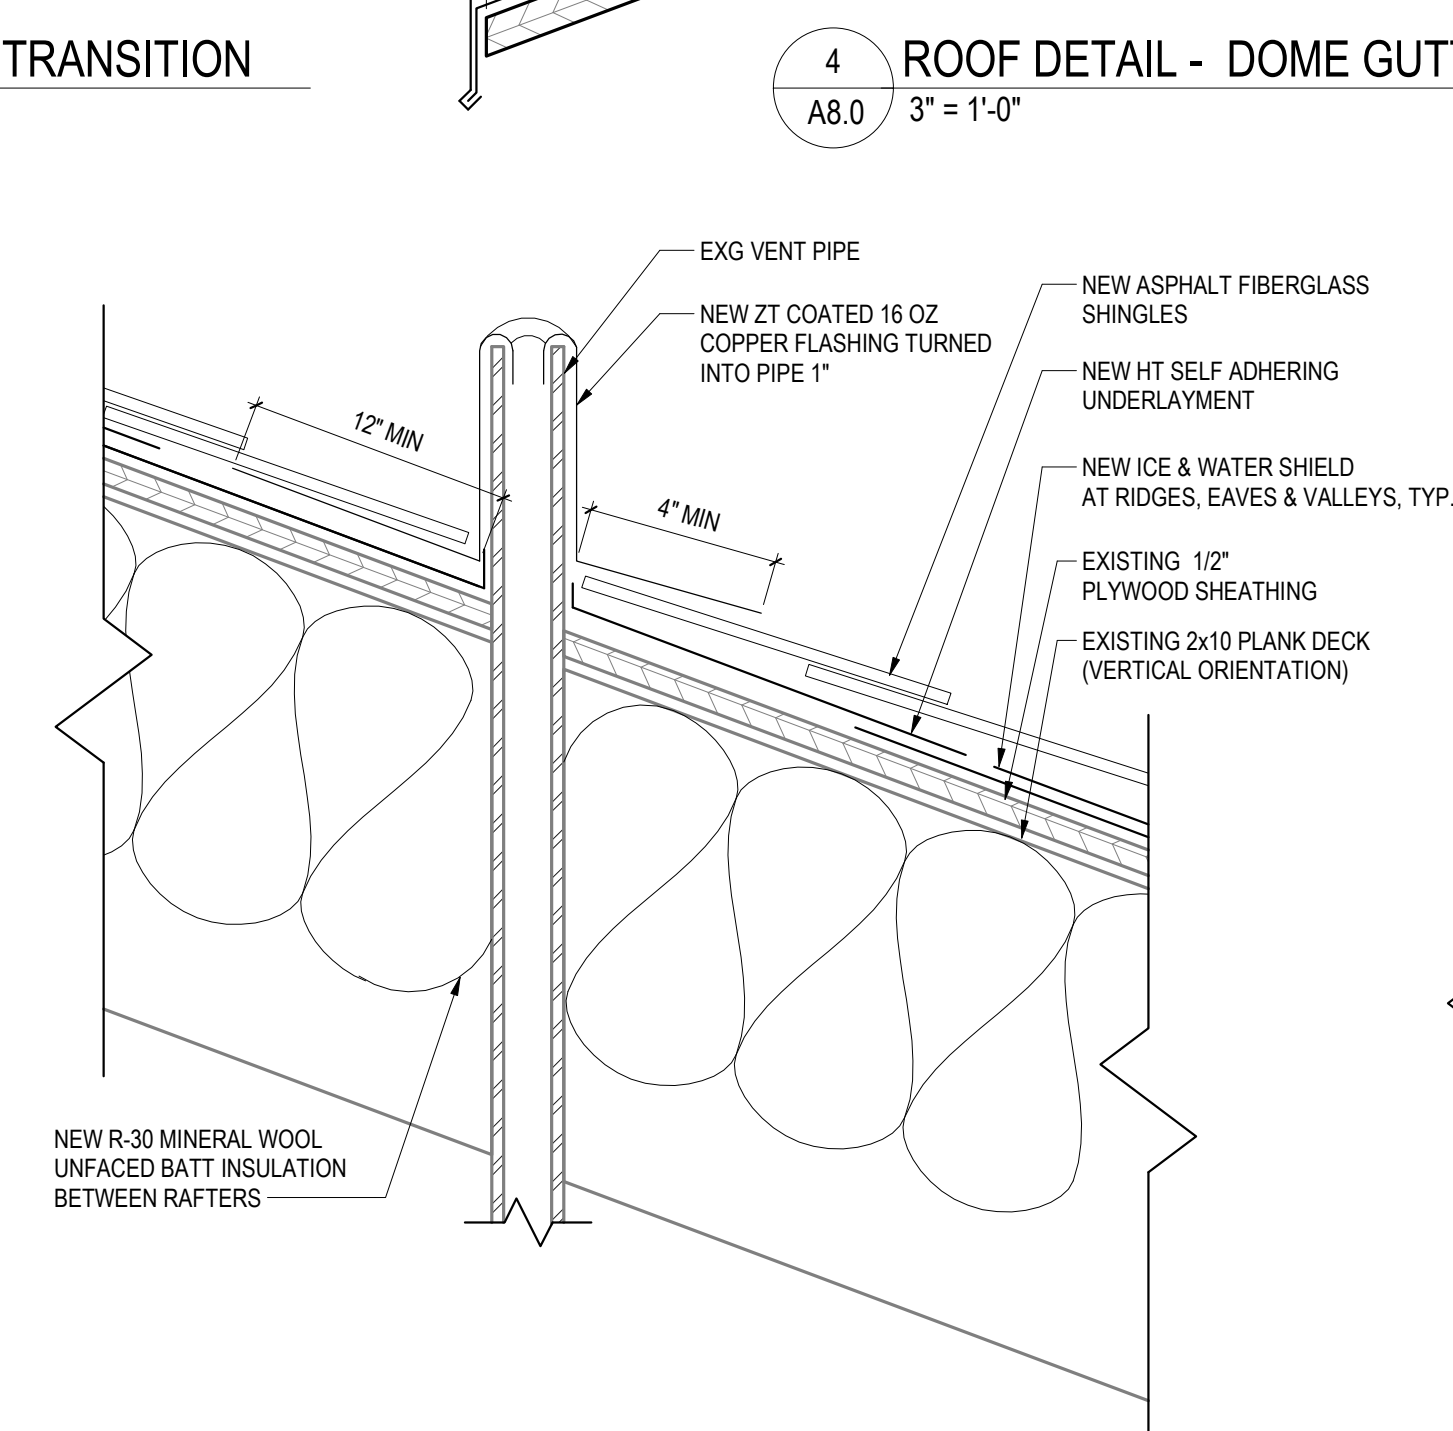


**2 ROOF DETAIL - TYPICAL VENT PIPE FLASHING**  
A8.0 3" = 1'-0"

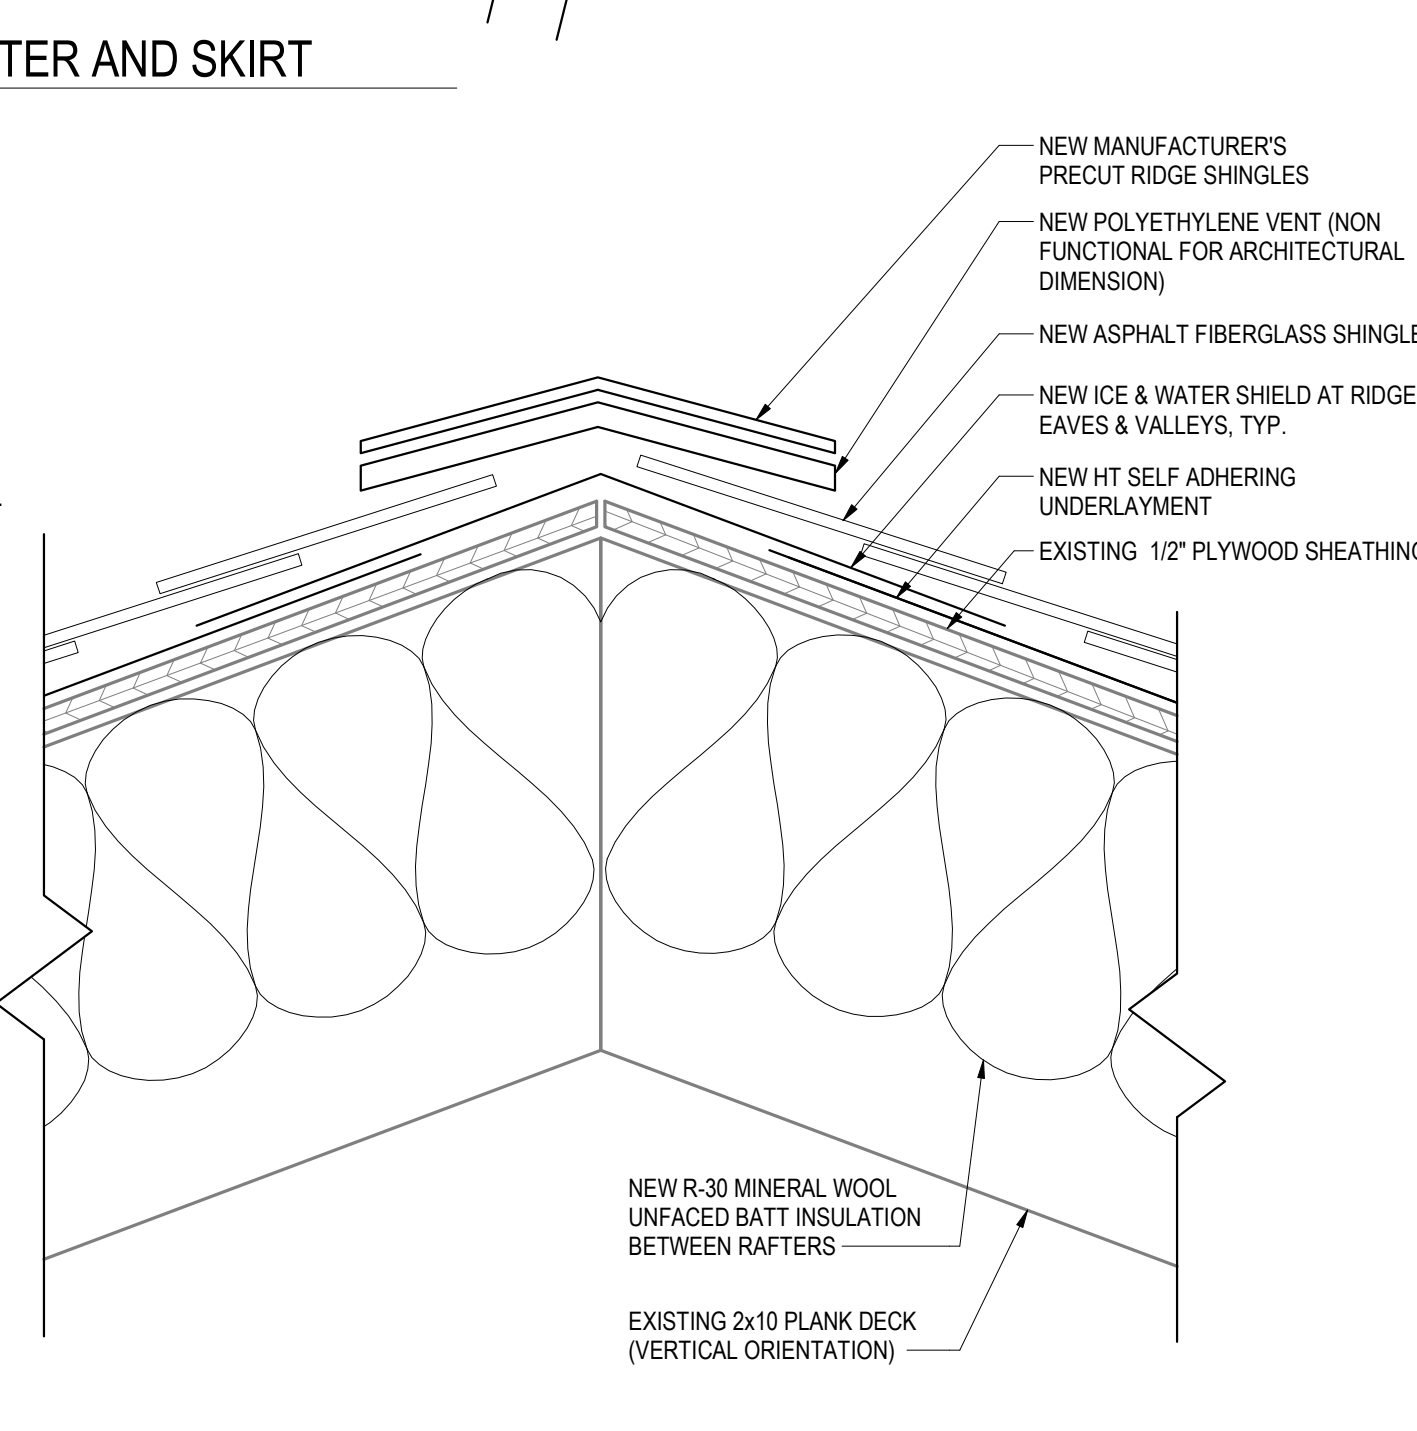


**1 ROOF DETAIL - RIDGE**  
A8.0 3" = 1'-0"




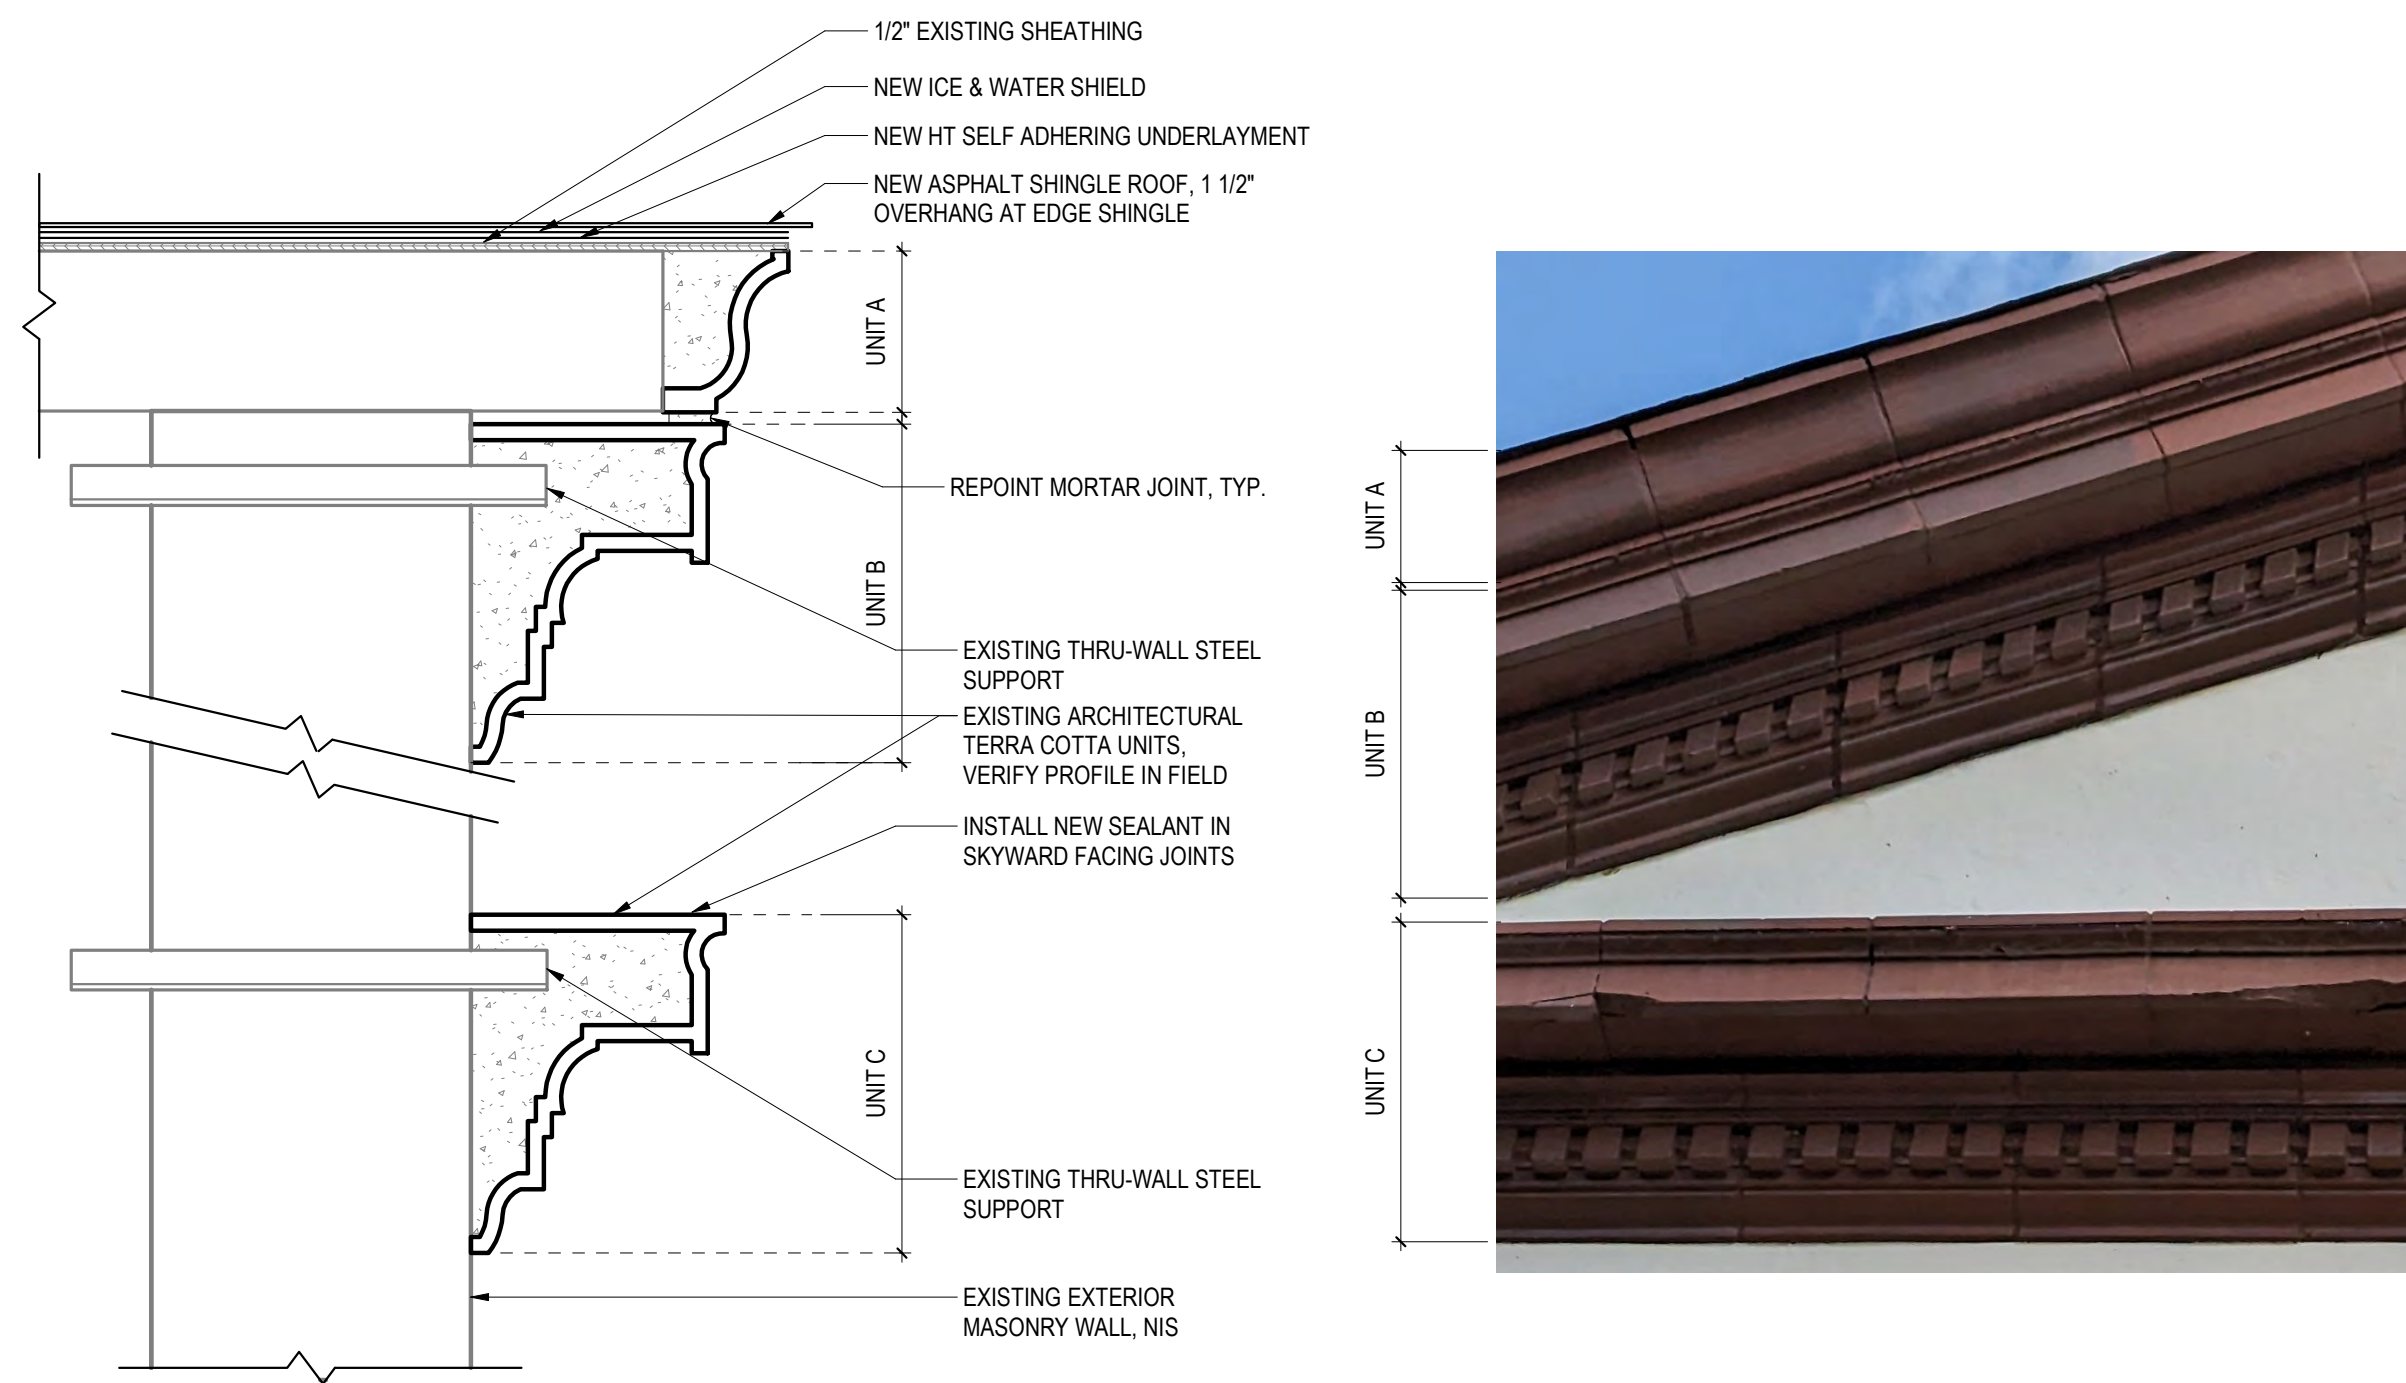


7 TERRA COTTA DETAIL - CORNICE AT RAKE AND PEDIMENT  
A8.1 1" = 1'-0"

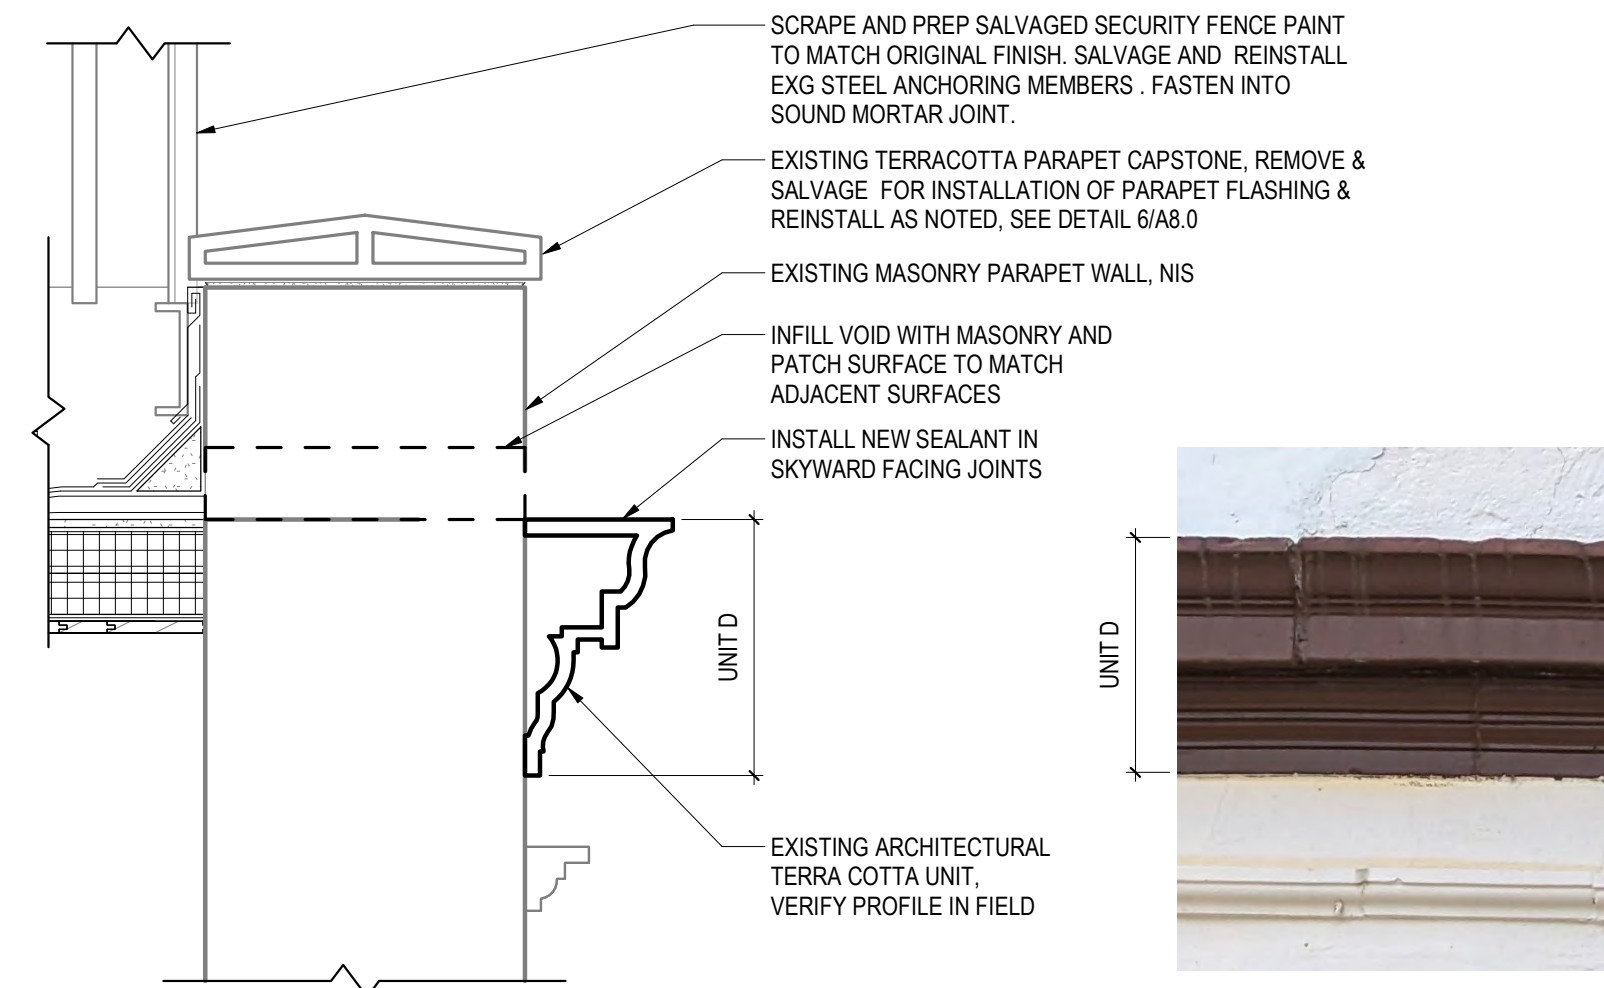


6 TERRA COTTA DETAIL - CORNICE AT SBS ROOF  
A8.1 1" = 1'-0"

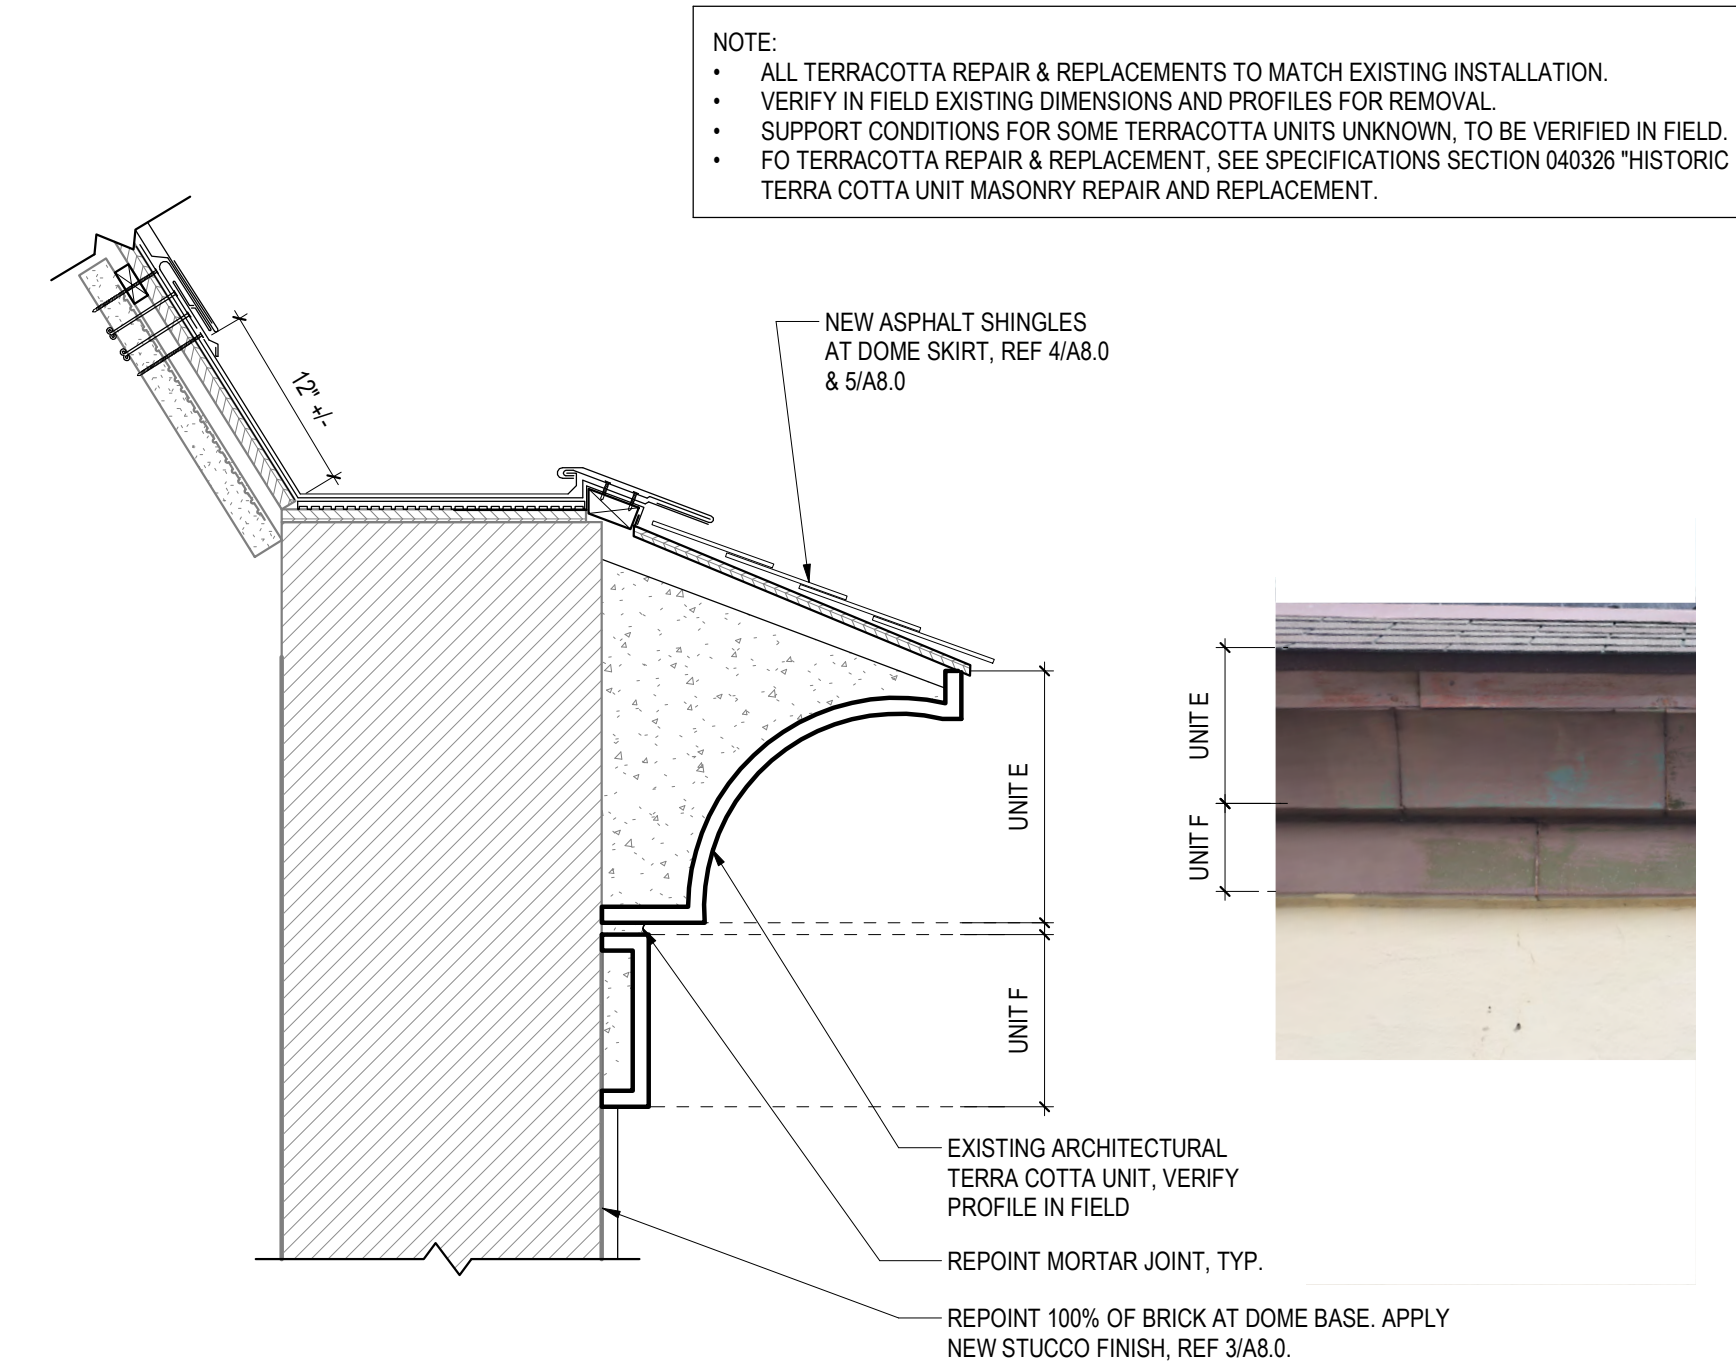



5 TERRA COTTA DETAIL - CORNICE AT DOME SKIRT  
A8.1 1" = 1'-0"

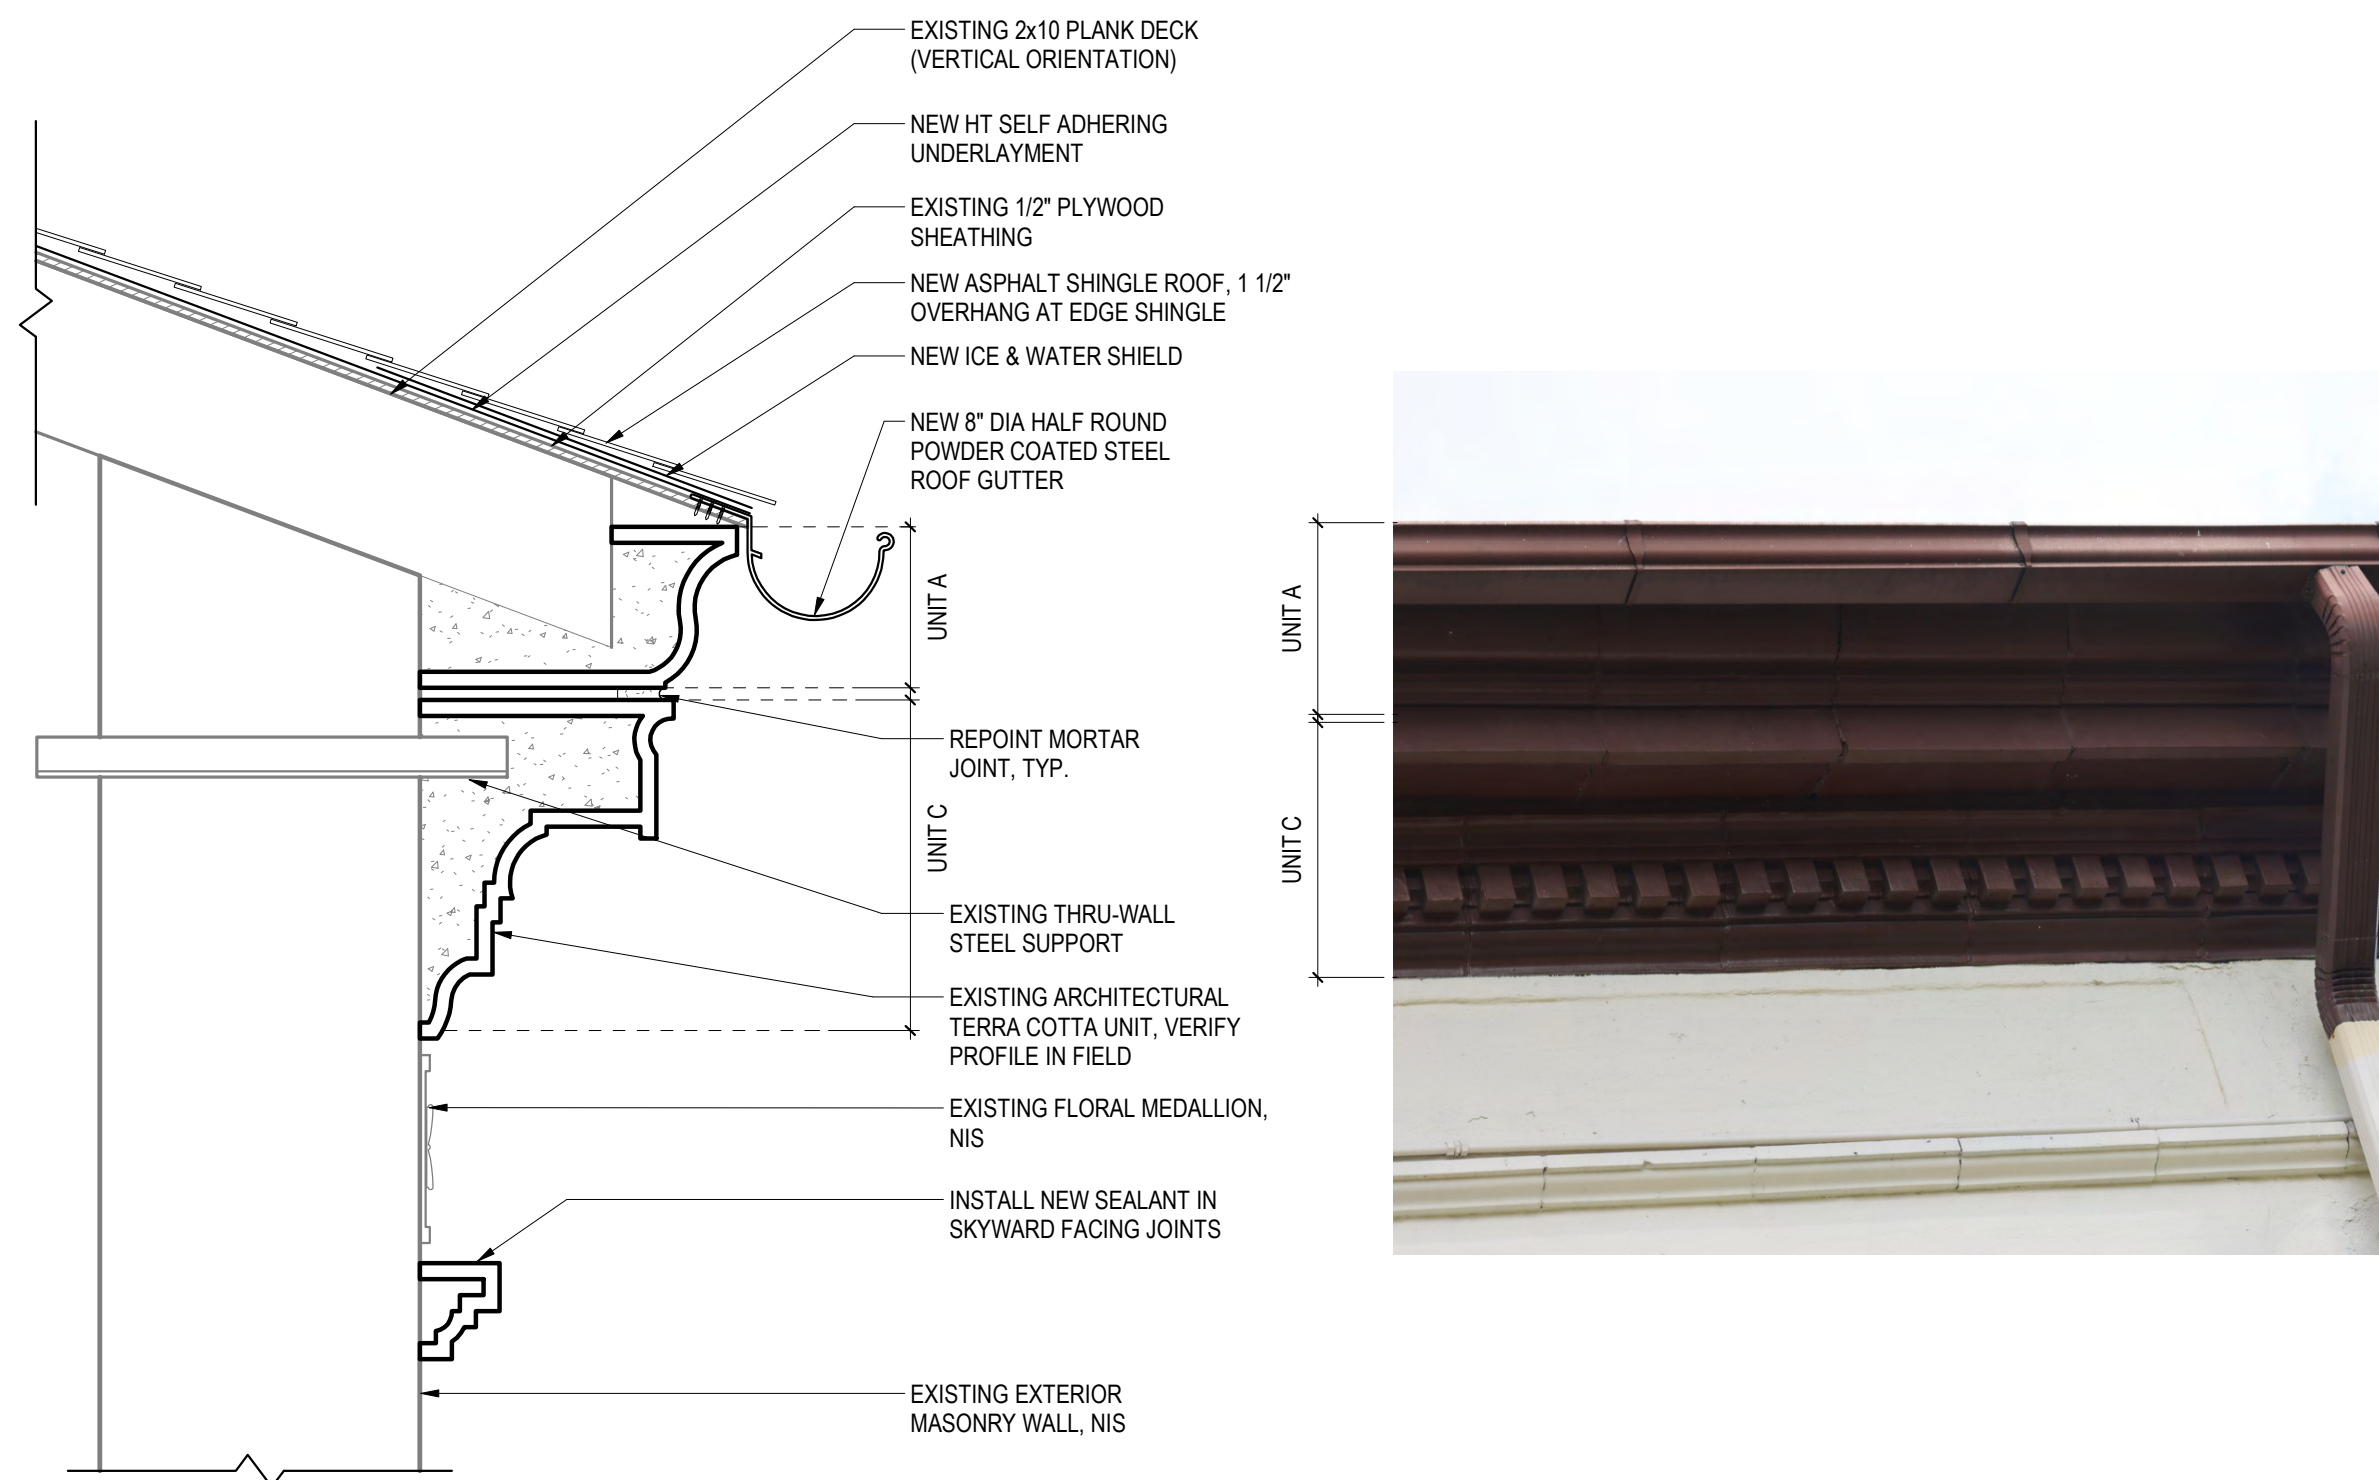

4 TERRA COTTA DETAIL - CORNICE AT EAVE  
A8.1 1" = 1'-0"

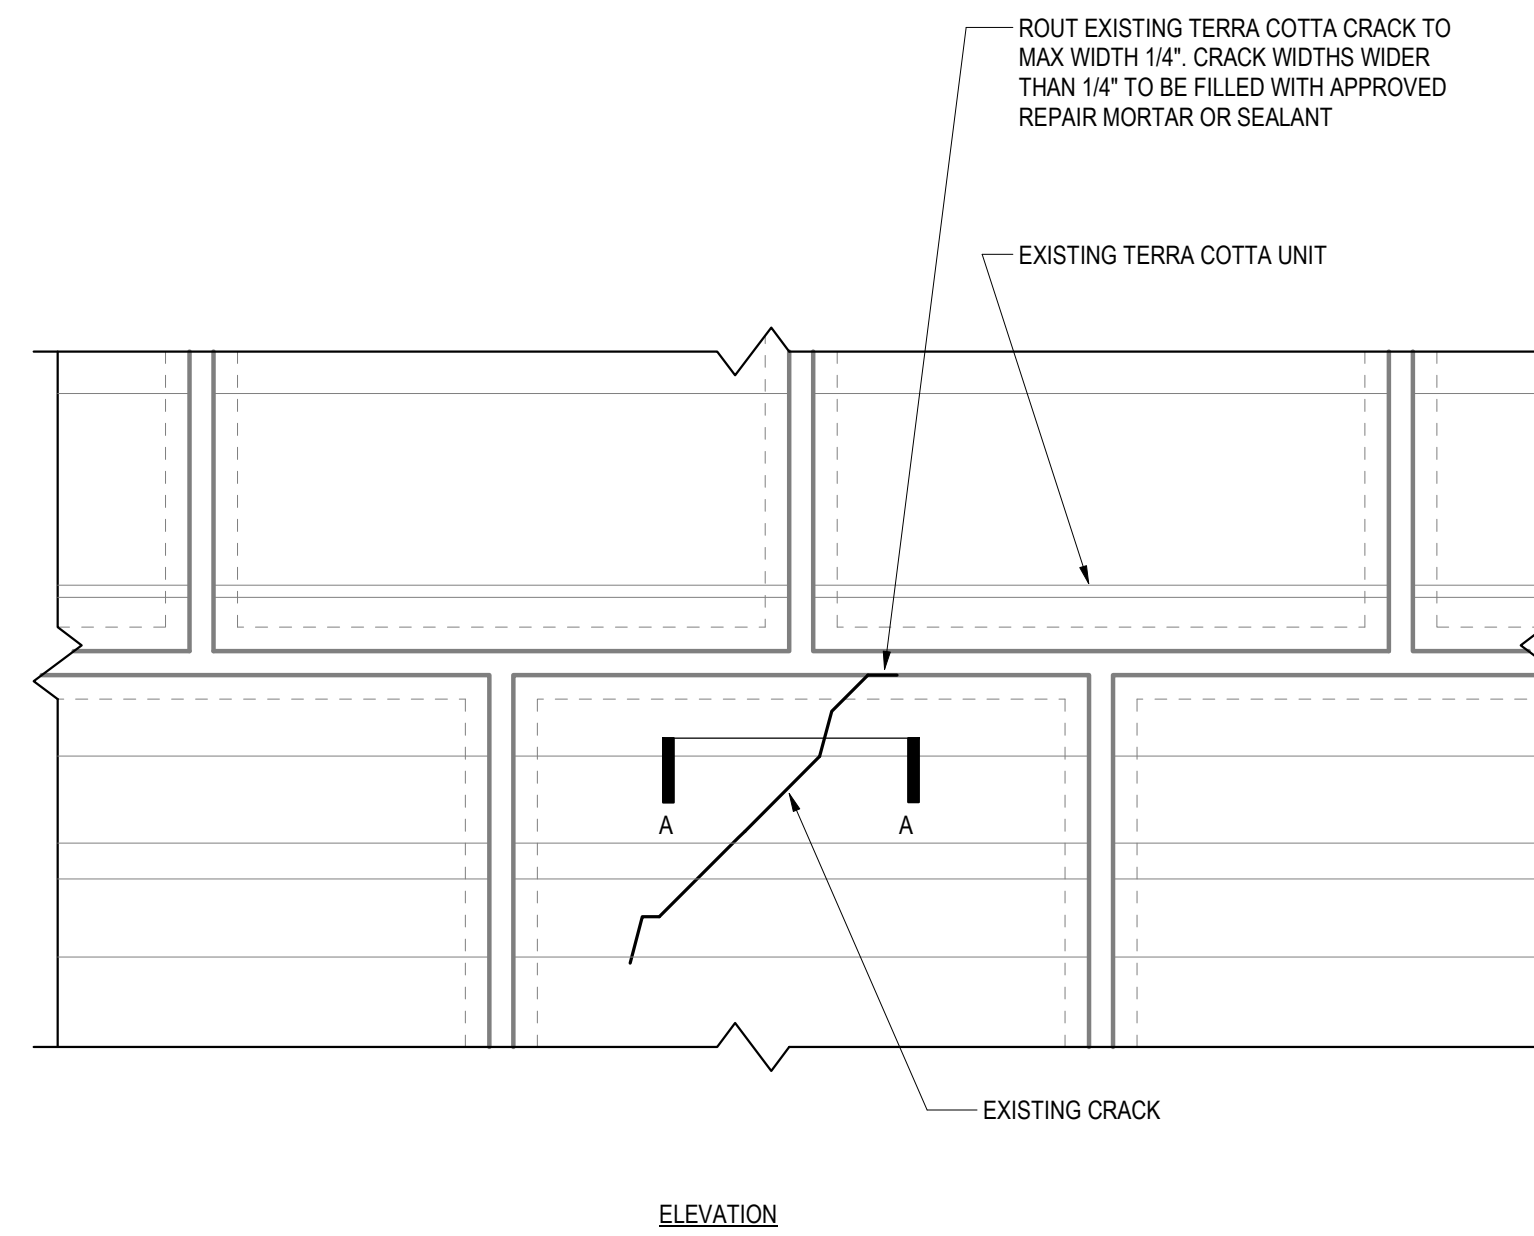


3 CORNICE DETAIL TYPICAL - ROUT AND SEAL CRACKED UNITS  
A8.1 1 1/2" = 1'-0"

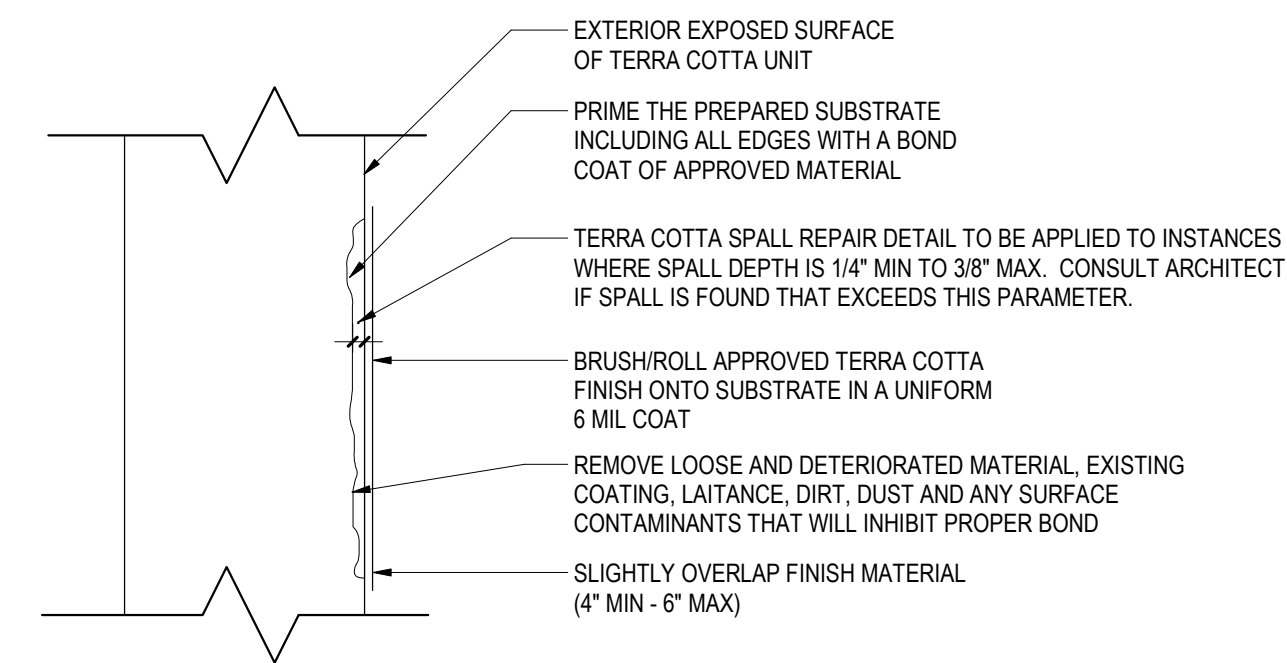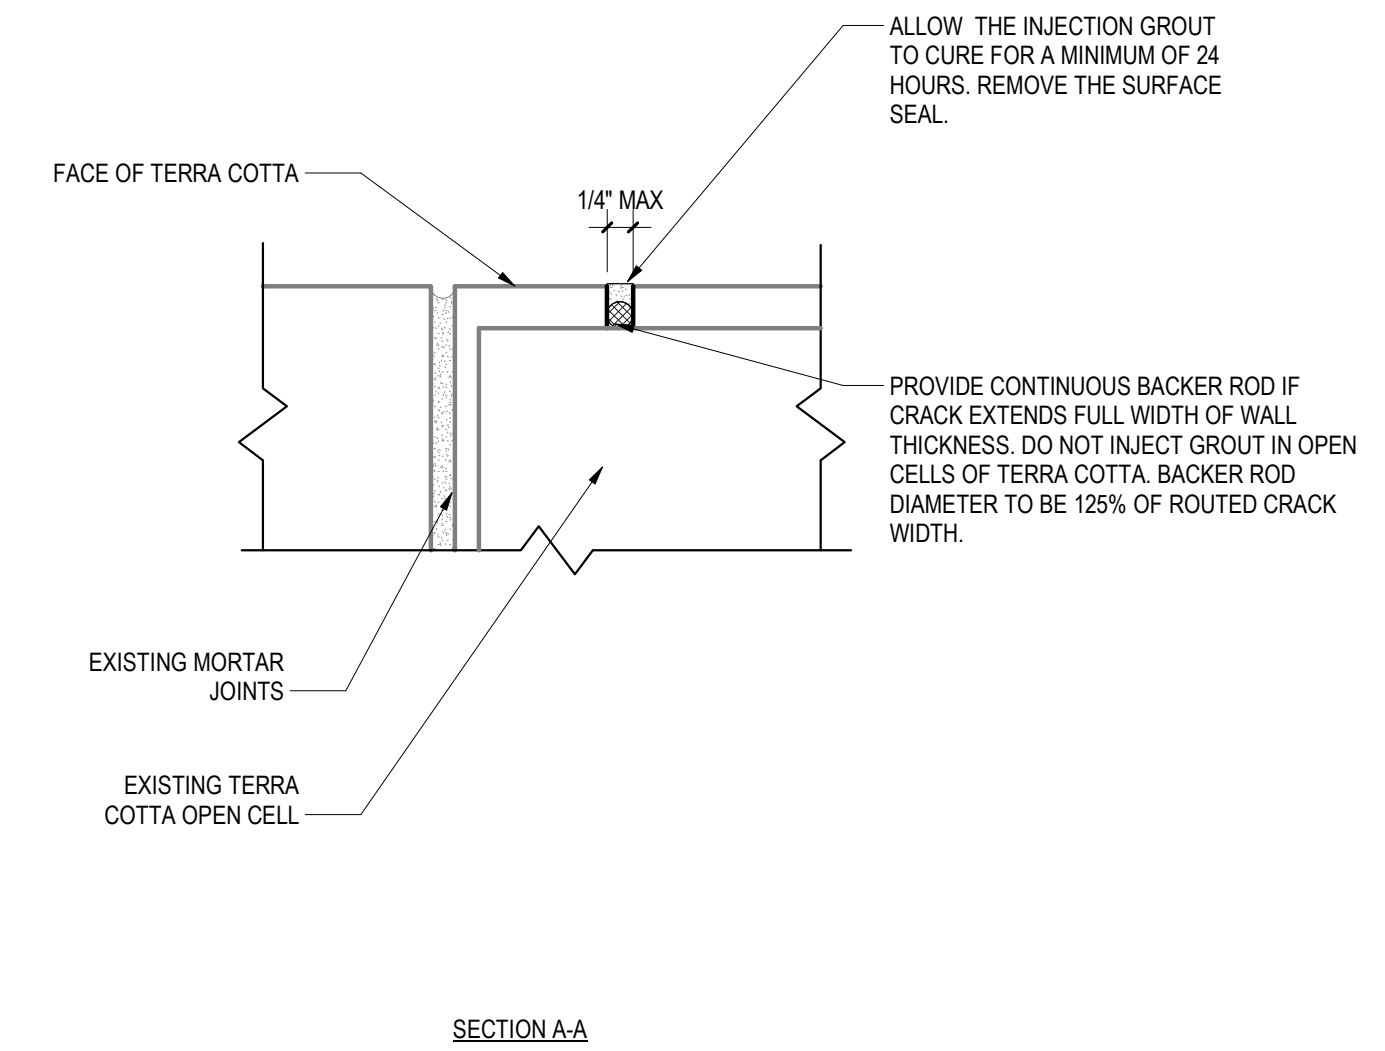

2 CORNICE DETAIL TYPICAL - GLAZE SPALLS  
A8.1 6" = 1'-0"

NOTE:  
EXTREME CARE MUST BE TAKEN DURING MORTAR REMOVAL TO NOT DAMAGE THE FACE OF EXISTING BRICK, LIMESTONE OR TERRACOTTA UNITS. ANY MASONRY DAMAGED DURING MORTAR REMOVAL SHALL BE REPLACED OR REPAIRED AT THE CONTRACTOR'S EXPENSE.

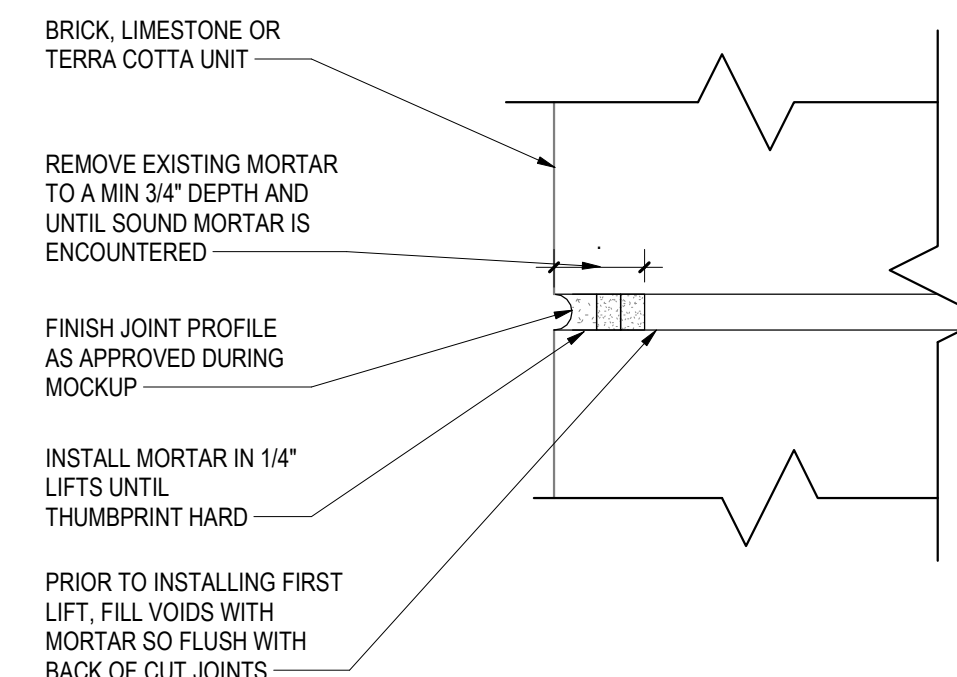

1 CORNICE DETAIL - TYPICAL REPOINTING  
A8.1 6" = 1'-0"





PROVIDE PROTECTION TO ALLOW FOR CONTINUED OPERATION OF CIRCULATION DESK AREA DURING CONSTRUCTION ACTIVITIES

ALTERNATE 1 (ADD):  
 REPAIR AND RESTORE EXISTING PLASTER AND LATH CEILING (ASSUMED) AT DOME INTERIOR.  
 REPAINT INTERIOR DOME SURFACE. PAINTING SHALL INCLUDE ALL SURFACES AND ELEMENTS ABOVE THE CORNICE LINE



1 DOME INTERIOR PHOTOS  
 A10.0 NTS

Seal:

No.	Date	Revision

By: JH    Checked: JSH    Scale: AS NOTED  
 Date: 04/15/2024

Drawing Title:  
 DOME INTERIOR PHOTOS

Drawing No.:  
 A10.0



**GENERAL STRUCTURAL NOTES**

1. THIS PROJECT HAS BEEN DESIGNED USING THE 2018 INTERNATIONAL BUILDING CODE (IBC), AND APPLICABLE LOCAL REGULATIONS.
2. NOTIFY THE ENGINEER IMMEDIATELY IF ANY EXISTING CONDITIONS CONFLICT WITH STRUCTURAL INFORMATION SHOWN IN THE CONSTRUCTION DOCUMENTS.
3. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR WORK THAT SHE DOES NOT REVIEW AND/OR WORK NOT COMPLETED IN ACCORDANCE WITH STRUCTURAL ENGINEER'S PLANS AND/OR SPECIFICATIONS.
4. IN CASE OF CONFLICT BETWEEN THE GENERAL NOTES, DETAILS AND SPECIFICATIONS, THE CONTRACTOR SHALL SUBMIT A REQUEST FOR CLARIFICATION.
5. STRUCTURAL SPECIAL INSPECTIONS ARE A REQUIREMENT FOR THIS PROJECT. A QUALIFIED INDEPENDENT INSPECTION AGENCY REGISTERED WITH THE CITY OF PHILADELPHIA SHALL BE SELECTED BY THE OWNER TO PERFORM THESE SERVICES. SPECIAL INSPECTIONS SHALL BE PERFORMED FOR THIS PROJECT AS FOLLOWS, AND IN ACCORDANCE WITH PROJECT SPECIFICATIONS:  
STRUCTURAL STEEL (AISC 360) VISUAL INSPECTION OF FIELD CONNECTIONS PERIODIC POST-INSTALLED ANCHOR INSTALLATION HORIZONTAL & OVERHEAD INSTALLATION CONTINUOUS
6. THE SPECIAL INSPECTIONS AGENCY SHALL PERFORM INSPECTIONS AND SUBMIT REPORTS THE ENGINEER OF RECORD (EOR) WITHIN 72 HOURS OF INSPECTION. ANY INADEQUACIES FOUND BY THE INSPECTOR SHALL BE REPORTED TO THE EOR WITHIN 24 HOURS. THE CONTRACTOR SHALL FACILITATE THESE INSPECTIONS BY SCHEDULING THE INSPECTIONS TO COORDINATE WITH THE WORK BEING PERFORMED BY THEIR SUB-CONTRACTORS.

**POST-INSTALLED ANCHORS IN MASONRY**

1. WHEN INSTALLING POST INSTALLED ADHESIVE ANCHORS, THE CONTRACTOR SHALL TAKE MEASURES TO AVOID DAMAGING EXISTING MASONRY. INSTALLER SHALL BE TRAINED BY MANUFACTURER ON INSTALLATION PROCEDURES, CLEAN HOLE FREE OF DUST, DEBRIS, AND MOISTURE. USE COMPRESSED AIR AND WIRE BRUSH, IN ACCORDANCE WITH MANUFACTURERS PROCEDURES. VERIFY THAT ADHESIVES TO BE USED, ARE WITHIN EXPIRATION DATE. PROVIDE HILTI OR APPROVED ALTERNATIVE.

**STEEL**

1. ALL STRUCTURAL STEEL WORK SHALL CONFORM TO THE FOLLOWING GOVERNING STANDARDS:  
A. AISC "SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS," CURRENT EDITION.  
B. THE AMERICAN WELDING SOCIETY (AWS D1.1) "CODE FOR WELDING IN BUILDING CONSTRUCTION," CURRENT EDITION.
2. INSTALLER QUALIFICATIONS: ENGAGE AN EXPERIENCED INSTALLER WHO HAS COMPLETED STRUCTURAL STEEL WORK SIMILAR IN MATERIAL, DESIGN, AND EXTENT TO THAT INDICATED FOR THIS PROJECT AND WITH A RECORD OF SUCCESSFUL IN-SERVICE PERFORMANCE.
3. FABRICATOR QUALIFICATIONS: ENGAGE A FIRM EXPERIENCED IN FABRICATING STRUCTURAL STEEL SIMILAR TO THAT INDICATED FOR THIS PROJECT AND WITH A RECORD OF SUCCESSFUL IN-SERVICE PERFORMANCE, AS WELL AS SUFFICIENT PRODUCTION CAPACITY TO FABRICATE STRUCTURAL STEEL WITHOUT DELAYING THE WORK.
4. ALL STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING ASTM SPECIFICATIONS:  
A. PLATES AND ANGLES: ASTM A36, Fy=36 KSI.  
B. W, WT & C SHAPES: ASTM A992, Fy=50 KSI.  
C. STEEL PIPE SHALL CONFORM TO ASTM A53 TYPE E GRADE B, [STD. = SCHEDULE 40]  
D. BOLTED CONNECTIONS (STEEL TO STEEL): ASTM A325-N, (3/4" DIAM.), U.N.O.  
E. ANCHOR BOLTS AND CONNECTORS IN WOOD FRAMING: ASTM A307, (3/4" DIAM.), U.N.O.
5. ANCHORAGE BOLTS AND FITTINGS IN MASONRY SHALL BE GALVANIZED.
6. WELDING SHALL BE PERFORMED BY WELDERS CERTIFIED BY THE A.W.S. SUBMIT WELDER CERTIFICATES TO ENGINEER FOR RECORD.
7. WELDING ELECTRODES SHALL BE ASTM A233, CLASS E70XX. ALL WELDING SHALL CONFORM TO THE A.W.S. STANDARD CODE.
8. ALL SHOP AND FIELD WELDS SHALL BE 3/16" FILLET WELDS MINIMUM, U.N.O.
9. SHOP PRIME ALL STEEL. TOUCH UP FIELD WELDS AND ANY DAMAGED AREAS OF PAINT WITH A ZINC RICH PAINT, IN FIELD AFTER WELDING.
10. MINIMUM CENTER-CENTER SPACING BETWEEN BOLTS SHALL BE 3", U.N.O. MINIMUM EDGE DISTANCE SHALL BE 1-1/4" FROM CENTER OF BOLTS TO EDGE OF STEEL.

**REPAIR EXISTING STEEL**

1. STEEL FRAMING FOR THE DOME ARMATURE IS TO BE INSPECTED BY THE EOR DURING CONSTRUCTION. CONTRACTOR SHALL DEMOLISH FINISHES AS NEEDED TO EXPOSE DAMAGED FRAMING.
2. EOR AND SPECIAL INSPECTIONS AGENCY REPRESENTATIVE SHALL ATTEND SITE MEETING TO ESTABLISH CRITERIA FOR IDENTIFYING A) EXISTING FRAMING MEMBERS TO BE REMOVED AND REPLACED; B) EXISTING FRAMING MEMBERS TO BE REINFORCED AND RE-USED; AND C) EXISTING FRAMING MEMBERS IN GOOD CONDITION TO REMAIN IN PLACE.
3. POWER-TOOL CLEAN EXISTING STEEL FRAMING TO SSPC-SP3 STANDARDS, IN PREPARATION FOR REPAIRS.
4. SPECIAL INSPECTIONS AGENCY SHALL SURVEY ALL STEEL FRAMING MEMBERS FOR MATERIAL PROFILE, AND REPORT FINDINGS.
5. ELECTRODES TO BE USED WELDING EXISTING STEEL, SHALL BE ASTM A233, CLASS E60XX. WELD PROCEDURES SHALL CONFORM TO THE A.W.S. D1.1 STANDARD PRE-CERTIFIED.

**FRAMING LUMBER & SHEATHING**

1. FRAMING LUMBER SHALL BE OF THE FOLLOWING MINIMUM STRENGTH FOR THE SPECIFIED USE, UNLESS OTHERWISE NOTED ON PLAN. ALL LUMBER SHALL BE GRADE-STAMPED BY A RECOGNIZED GRADING AGENCY AND SHALL BE SURFACED DRY. MOISTURE CONTENT NOT TO EXCEED 19%.


- DIMENSION LUMBER:**  
GRADE NO.2 PRESSURE TREATED, MIXED SOUTHERN PINE OR EQUAL. PROVIDE LUMBER STAMPED KDAT (KILN-DRIED AFTER TREATMENT). ALTERNATIVELY, SEASON THE LUMBER FOR SEVERAL MONTHS AFTER TREATMENT, SO MOISTURE CONTENT MEETS EQUILIBRIUM CONDITIONS.
2. STRUCTURAL COMPOSITE LUMBER SHALL BE PRESERVATIVE TREATED, (WOLMANIZED) PARALLEL STRAND LUMBER, (PSL-PT) PSL 2900FB-2.0E
  3. STORE FRAMING AND SHEATHING MATERIALS IN DRY LOCATION. REMOVE STANDING WATER FROM INSTALLED SHEATHING. ENSURE INSTALLED LUMBER MOISTURE CONTENT IS 19% OR LESS, BEFORE INSTALLING HOLD DOWN ANCHORS, STRAPS, OR FINISHES THAT WOULD BE AFFECTED BY LUMBER SHRINKING OR EXPANDING.
  4. FASTENING SHALL CONFORM TO A MINIMUM AS SPECIFIED IN TABLE 2304.10.1 OF THE INTERNATIONAL BUILDING CODE.
  5. BUILT-UP MULTI-MEMBER WOOD GIRDERS SHALL HAVE MEMBER JOINTS STAGGERED SUCH THAT NOT MORE THAN (1) MEMBER SPICE OCCURS BETWEEN SUPPORT POINTS. ORIENT ADJACENT MEMBERS WITH ALTERNATE GRAINS, AND CONNECT MEMBERS WITH GALVANIZED NAILS: 10D (148") X 3" COMMON FOR (2) MEMBERS, 16D (162") X 3-1/2" COMMON FOR (3) MEMBERS, AND 20D (192") X 4" COMMON FOR (4) MEMBERS. NAIL AT TOP AND BOTTOM @ 24" O.C. STAGGER OPPOSITE FACES, AND WITHIN 1-1/2" OF MEMBER ENDS.
  6. PROVIDE CROSS BRIDGING AT MAXIMUM 8'-0" O.C. FOR ALL JOISTS. NO JOISTS SHALL BE CUT OR NOTCHED WITHOUT APPROVAL.
  7. ALL MEMBERS SHALL HAVE LATERAL SUPPORT SUPPLIED AT ALL BEARING POINTS AS WELL AS CONTINUOUSLY ALONG THE COMPRESSION FACE.
  8. PLYWOOD OR OSB SHEATHING SHALL BE APA GRADE STAMPED FOR SPECIFIC SPAN, SHALL BE MADE WITH EXTERIOR GLUE AND SHALL BE OF THE FOLLOWING THICKNESS:

- ROOF: 19/32" THICK, EXPOSURE 1, STRUCTURAL 1, SPAN RATING 40/20.  
INDEX STAMP SHALL BE VISIBLE ON ALL SHEETS.  
PROTECT SHEATHING FROM EXTENSIVE EXPOSURE TO WEATHER.
9. INSTALL PLYWOOD SHEATHING WITH FACE GRAIN PERPENDICULAR TO THE SUPPORTING MEMBERS, U.N.O.
  10. USE PLYCLIPS OR OTHER EDGE SUPPORT AS REQUIRED FOR ROOF SHEATHING.

11. PROVIDE STRUCTURAL WOOD TONGUE AND GROOVE DECKING TO MATCH EXISTING DECKING DEPTH. PROVIDE SYP GRADE #1 OR EQUAL. FASTEN TO SUPPORTING JOISTS WITH #10 SCREWS X 2" EMBED @ 8" O.C.
12. PRESERVATIVE TREATMENT: TREAT WOOD MEMBERS AND SHEATHING IN CONTACT WITH MASONRY OR CONCRETE, OR WITHIN 6" OF GROUND, (IRC-R317.1.5). TREAT IN ACCORDANCE WITH CURRENT STANDARDS OF AMERICAN WOOD PRESERVERS ASSOCIATION (AWPA) STANDARD.  
USE CATEGORY 3B FOR EXPOSED EXTERIOR WOOD, NOT IN CONTACT WITH GROUND.  
USE CATEGORY 4A FOR WOOD IN CONTACT WITH GROUND.  
LUMBER AND SHEATHING SHALL BE VISIBLY STAMPED WITH AWPA USE CATEGORY STAMP.
13. CONTRACTOR SHALL VERIFY CORROSIVE COMPATIBILITY OF FASTENERS WITH ACO PRESERVATIVE
14. PROTECT ENDS AND TOPS OF FRAMING IN CONTACT WITH MOISTURE WITH SELF ADHERED FLASHING OR EQUAL.

**STRUCTURAL DESIGN CRITERIA**

GROUND SNOW LOAD	25 LBS/SQ FT
ROOF LIVE LOAD	20 LBS/ SQ FT
<b>WIND LOADS</b>	
WIND SPEED:	115 MPH, EXPOSURE B
WIND PRESSURE FOR COMPONENTS AND CLADDING DESIGN	20 LBS/SQ FT

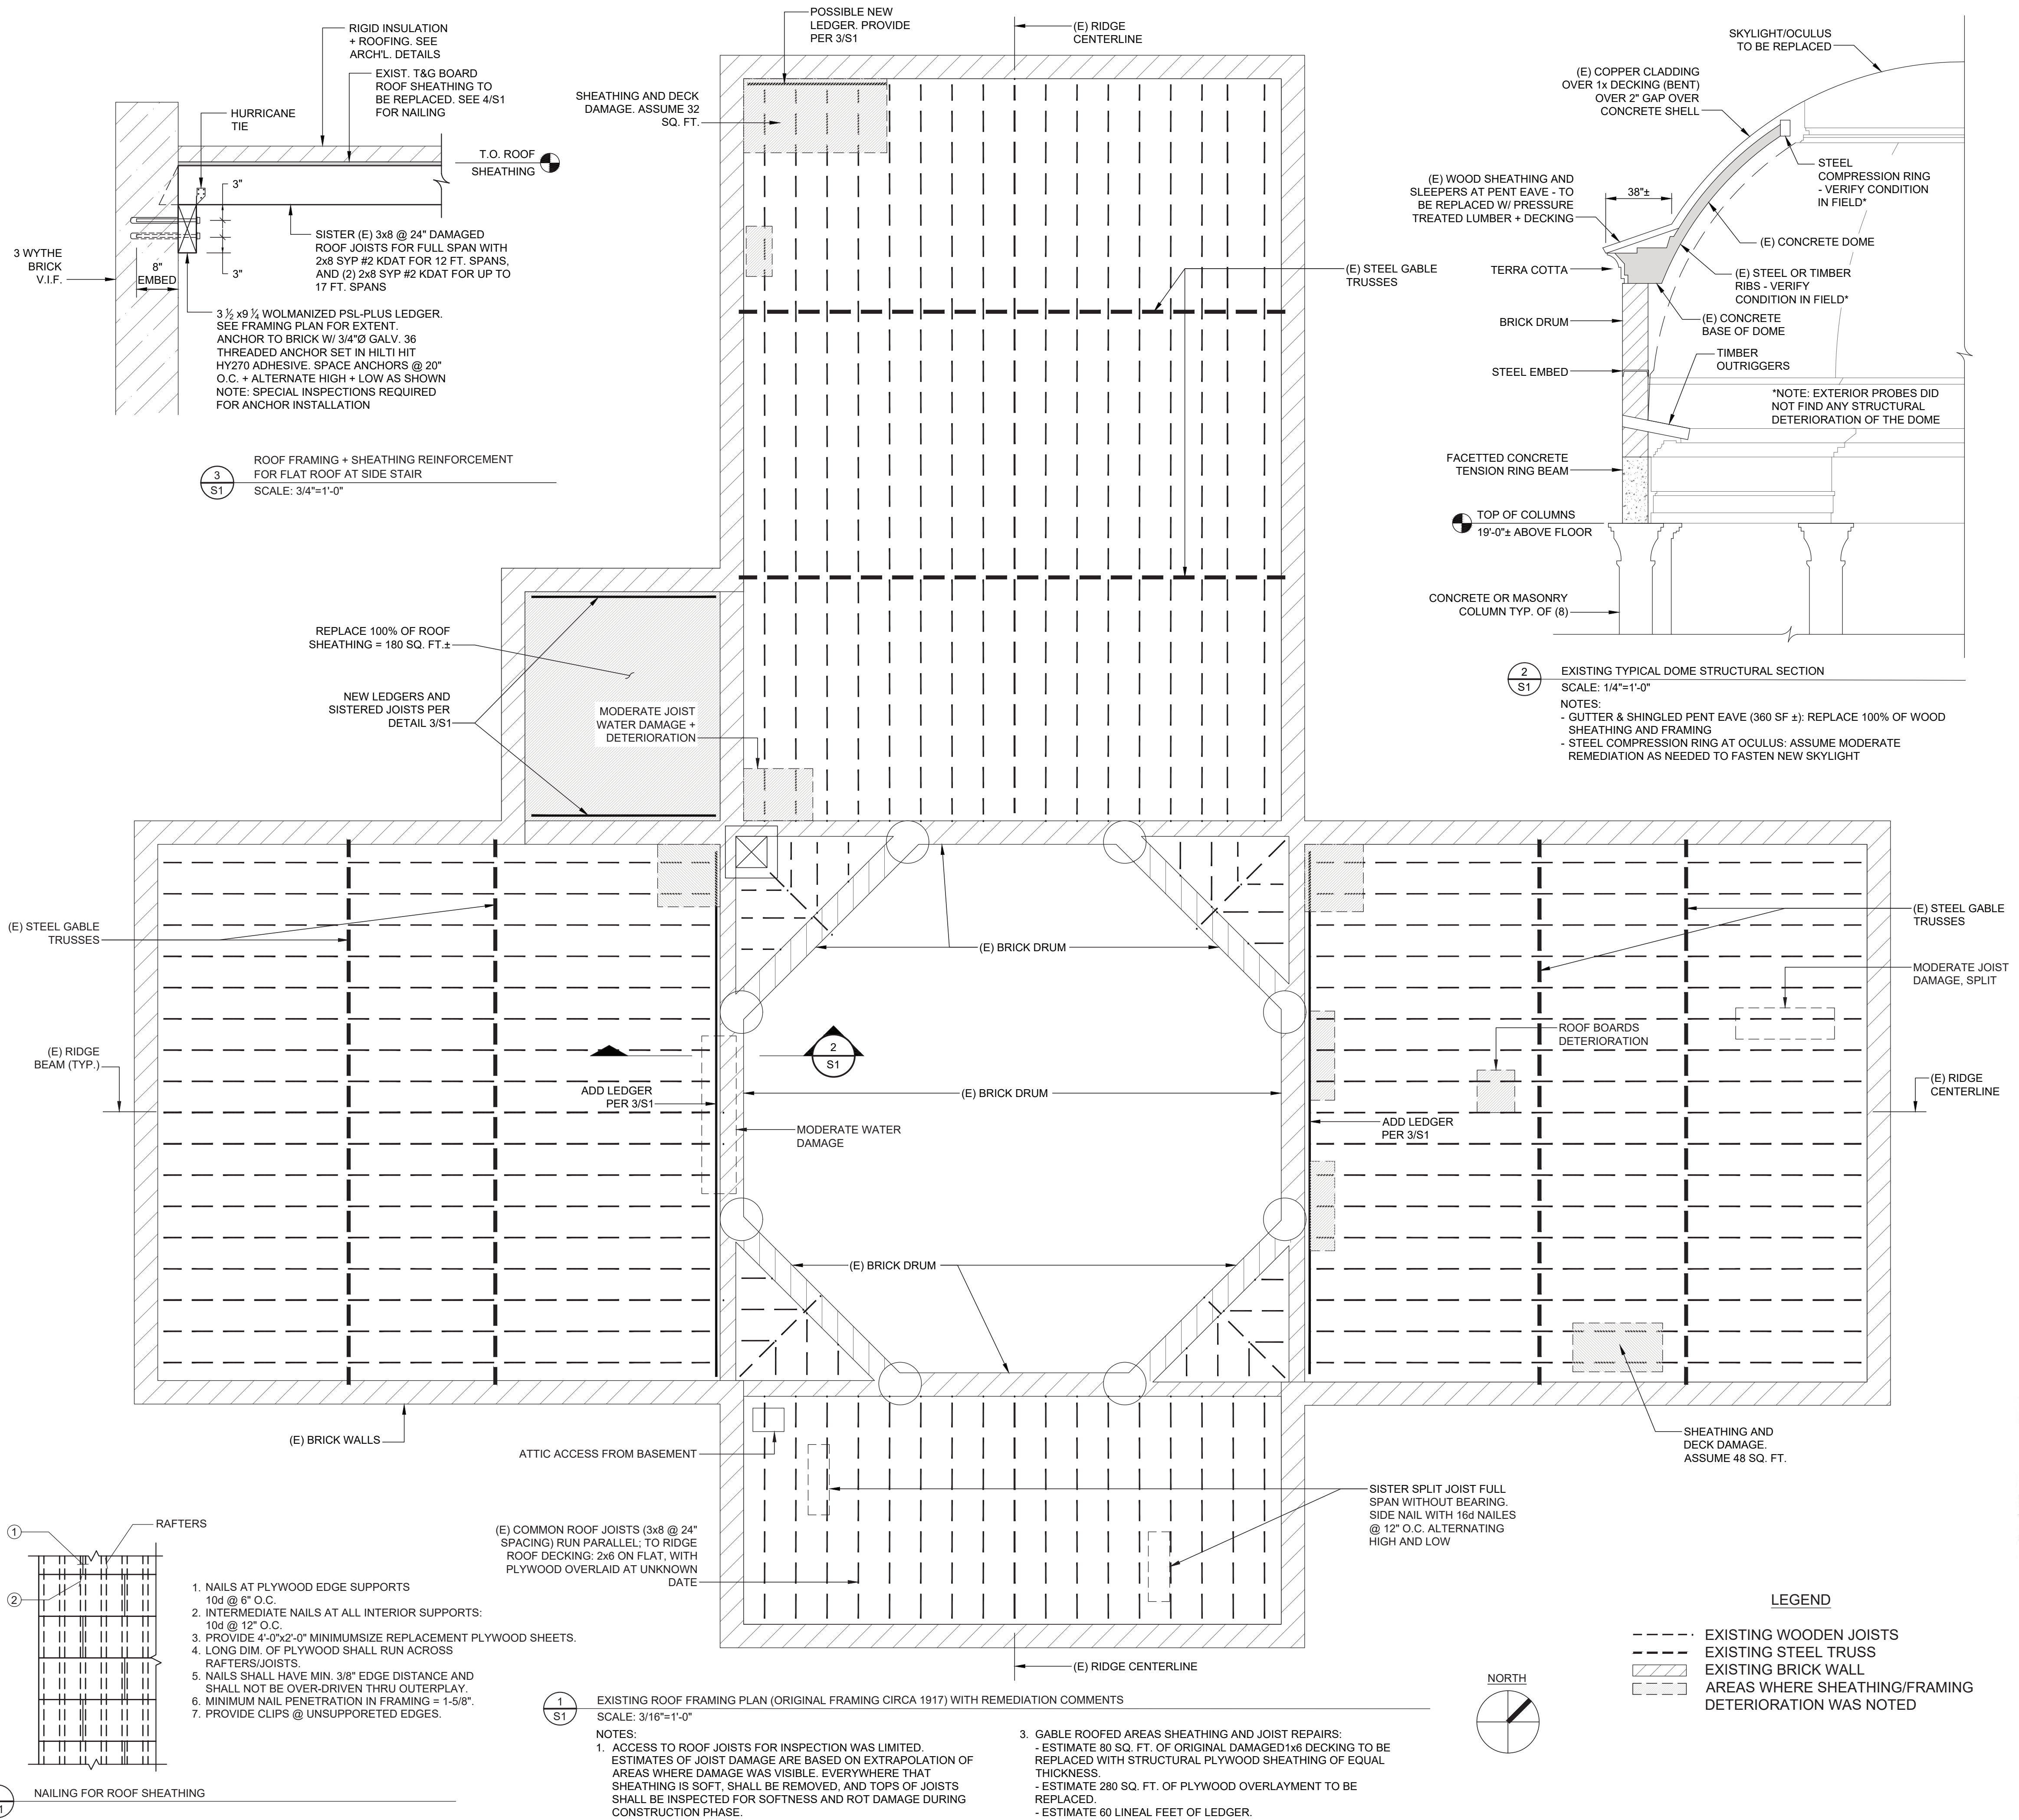

MCPHERSON SQUARE LIBRARY  
601 E INDIANA AVE.  
PHILADELPHIA, PA 19134

**ARCHITECTS:**  
SMP Architects  
1600 Walnut Street, 2nd Floor  
Philadelphia, PA 19103  
215.955.4410  
www.smparchitects.com

**CIVIL ENGINEER:**  
KS ENGINEERS  
530 Walnut Street, Suite 460  
Philadelphia, PA 19106  
215.616.3060

**STRUCTURAL ENGINEER:**  
Ann Rothmann  
100 E Lancaster Avenue, Suite 203  
Wayne, PA 19087  
610.688.2566

**ROOFING CONSULTANT:**  
Steve McLaughlin  
210 Garden Avenue  
Somerdale, NJ 08083  
856.287.2424

Seal:



No.	Date	Revision

By: SH Checked: AR Scale: AS NOTED  
Date: 04/15/2024

Drawing Title:  
ROOF FRAMING PLAN, SECTIONS AND NOTES

Drawing No.:  
**S1** OF 1  
STRUCTURAL SHEET