

## AMENDMENT ACKNOWLEDGMENT

AMENDMENT NO.2

Dated: 5/12/22

### NOTICE

*It is the sole responsibility of the sellers to ensure that it has received any and all Amendments and the Procurement Commissioner may in his/her sole discretion reject any bid for which all Amendments have not been executed and returned.*

### PROPOSAL FOR

DPP Project No.: 13-21-4643-01

Description: Engine 72 Decontamination Suite

### IS AMENDED AS FOLLOWS:

1. Amendments will be posted in PRA Contracts to all known to have been added to the Bid holder's list or Qualified Sellers after the questionnaire due date. Each Seller shall ascertain prior to submitting Quote that Seller has received all Amendments issued, and shall acknowledge their receipt in their Quote on PRA Contracts.

2. The following are the requirement modifications to the Contract

#### Specifications:

- A. Contract Drawing MPE 1.3 Specification Section 16721 Item #3.

Remove the following paragraph in its entirety:

3. NEW MODULES AND PERIPHERAL DEVICES SHALL BE BY THE SAME MANUFACTURER AS THE EXISTING SYSTEM, AND SHALL BE SUPPLIED THROUGH ONE OF THEIR AUTHORIZED DISTRIBUTORS. PROVIDE ALL NECESSARY MODIFICATIONS TO THE HEAD-END EQUIPMENT, INCLUDING POWER EXTENDER PANELS FOR SUPPORTING ADDITIONAL AUDIBLE/VISUAL APPLIANCES.

Replace it with the following:


3. NEW MODULES AND PERIPHERAL DEVICES SHALL BE BY THE SERVICING INSTALLER (FORTRESS PROTECTION 215-854-8400) AND SHALL BE RATED WITH AND COMPATIBLE TO THE EXISTING HONEYWELL S3 SERIES FIRE ALARM CONTROL PANEL. FORTRESS PROTECTION SHALL BE RETAINED BY THE CONTRACTOR TO PROVIDE ALL NECESSARY MODIFICATIONS TO THE HEAD-END EQUIPMENT, INCLUDING POWER EXTENDER PANELS FOR SUPPORTING ADDITIONAL AUDIBLE/VISUAL APPLIANCES.

3. The following are the requirement modifications to the Contract Drawings:

- A. Contract Drawing M1.2:

Provide the added sensor information to existing Detail #1. The provision


and installation of this sensor is a contract requirement:

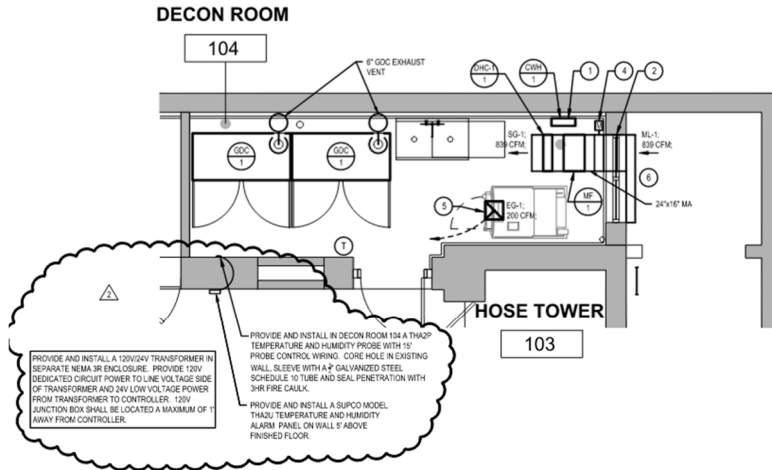

**1**  
**ML.2**  
**PARTIAL FIRST FLOOR PLAN**  
**MECHANICAL NEW WORK**  
SCALE : 1/4" = 1'-0"

**B. Contract Drawing P5.1:**

Add the following Detail to the contract requirements on Contract Drawing P5.1:

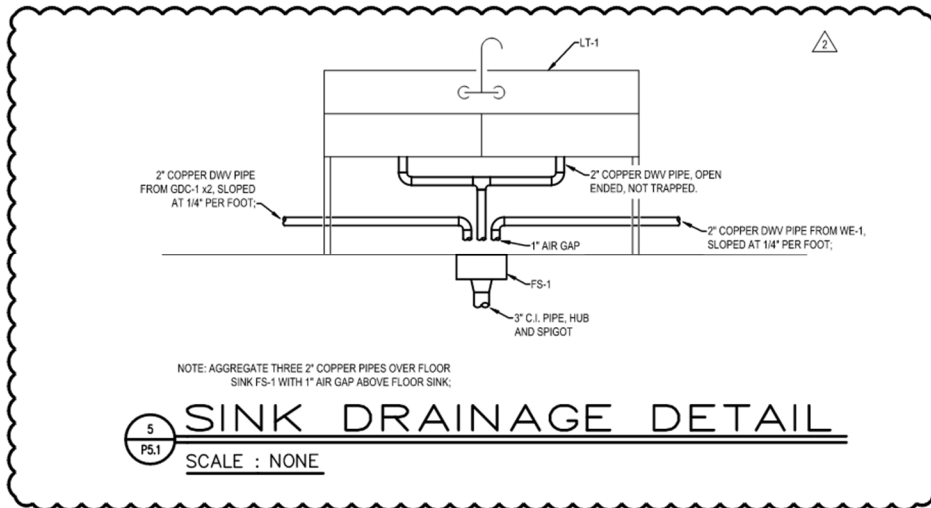

**END OF AMENDMENT NO. 2**

*Contractor must acknowledge receipt of Amendments*

Amendment #2, Dated 5/12/22